


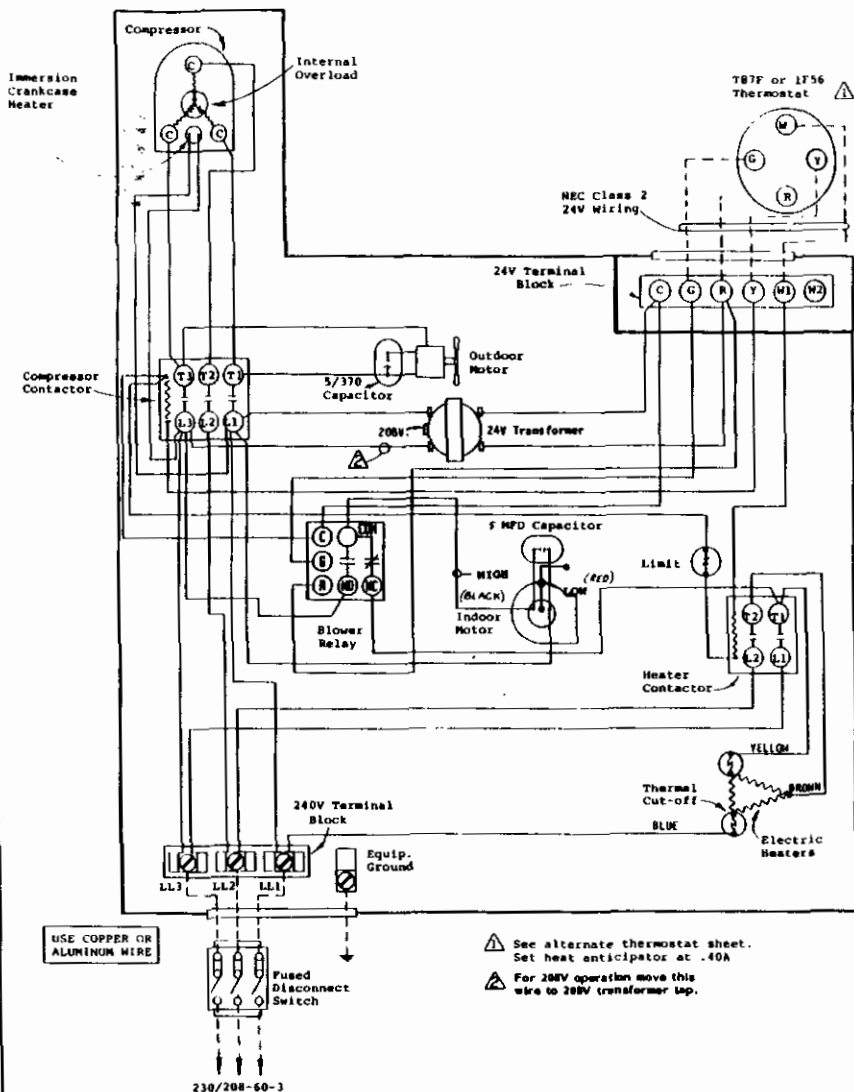

- ⚠ See alternate thermostat sheet. Set heat anticipator at .40A
- ⚠ For 208V operation move this wire to 208V transformer tap.

Factory Wiring
Field Wiring -

501960

4009-220 N