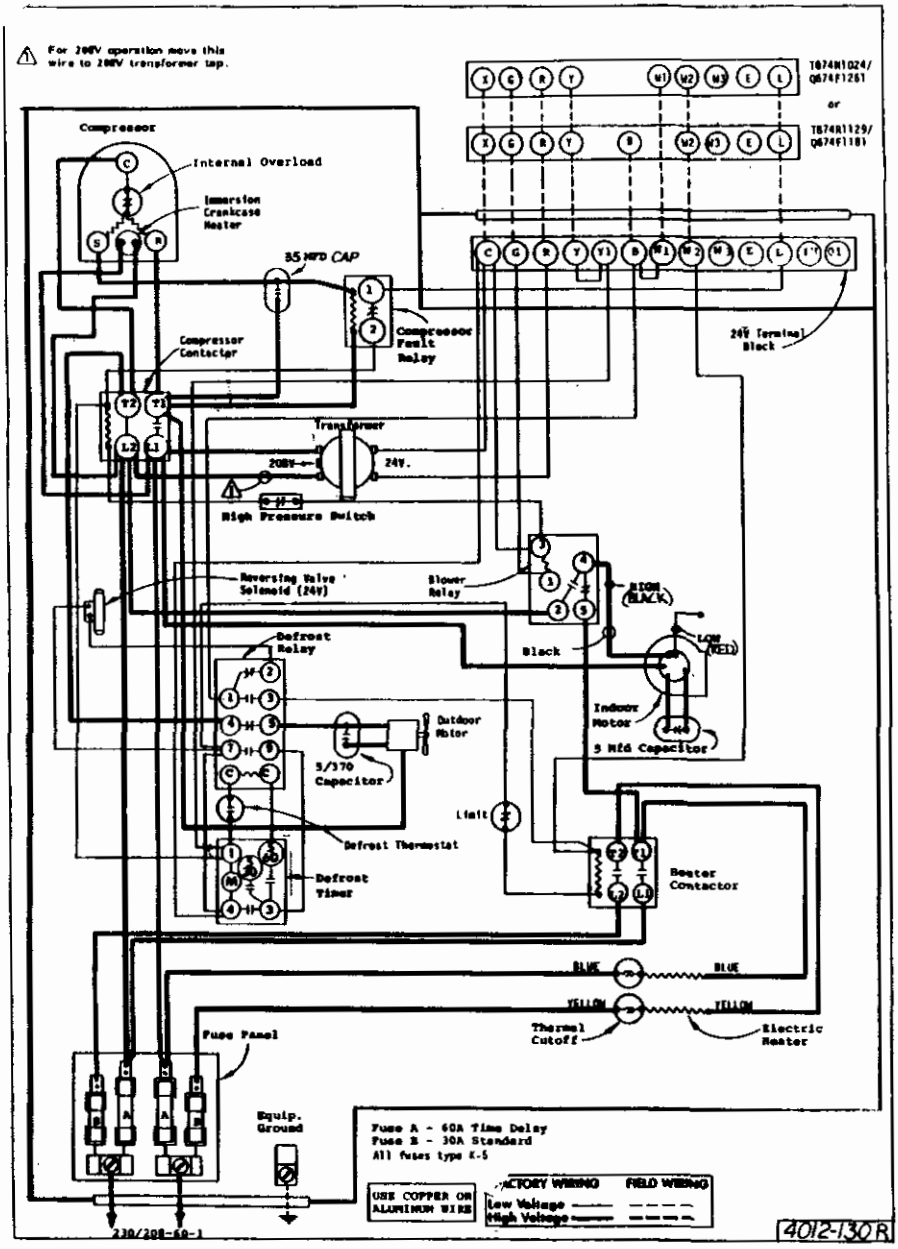
For 208V operation move this wire to 208V transformer tap.
T674N1024/ Q674F1261
or
T674R1129/ Q674F1181
Compressor
Internal Overload
Immersion Crankcase Heater
35 MFD CAP
Compressor Fault Relay
Compressor Contactor
24V Terminal Block
Transformer
208V
24V.
High Pressure Switch
Reversing Valve Solenoid (24V)
Blower Relay
HIGH (BLACK)
LOW (RED)
Black
Defrost Relay
Outdoor Motor
5/370 Capacitor
Indoor Motor
5 Mfd Capacitor
Limit
Defrost Thermostat
Defrost Timer
Heater Contactor
BLUE
YELLOW
Thermal Cutoff
Electric Heater
Fuse Panel
Equip. Ground
Fuse A - 60A Time Delay
Fuse B - 30A Standard
All fuses type K-5
USE COPPER OR ALUMINUM WIRE
FACTORY WIRING
FIELD WIRING
Low Voltage
High Voltage
230/208-60-1
4012-130R