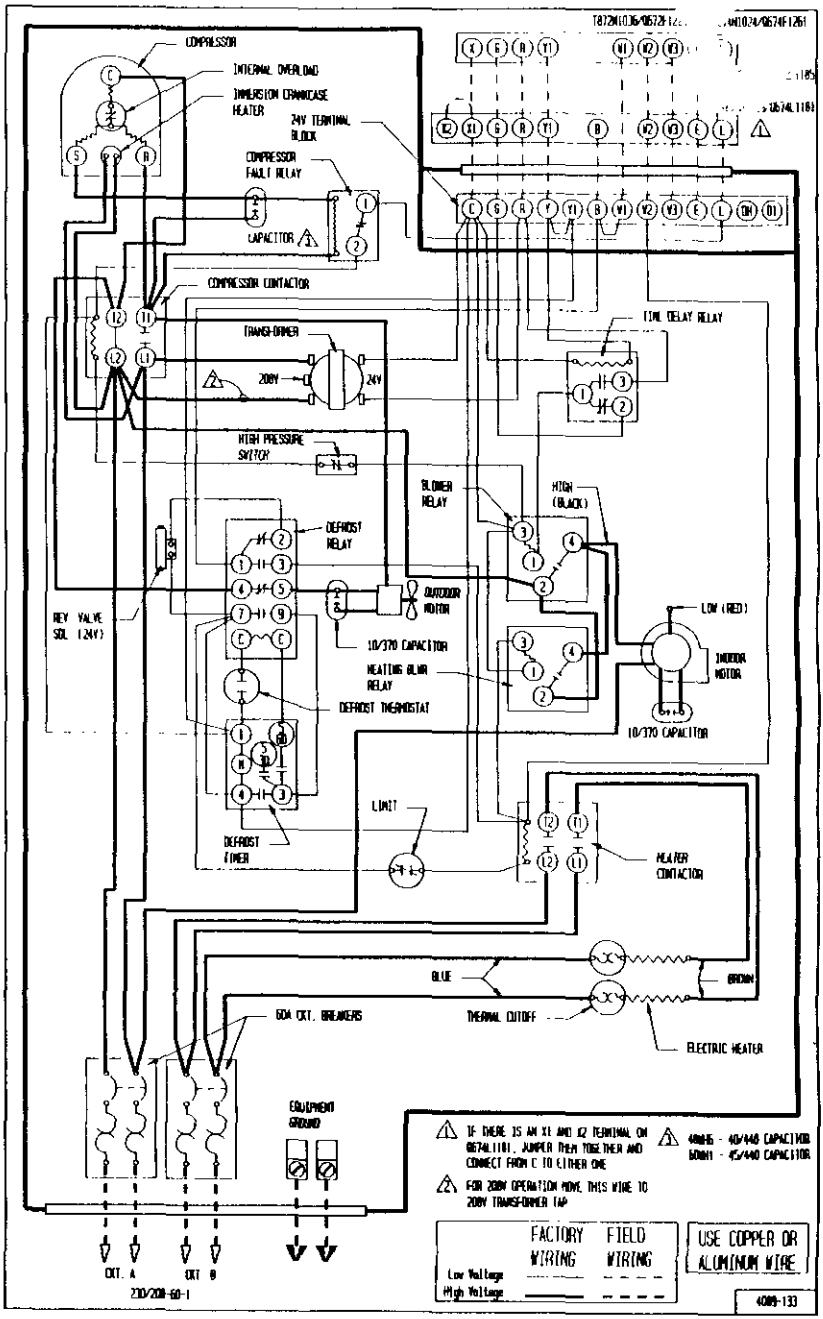
COMPRESSOR
INTERNAL OVERLOAD
IMMERSION CRANKCASE HEATER
24V TERMINAL BLOCK
COMPRESSOR FAULT RELAY
CAPACITOR
COMPRESSOR CONTACTOR
TIME DELAY RELAY
TRANSFORMER
208V
24V
HIGH PRESSURE SWITCH
BLOWER RELAY
HIGH (BLACK)
DEFROST RELAY
OUTDOOR MOTOR
REV VALVE SOL (24V)
10/370 CAPACITOR
HEATING BLWR RELAY
DEFROST THERMOSTAT
LOW (RED)
INDOOR MOTOR
10/370 CAPACITOR
LIMIT
DEFROST TIMER
HEATER CONTACTOR
BLUE
BROWN
THERMAL CUTOFF
ELECTRIC HEATER
60A CKT. BREAKERS
EQUIPMENT GROUND
CKT. A
CKT. B
230/208-60-1
IF THERE IS AN X1 AND X2 TERMINAL ON 0674L1181, JUMPER THEM TOGETHER AND CONNECT FROM C TO EITHER ONE
FOR 208V OPERATION MOVE THIS WIRE TO 208V TRANSFORMER TAP
40MFD - 40/440 CAPACITOR
60MFD - 45/440 CAPACITOR
FACTORY WIRING
FIELD WIRING
Low Voltage
High Voltage
USE COPPER OR ALUMINUM WIRE
4089-133