


T772N1135/0672F1220B OR T774N1135/0674F1261

T772N1134/0672L1102

OR

T774N1125/0674L1101

⚠

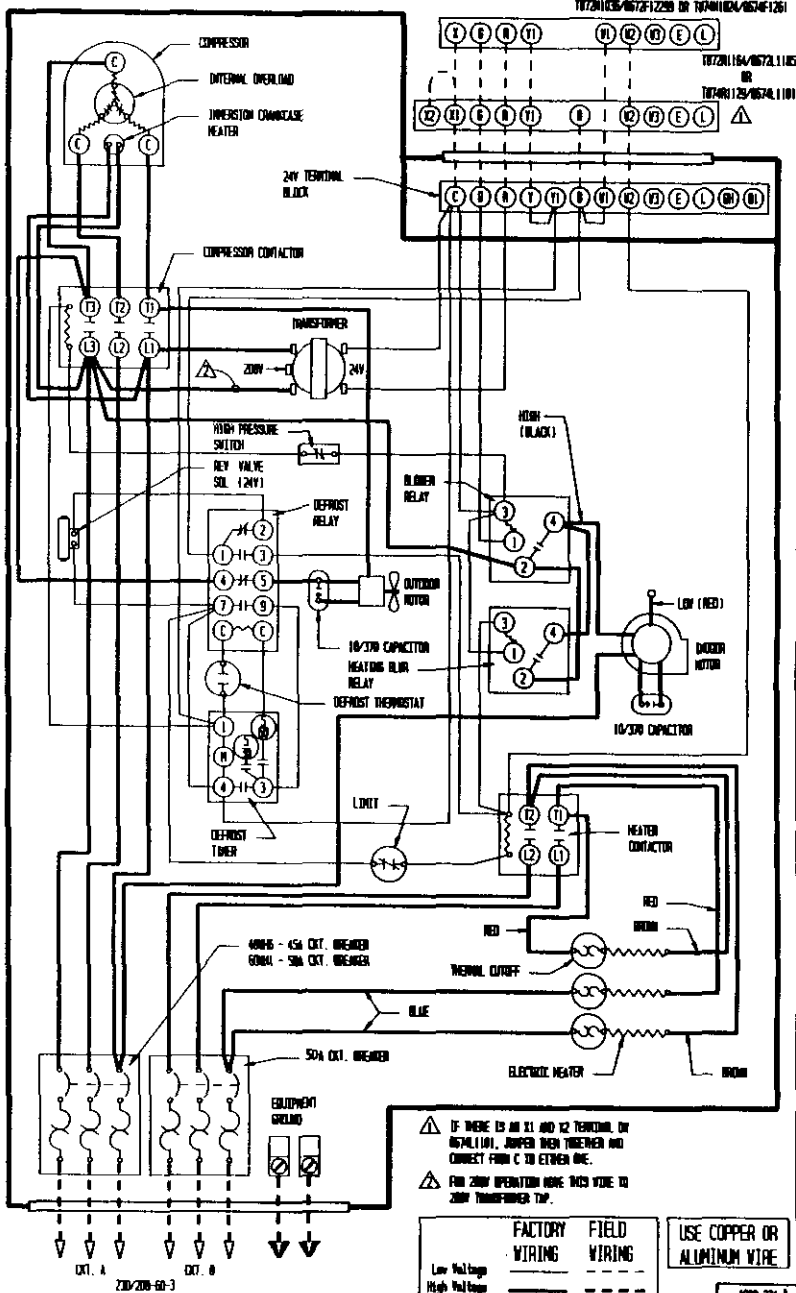

- ⚠ IF THERE IS AN XL AND XL TERMINAL ON INSTALLATION, JUMP THEM TOGETHER AND CONNECT FROM C TO EITHER ONE.
- ⚠ FOR 200V OPERATION RUN THIS WIRE TO 200V TRANSFORMER TAP.

FACTORY WIRING	FIELD WIRING	USE COPPER OR ALUMINUM WIRE
Low Voltage	-----	-----
High Voltage	-----	-----

400B-231 A