


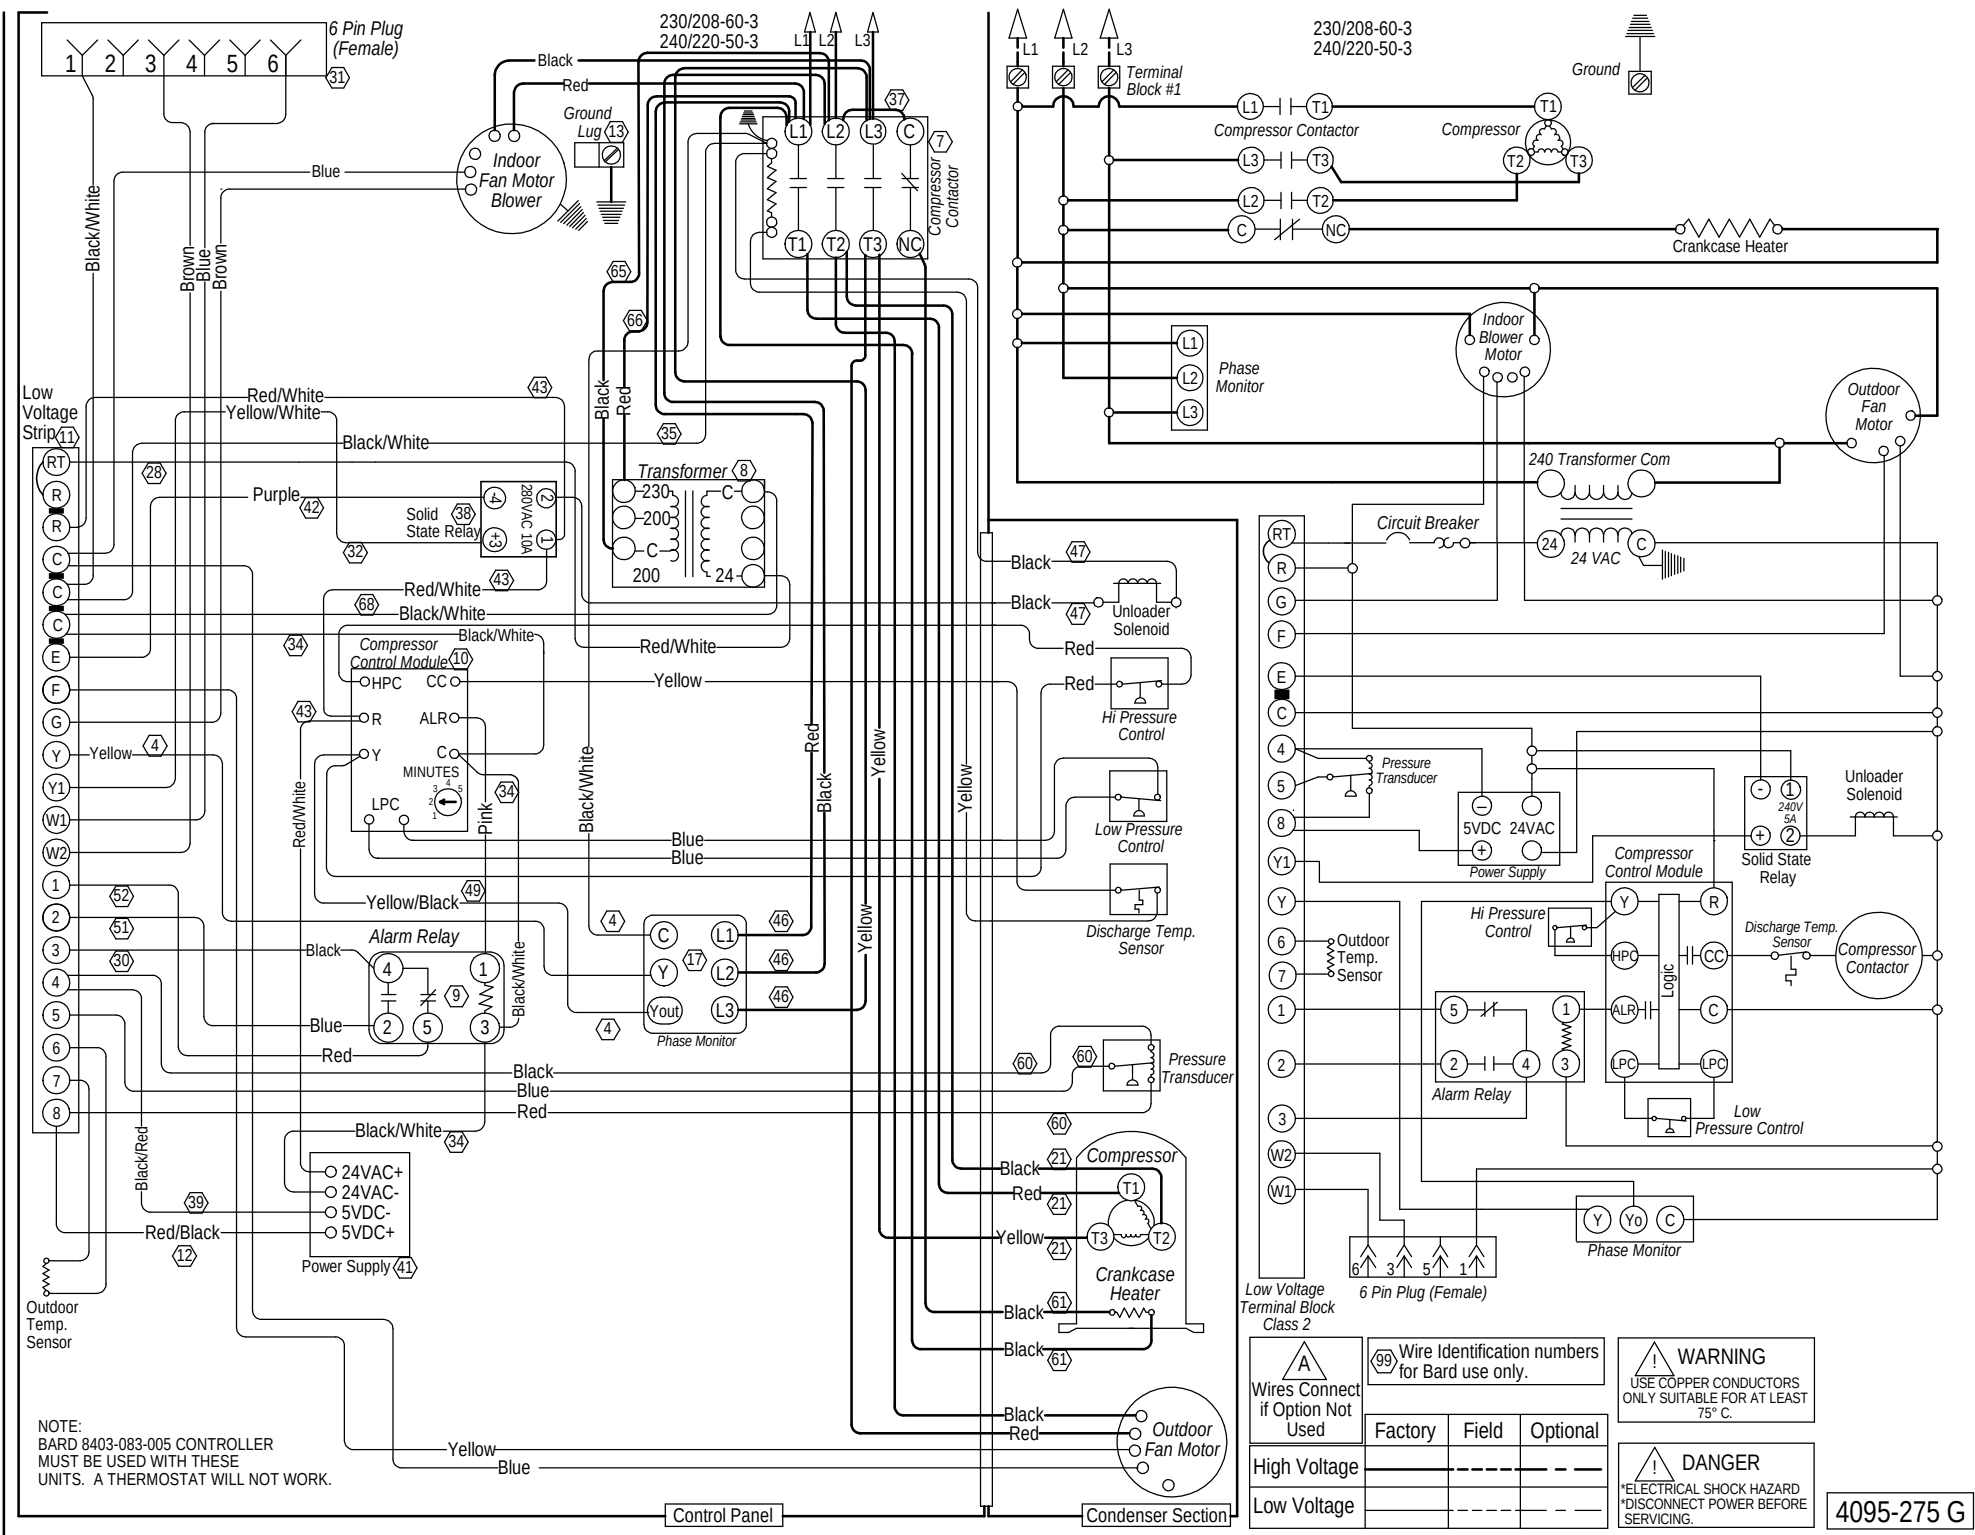

NOTE:
BARD 8403-083-005 CONTROLLER
MUST BE USED WITH THESE
UNITS. A THERMOSTAT WILL NOT WORK.

Wires Connect if Option Not Used	Factory		
	Field		
High Voltage	-----		

Low Voltage	-----		

WARNING
USE COPPER CONDUCTORS
ONLY SUITABLE FOR AT LEAST
75° C.

DANGER
ELECTRICAL SHOCK HAZARD
DISCONNECT POWER BEFORE
SERVICING.