


230/208-60-3

For Vent Wiring or controller/thermostat connections, see literature packet or go to [www.bardhvac.com](http://www.bardhvac.com)

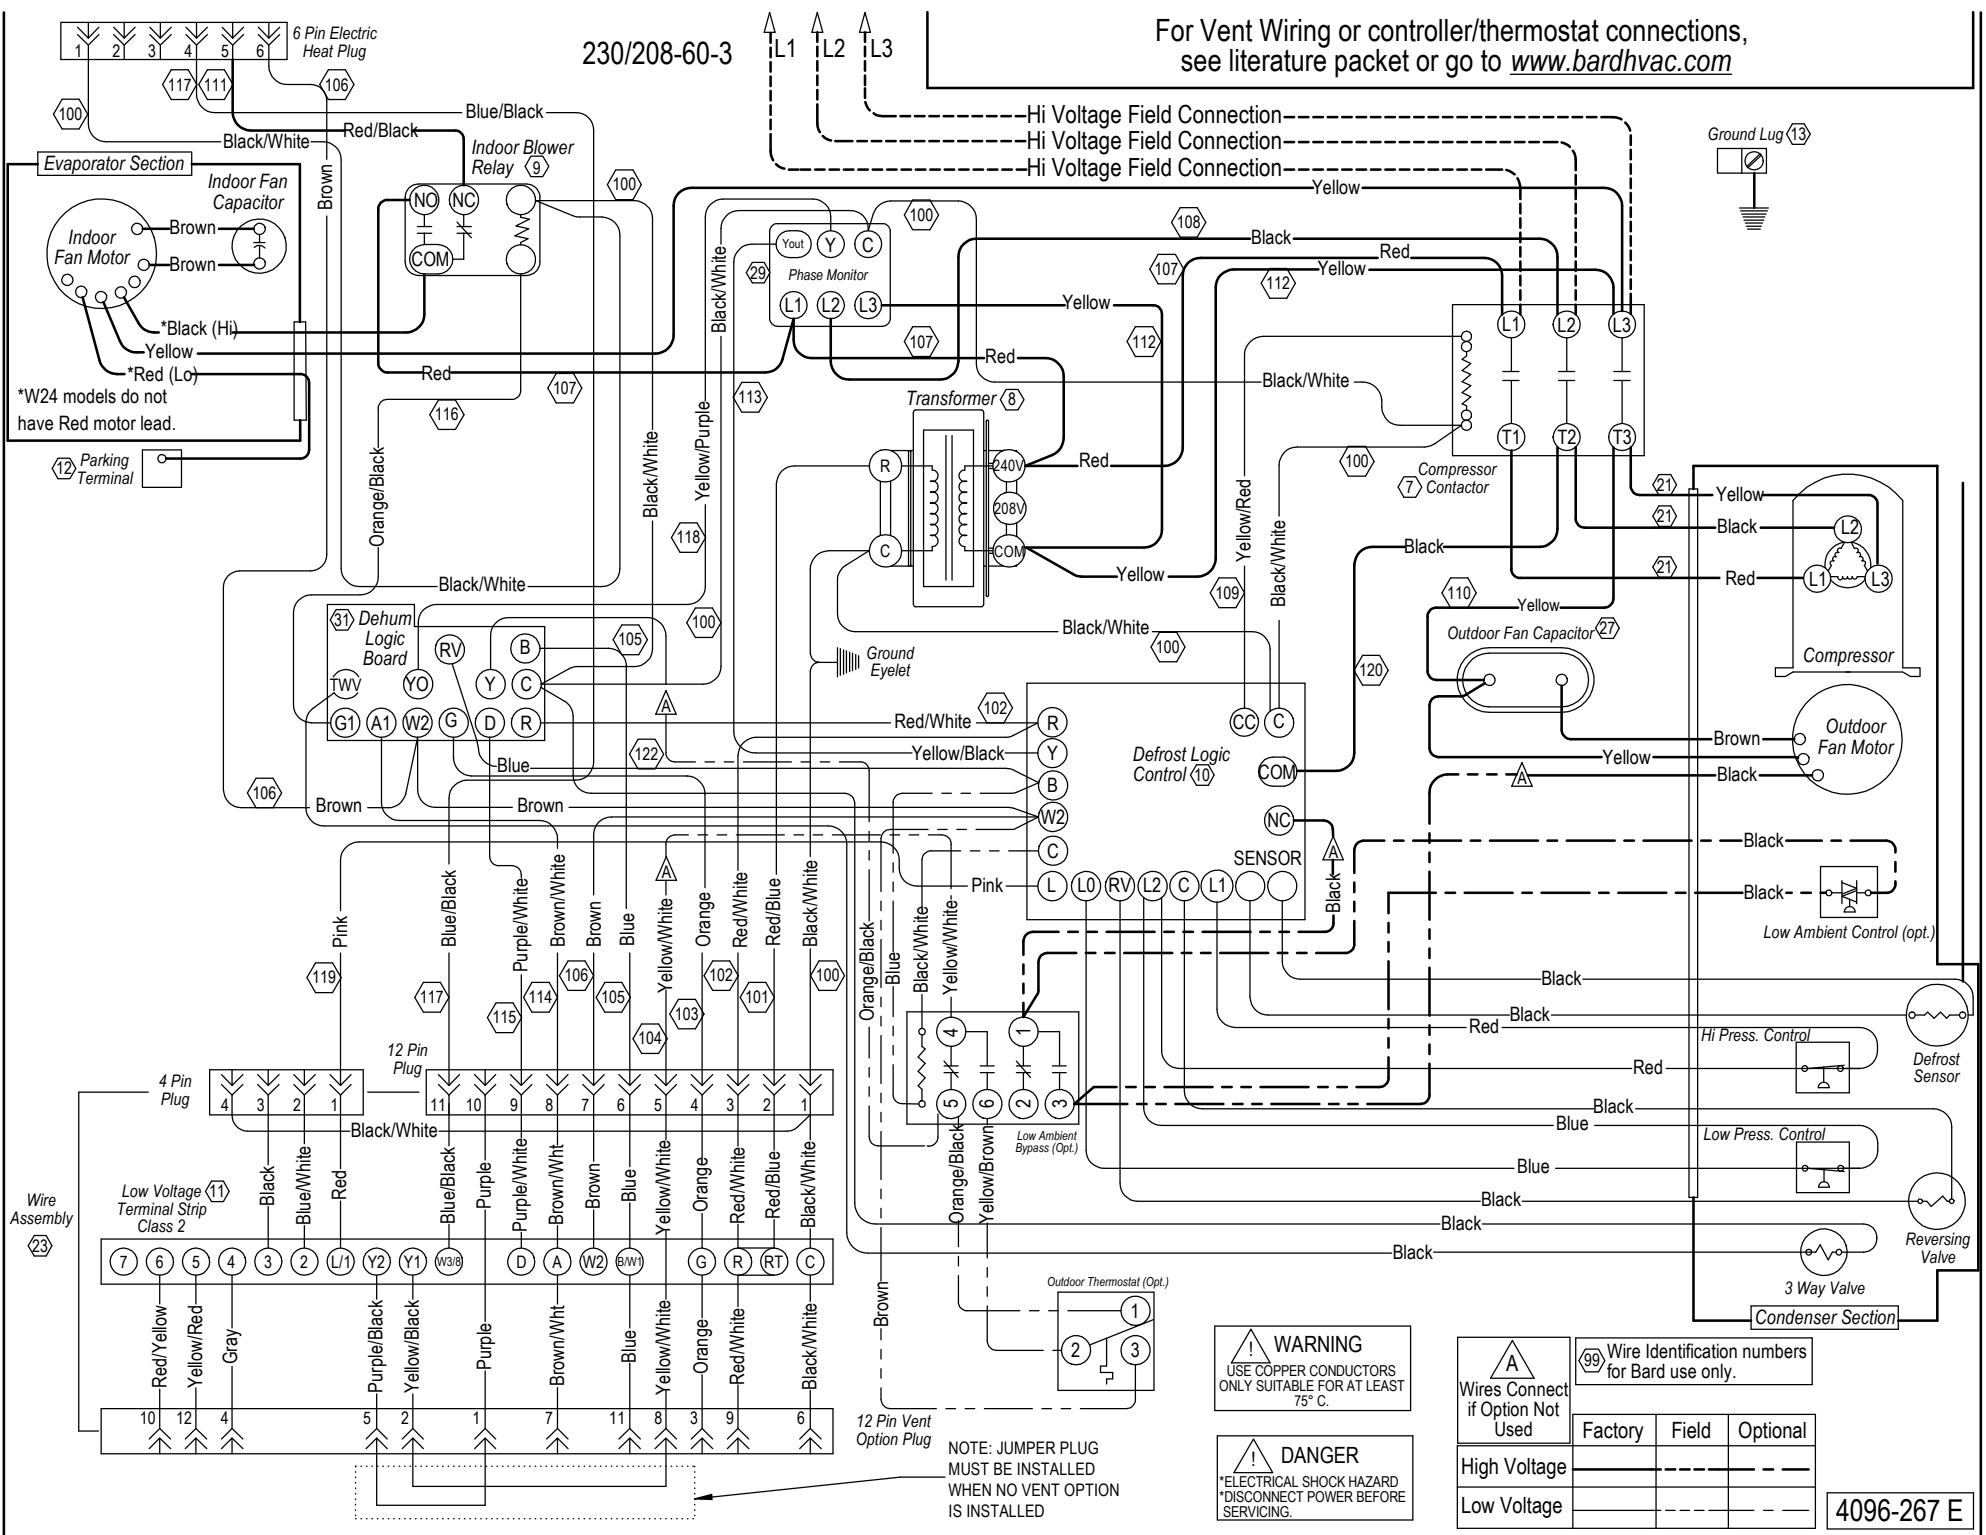

\*W24 models do not have Red motor lead.

NOTE: JUMPER PLUG MUST BE INSTALLED WHEN NO VENT OPTION IS INSTALLED

**WARNING**  
USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.

**DANGER**  
ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING.

**Wires Connect if Option Not Used**

	Factory	Field	Optional
High Voltage			
Low Voltage			

**99 Wire Identification numbers for Bard use only.**

4096-267 E