


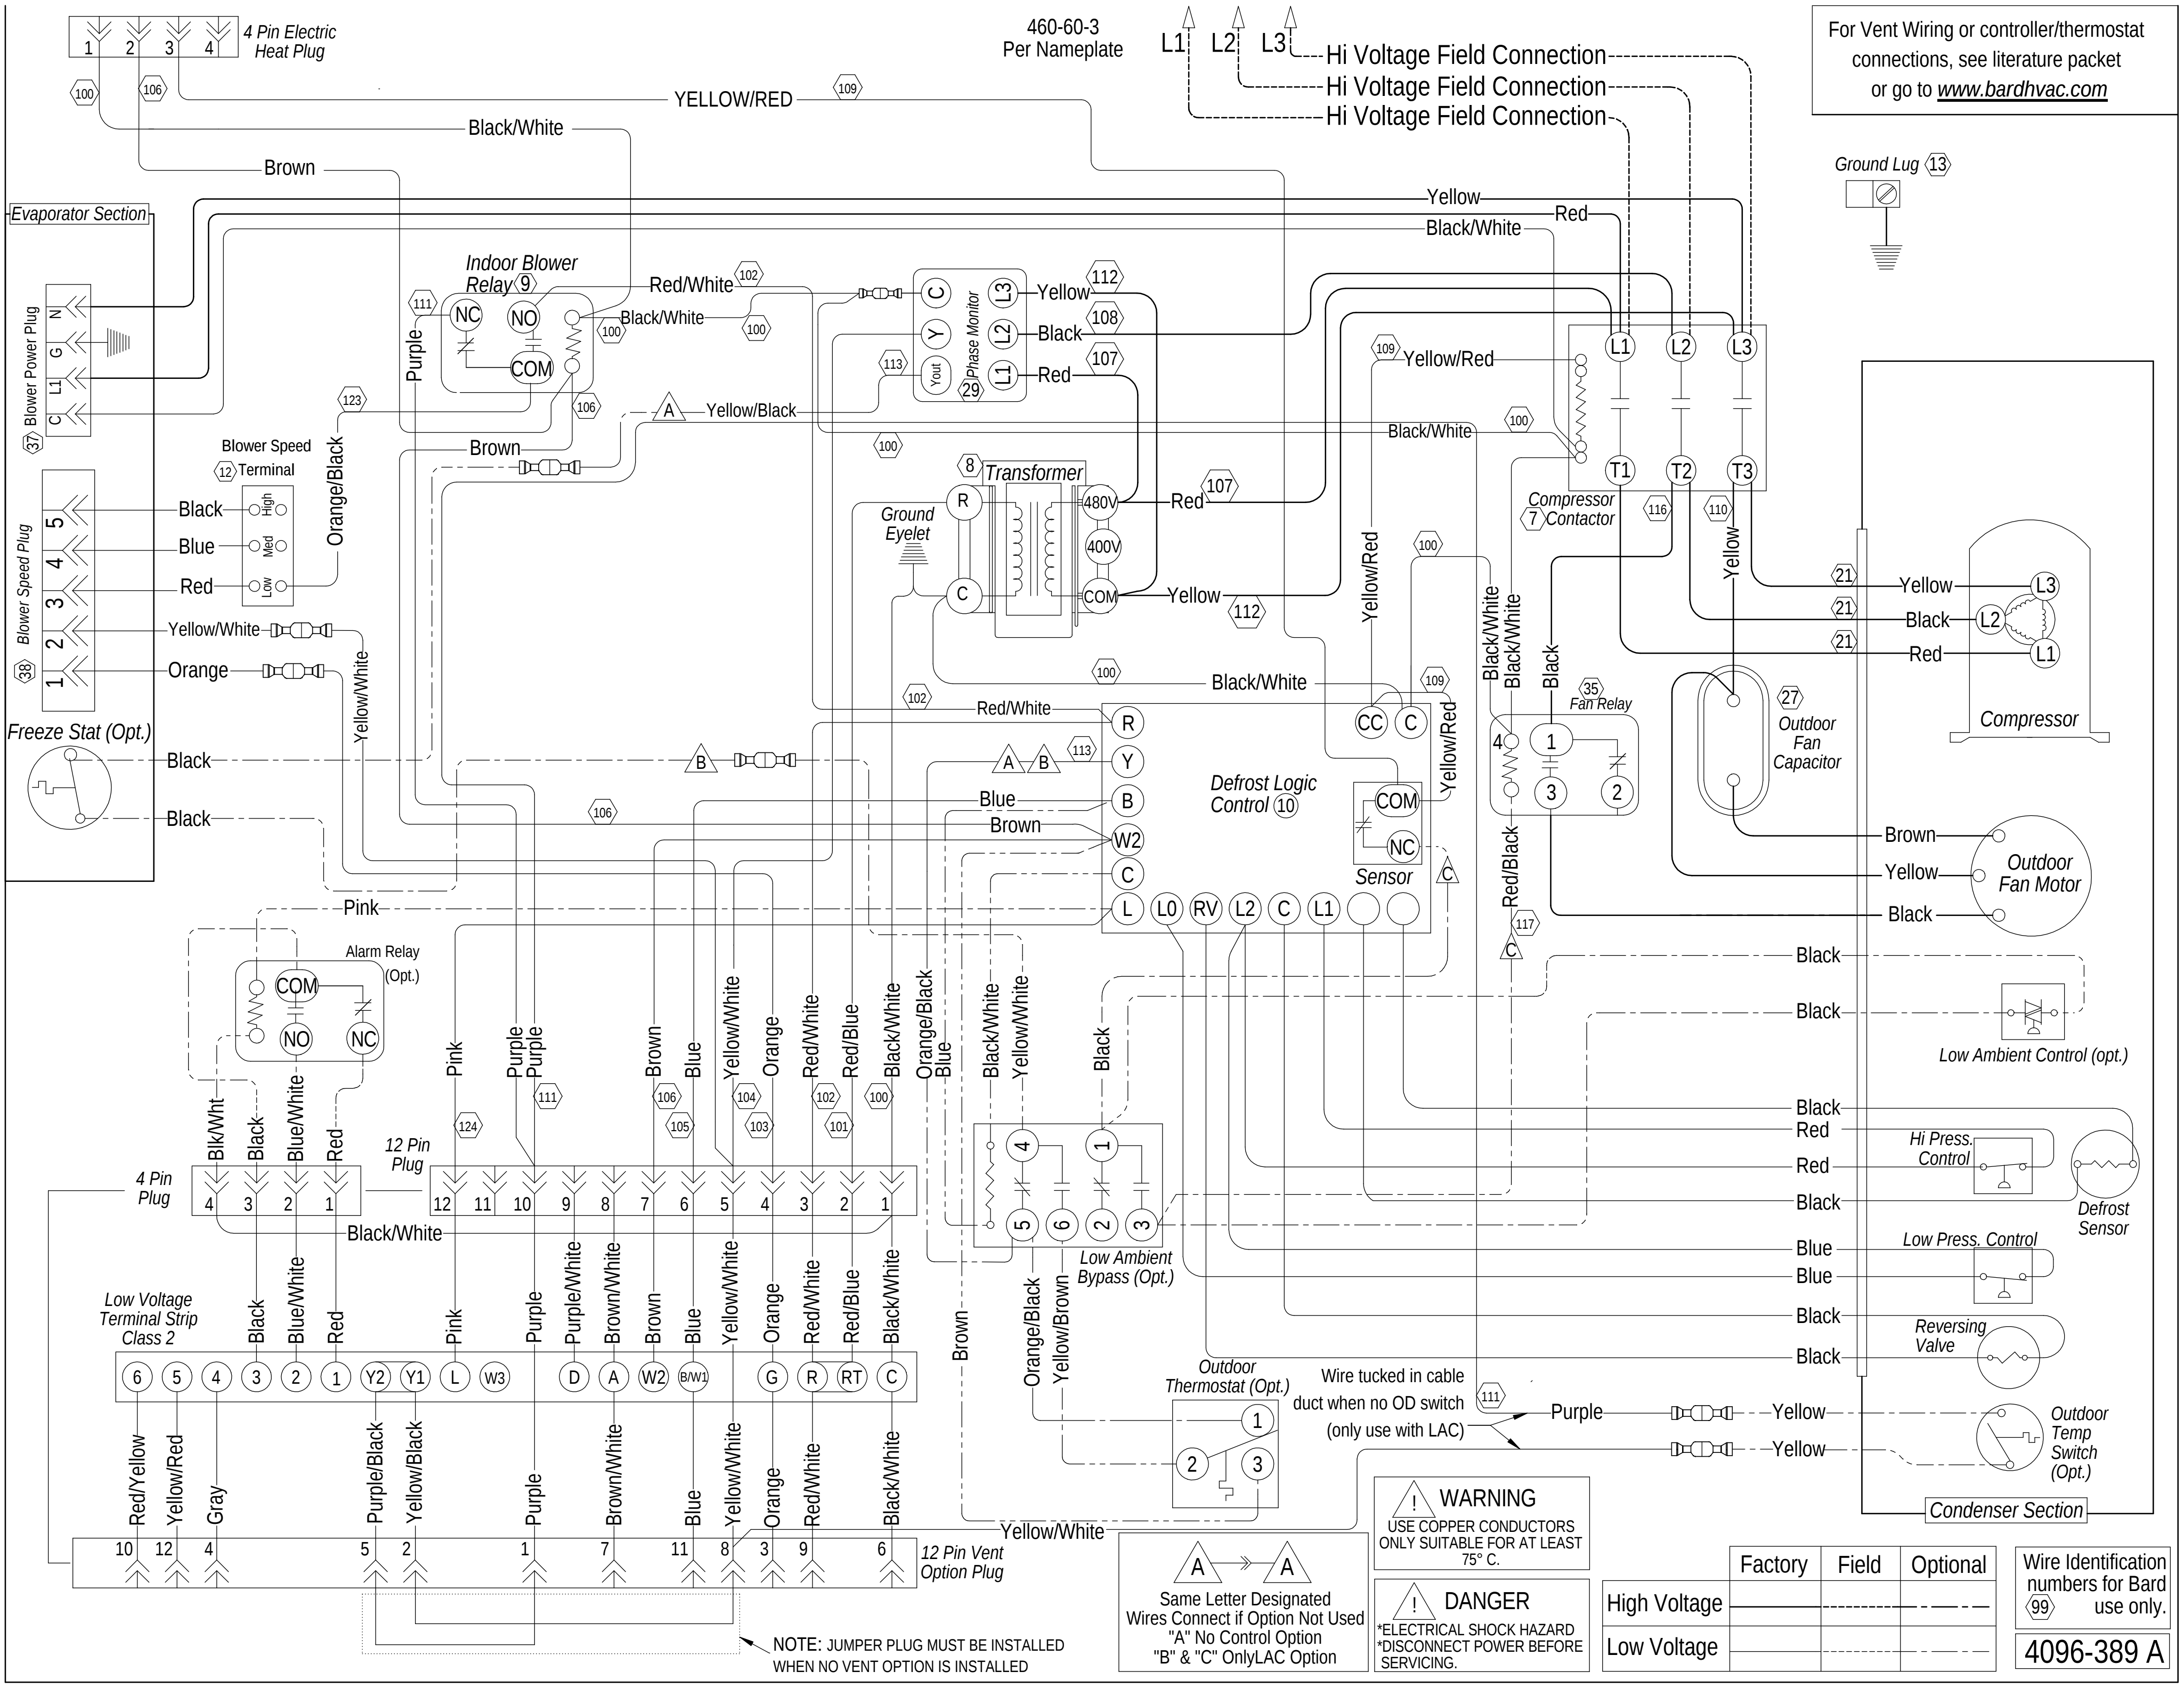

For Vent Wiring or controller/thermostat connections, see literature packet or go to [www.bardhvac.com](http://www.bardhvac.com)

|              | Factory | Field | Optional |
|--------------|---------|-------|----------|
| High Voltage |         |       |          |
| Low Voltage  |         |       |          |

|                                                |
|------------------------------------------------|
| Wire Identification numbers for Bard use only. |
| 4096-389 A                                     |