


NOTE: THIS IS LOCATED

IN UPPER CONTROL PANEL ON THE W42-72

For Vent Wiring or controller/thermostat connections, see literature packet or go to www.bardhvac.com

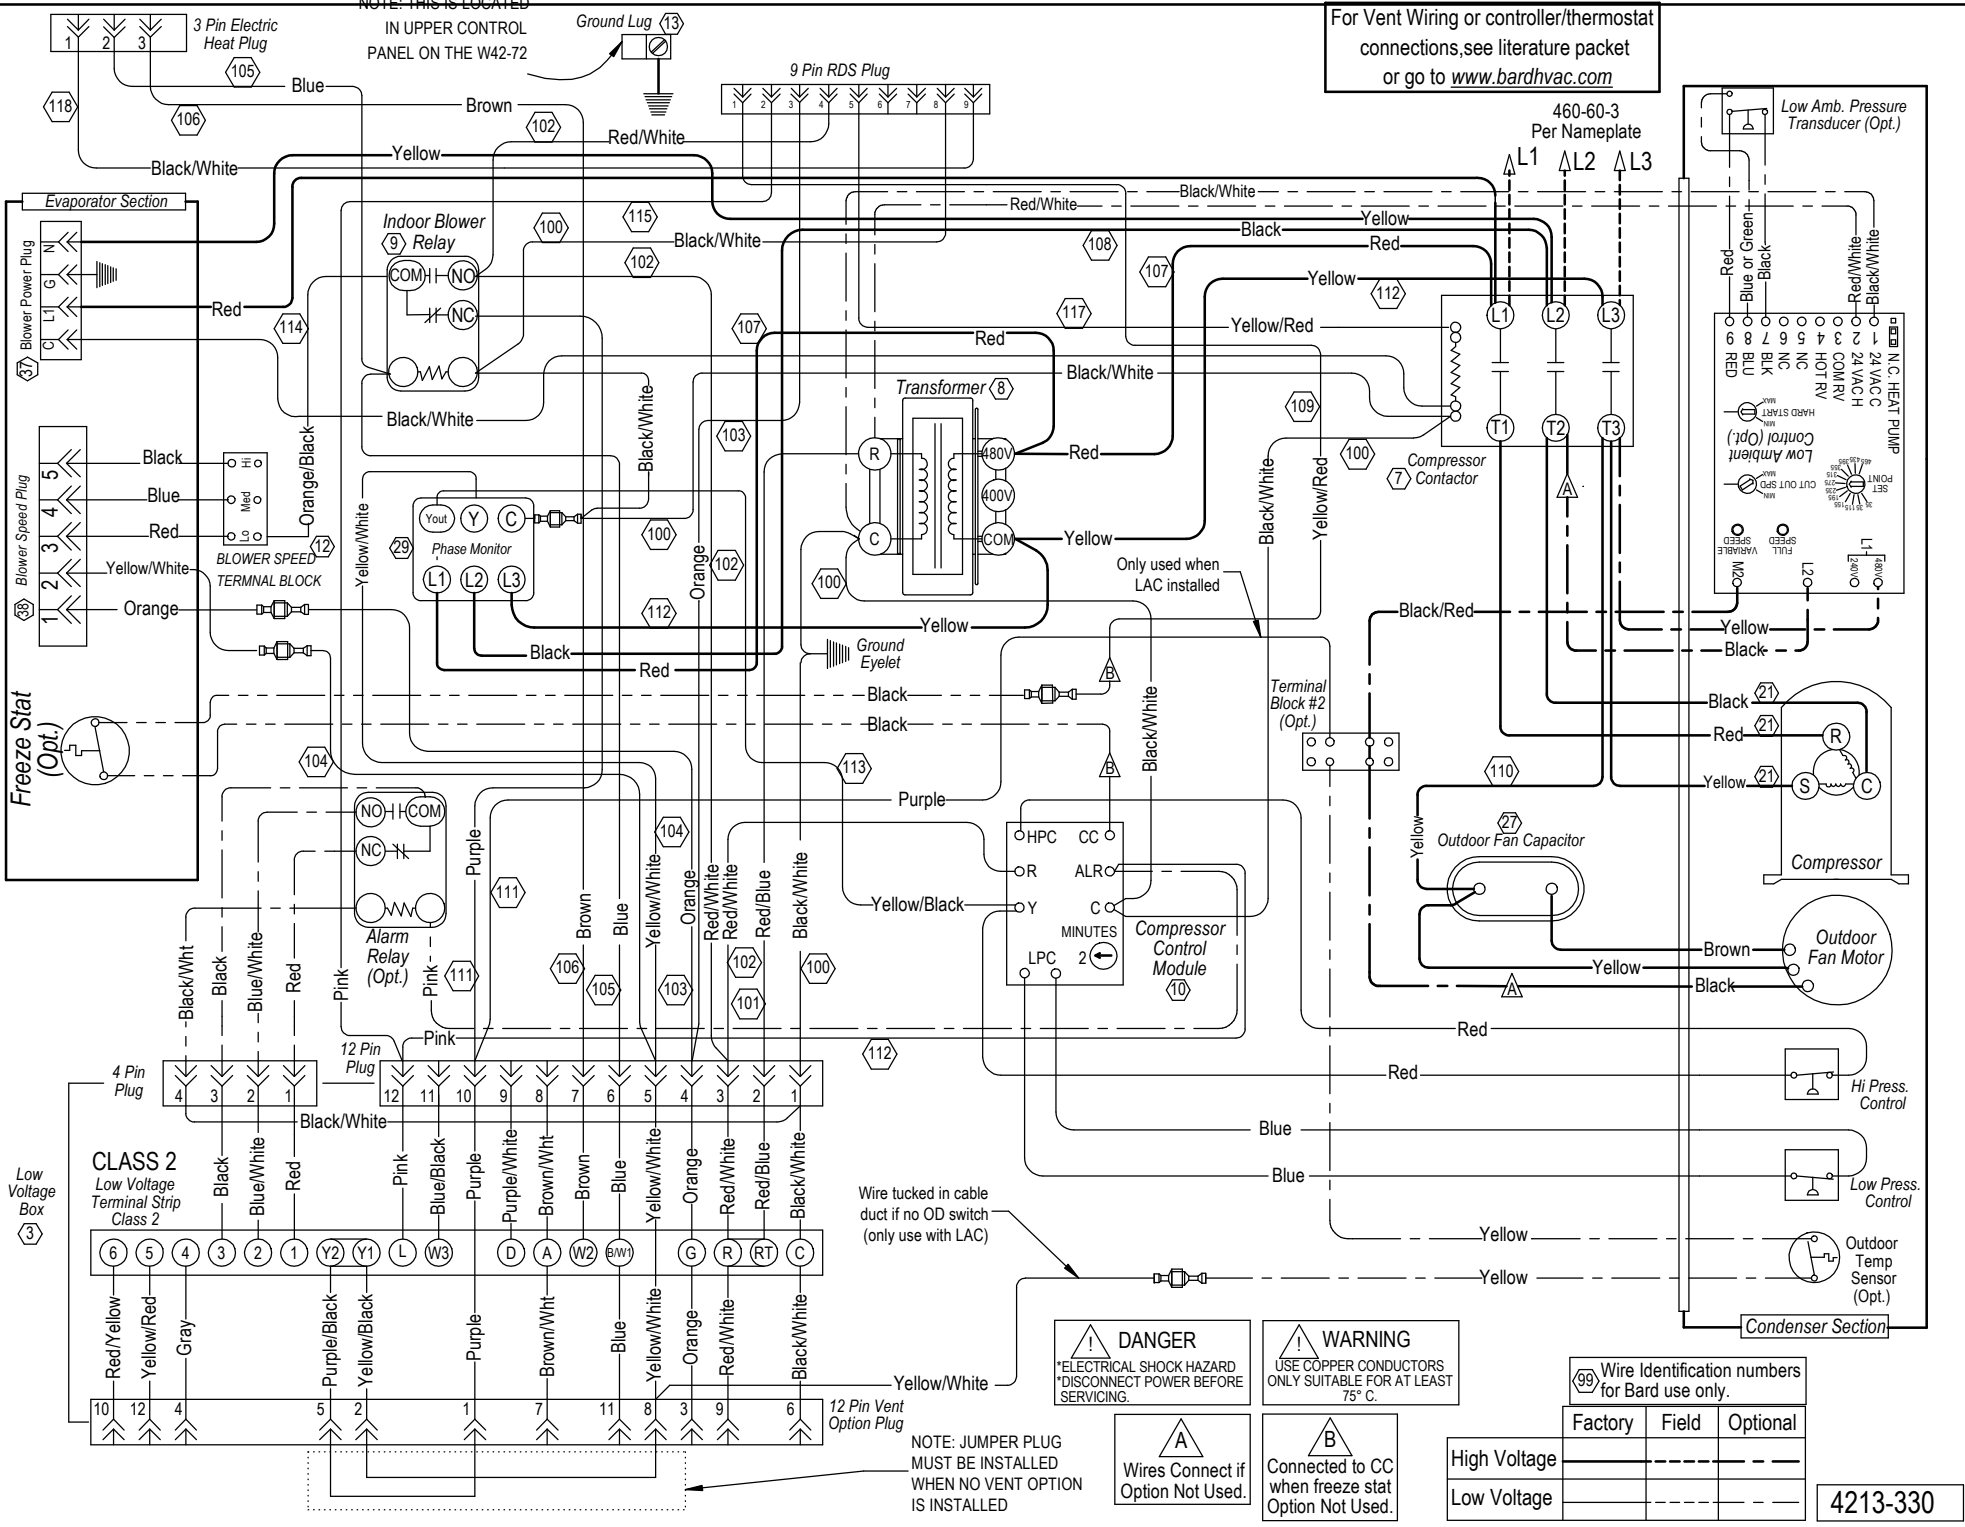

⚠ DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE SERVICING.

⚠ WARNING
USE COPPER CONDUCTORS
ONLY SUITABLE FOR AT LEAST 75° C.

A
Wires Connect if Option Not Used.

B
Connected to CC when freeze stat Option Not Used.

NOTE: JUMPER PLUG MUST BE INSTALLED WHEN NO VENT OPTION IS INSTALLED

99 Wire Identification numbers for Bard use only.

	Factory	Field	Optional
High Voltage			
Low Voltage			

4213-330