


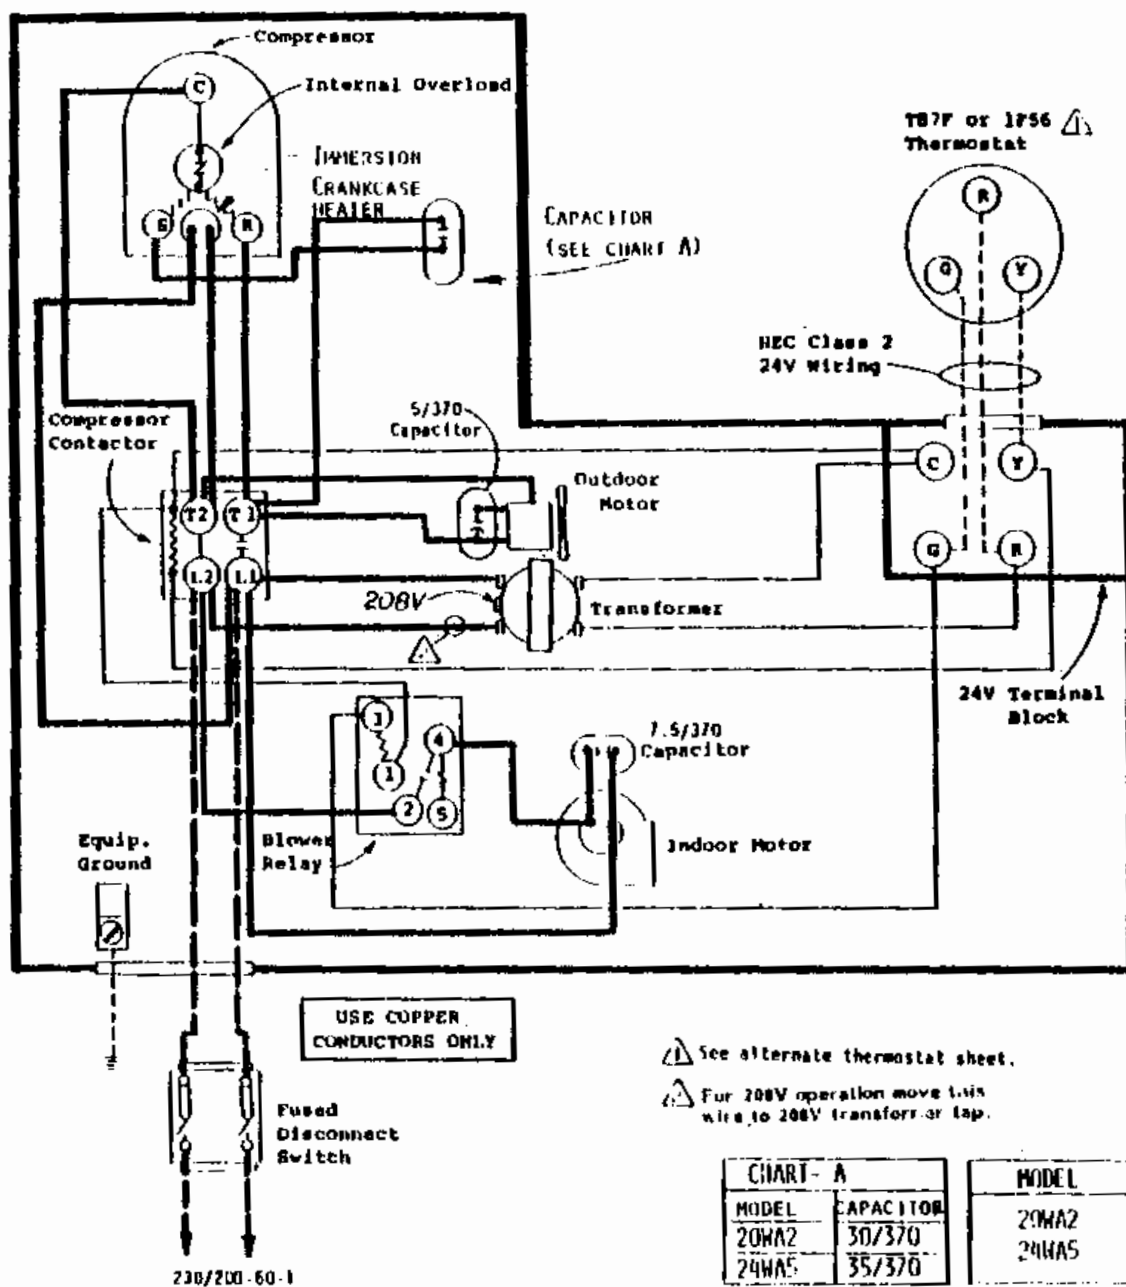


CHART - A		MODEL
MODEL	CAPACITOR	
20HA2	30/370	20HA2
24HA5	35/370	24HA5

FACTORY WIRING	FIELD WIRING
Low Voltage	Low Voltage
High Voltage	High Voltage

4007-110 I

CHART A	
MODEL	CAPACITANCE
21MA2	40/370
21MA5	35/370

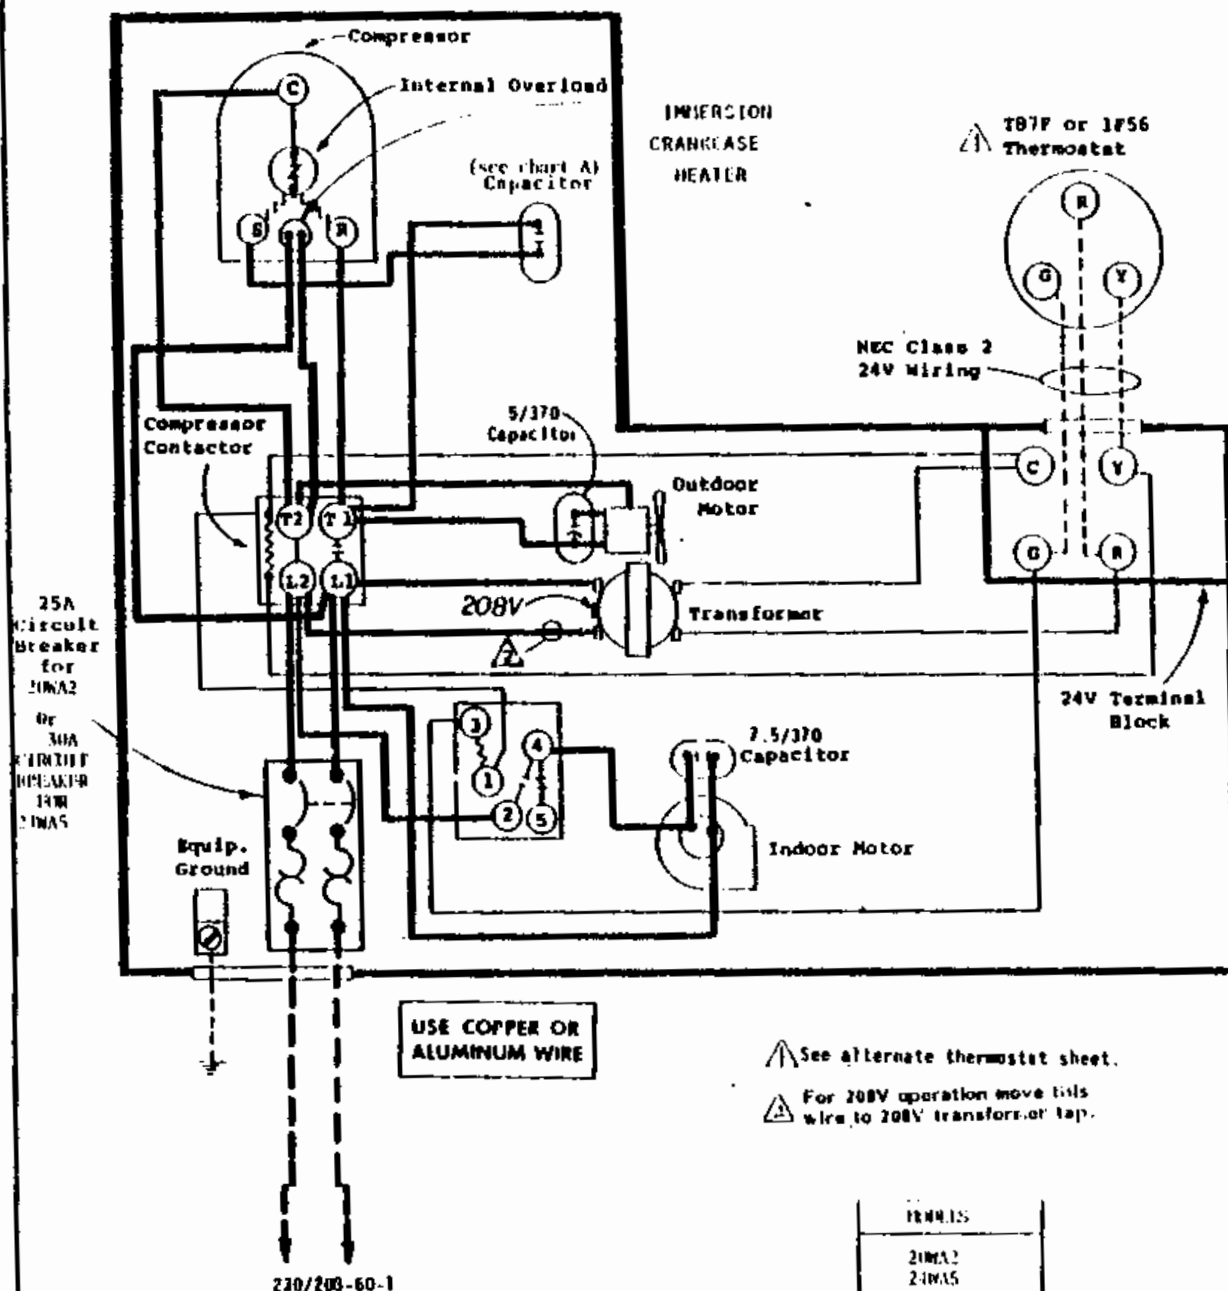


21MA2
21MA5

FACTORY WIRING	FIELD WIRING
Low Voltage	-----
High Voltage	-----

4007-111B

CHART A	
MODEL	CAPACITOR
20WA2	30/370
24WA5	35/370

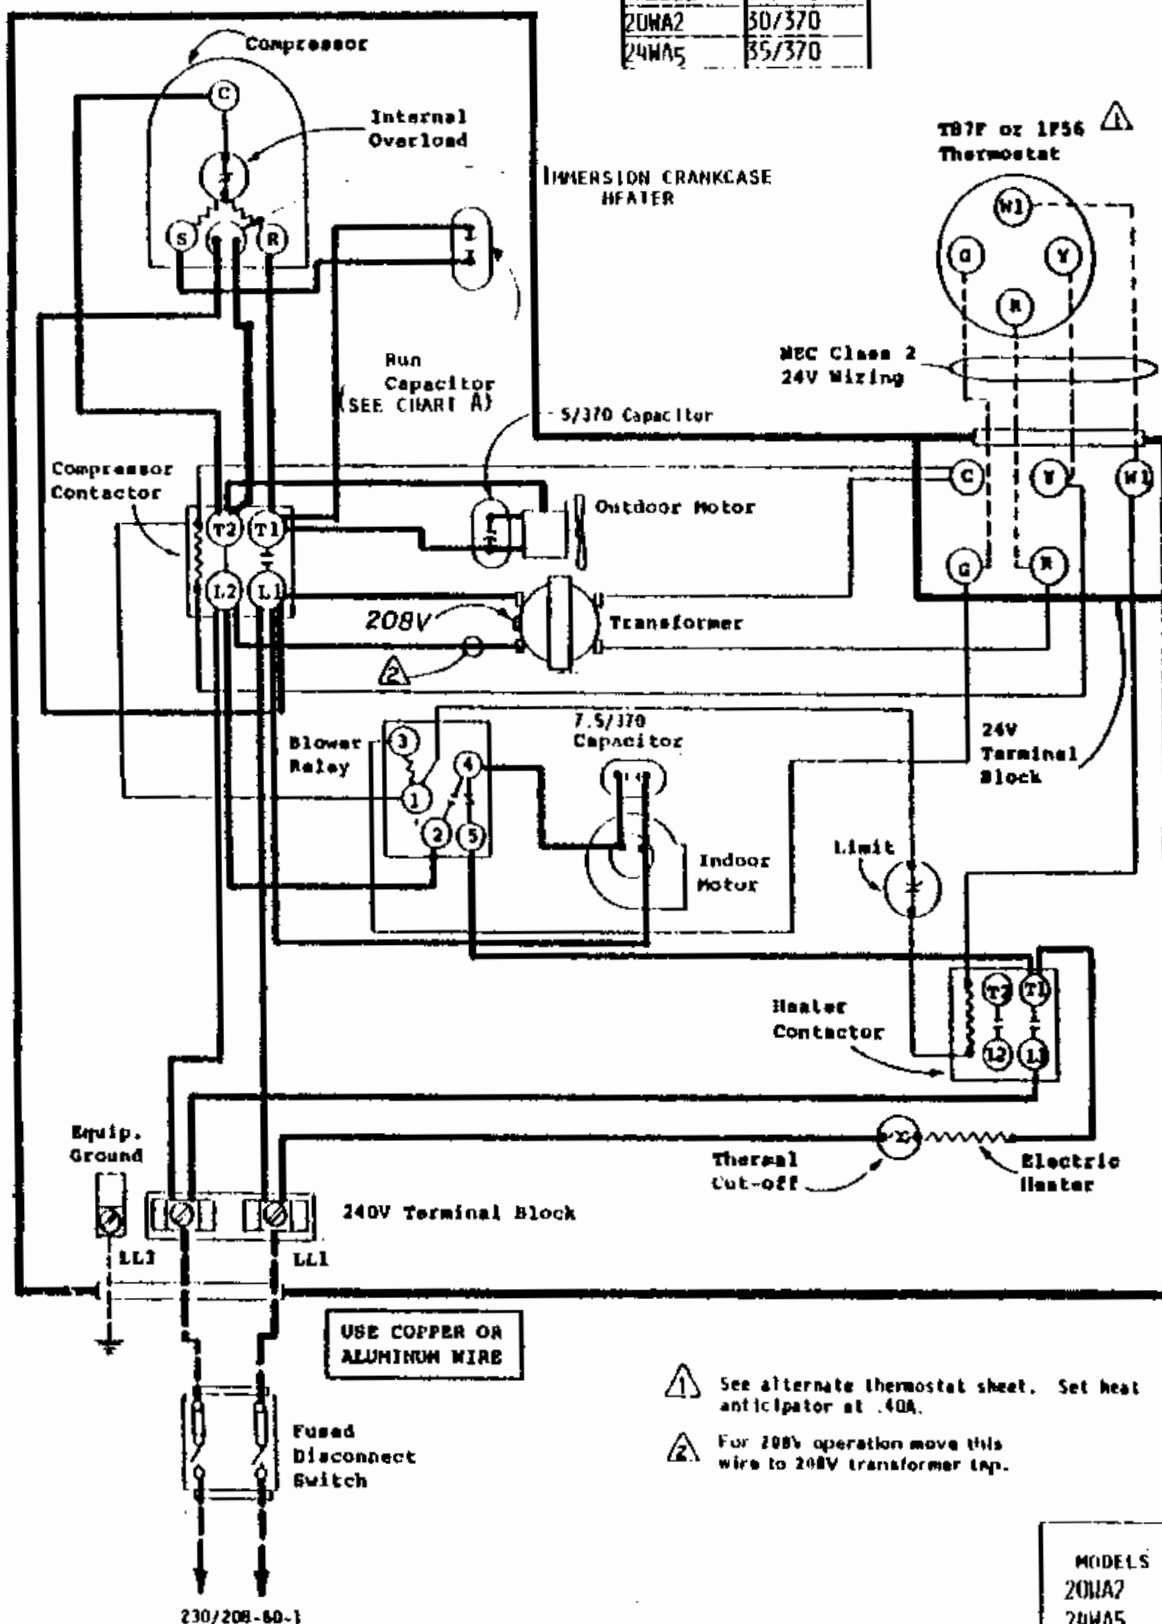

- ⚠ See alternate thermostat sheet. Set heat anticipator at .40A.
- ⚠ For 208V operation move this wire to 208V transformer tap.

MODELS
20WA2
24WA5
W/4 OR 5KW

FACTORY WIRING	FIELD WIRING
Low Voltage ———	Low Voltage ———
High Voltage ———	High Voltage ———

4007-120I


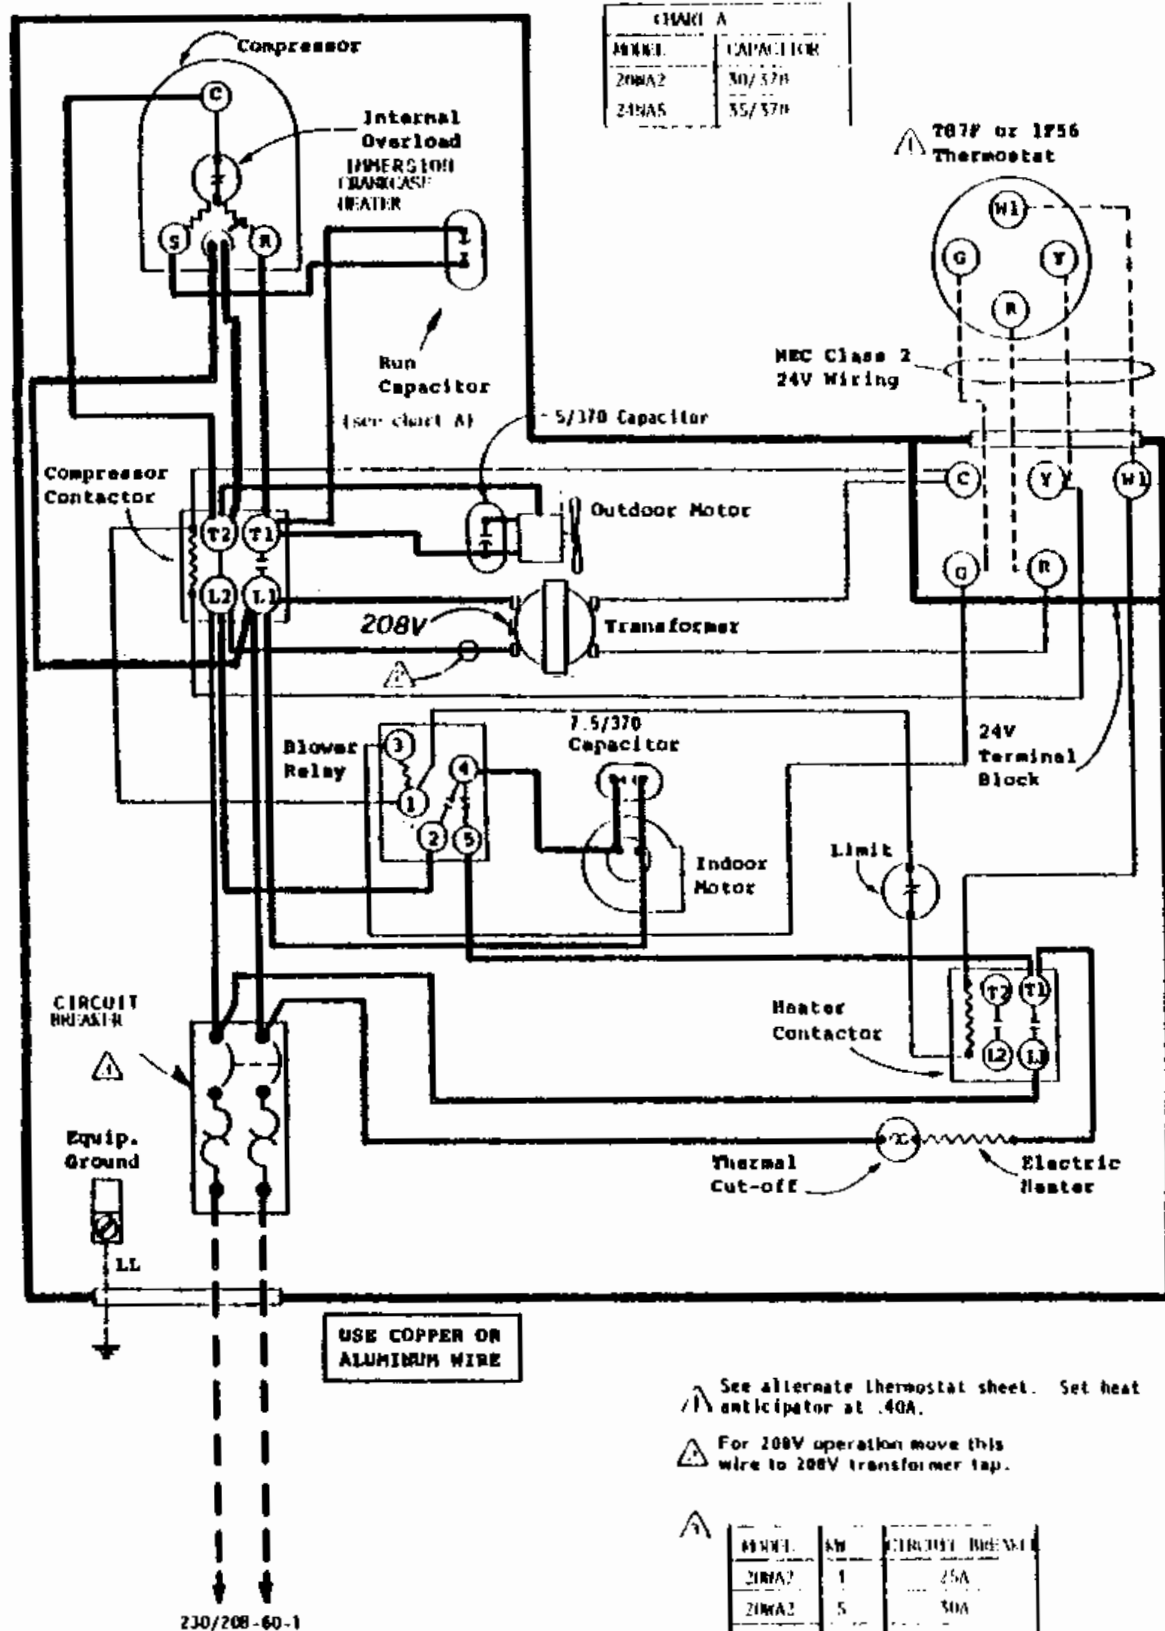



TABLE A	
MODEL	CAPACITOR
20MA2	50/370
21MA5	35/370

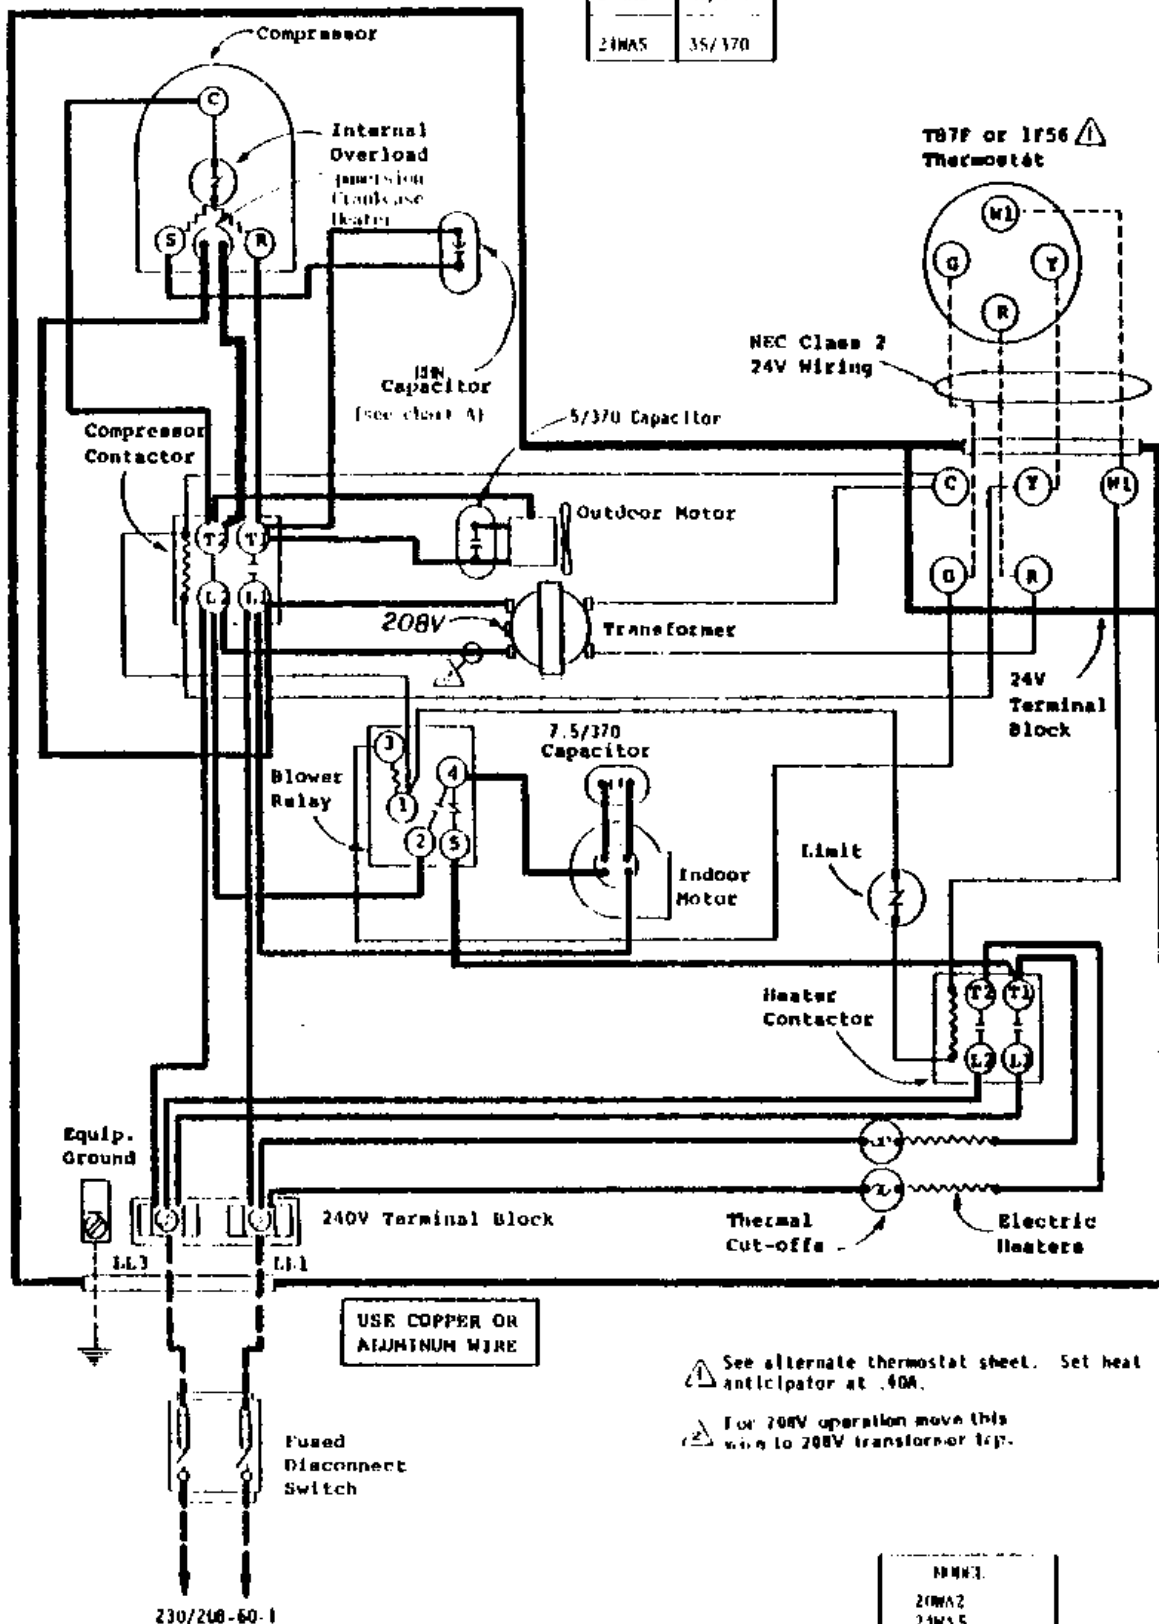

⚠ See alternate thermostat sheet. Set heat anticipator at .40A.
 ⚡ For 208V operation move this wire to 208V transformer tap.

MODEL
20MA2
21MA5
W/ 8 OR 10KW

CIRCUIT A	
MODEL	CAPACITOR
20MA2	30/370
24MA5	35/370

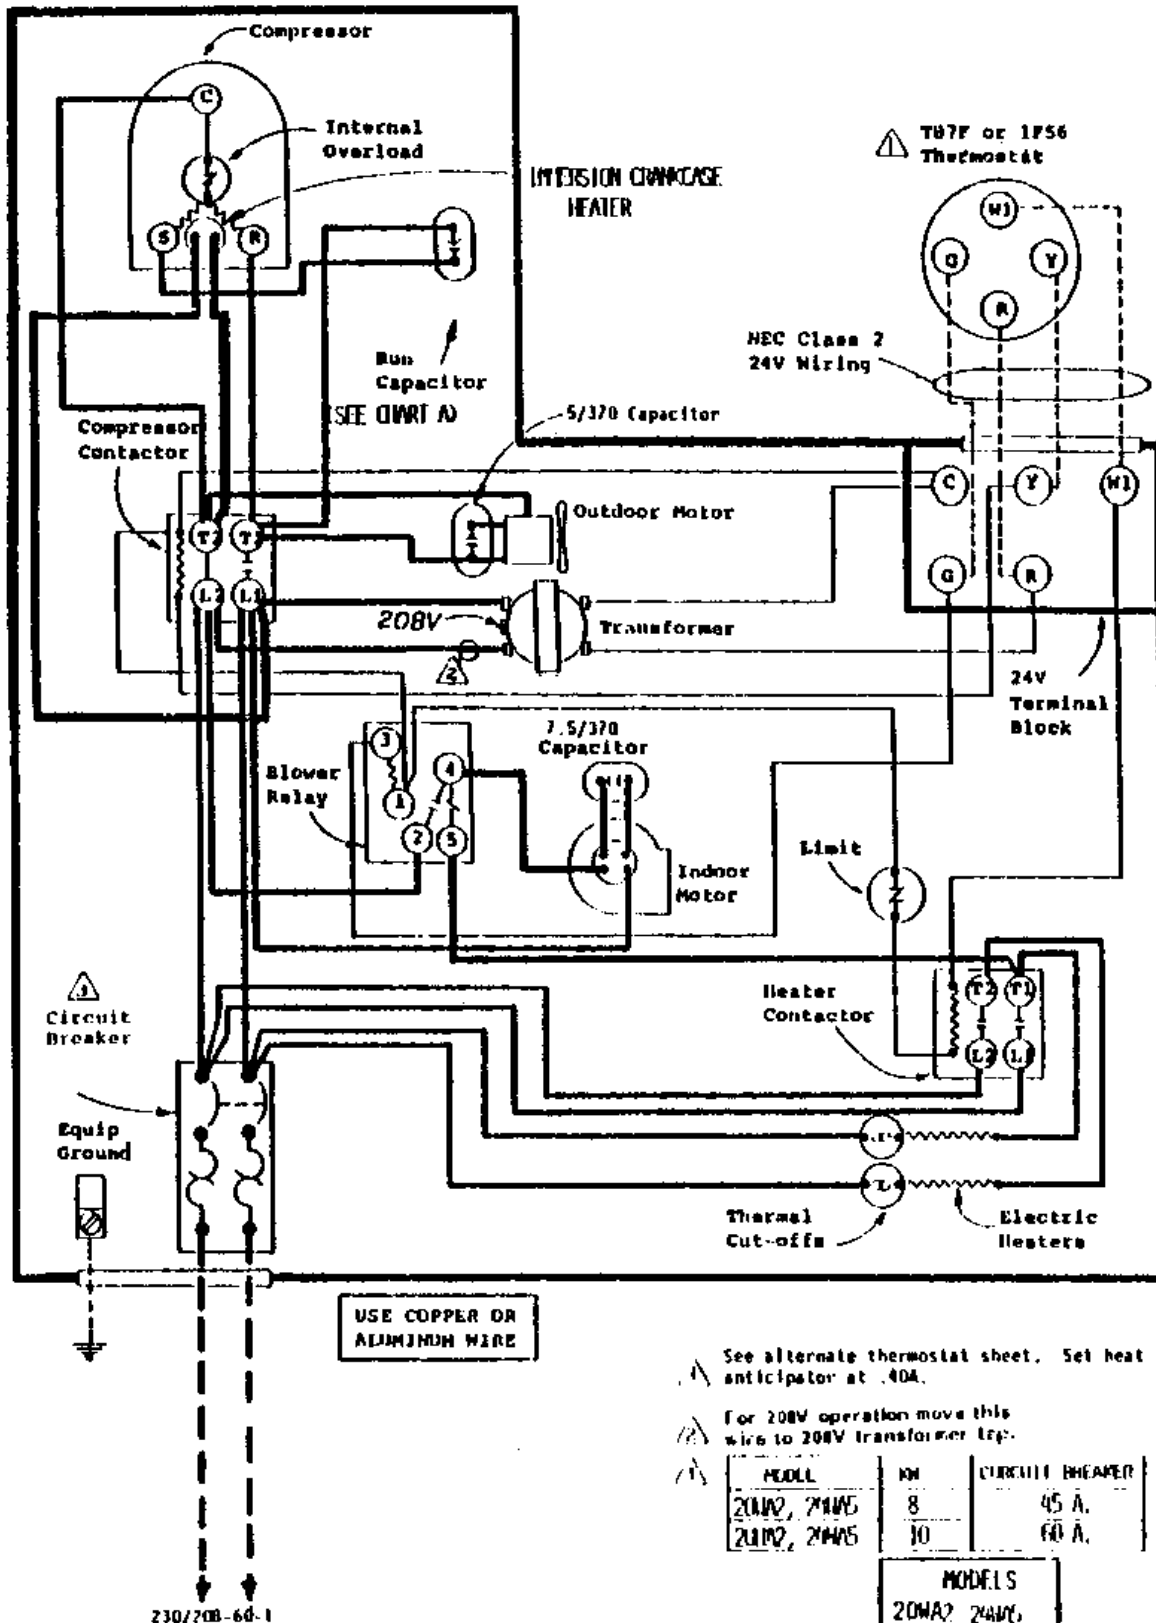

See alternate thermostat sheet. Set heat anticipator at .40A.

For 208V operation move this wire to 208V transformer tap.

MODEL	HP	CIRCUIT BREAKER
20MA2, 24MA5	8	45 A.
20MA2, 24MA5	10	60 A.

MODELS
20MA2, 24MA5
w/ R on 10KW

4007-131R