




⚠ For 208V operation move this wire to 208V transformer tap.

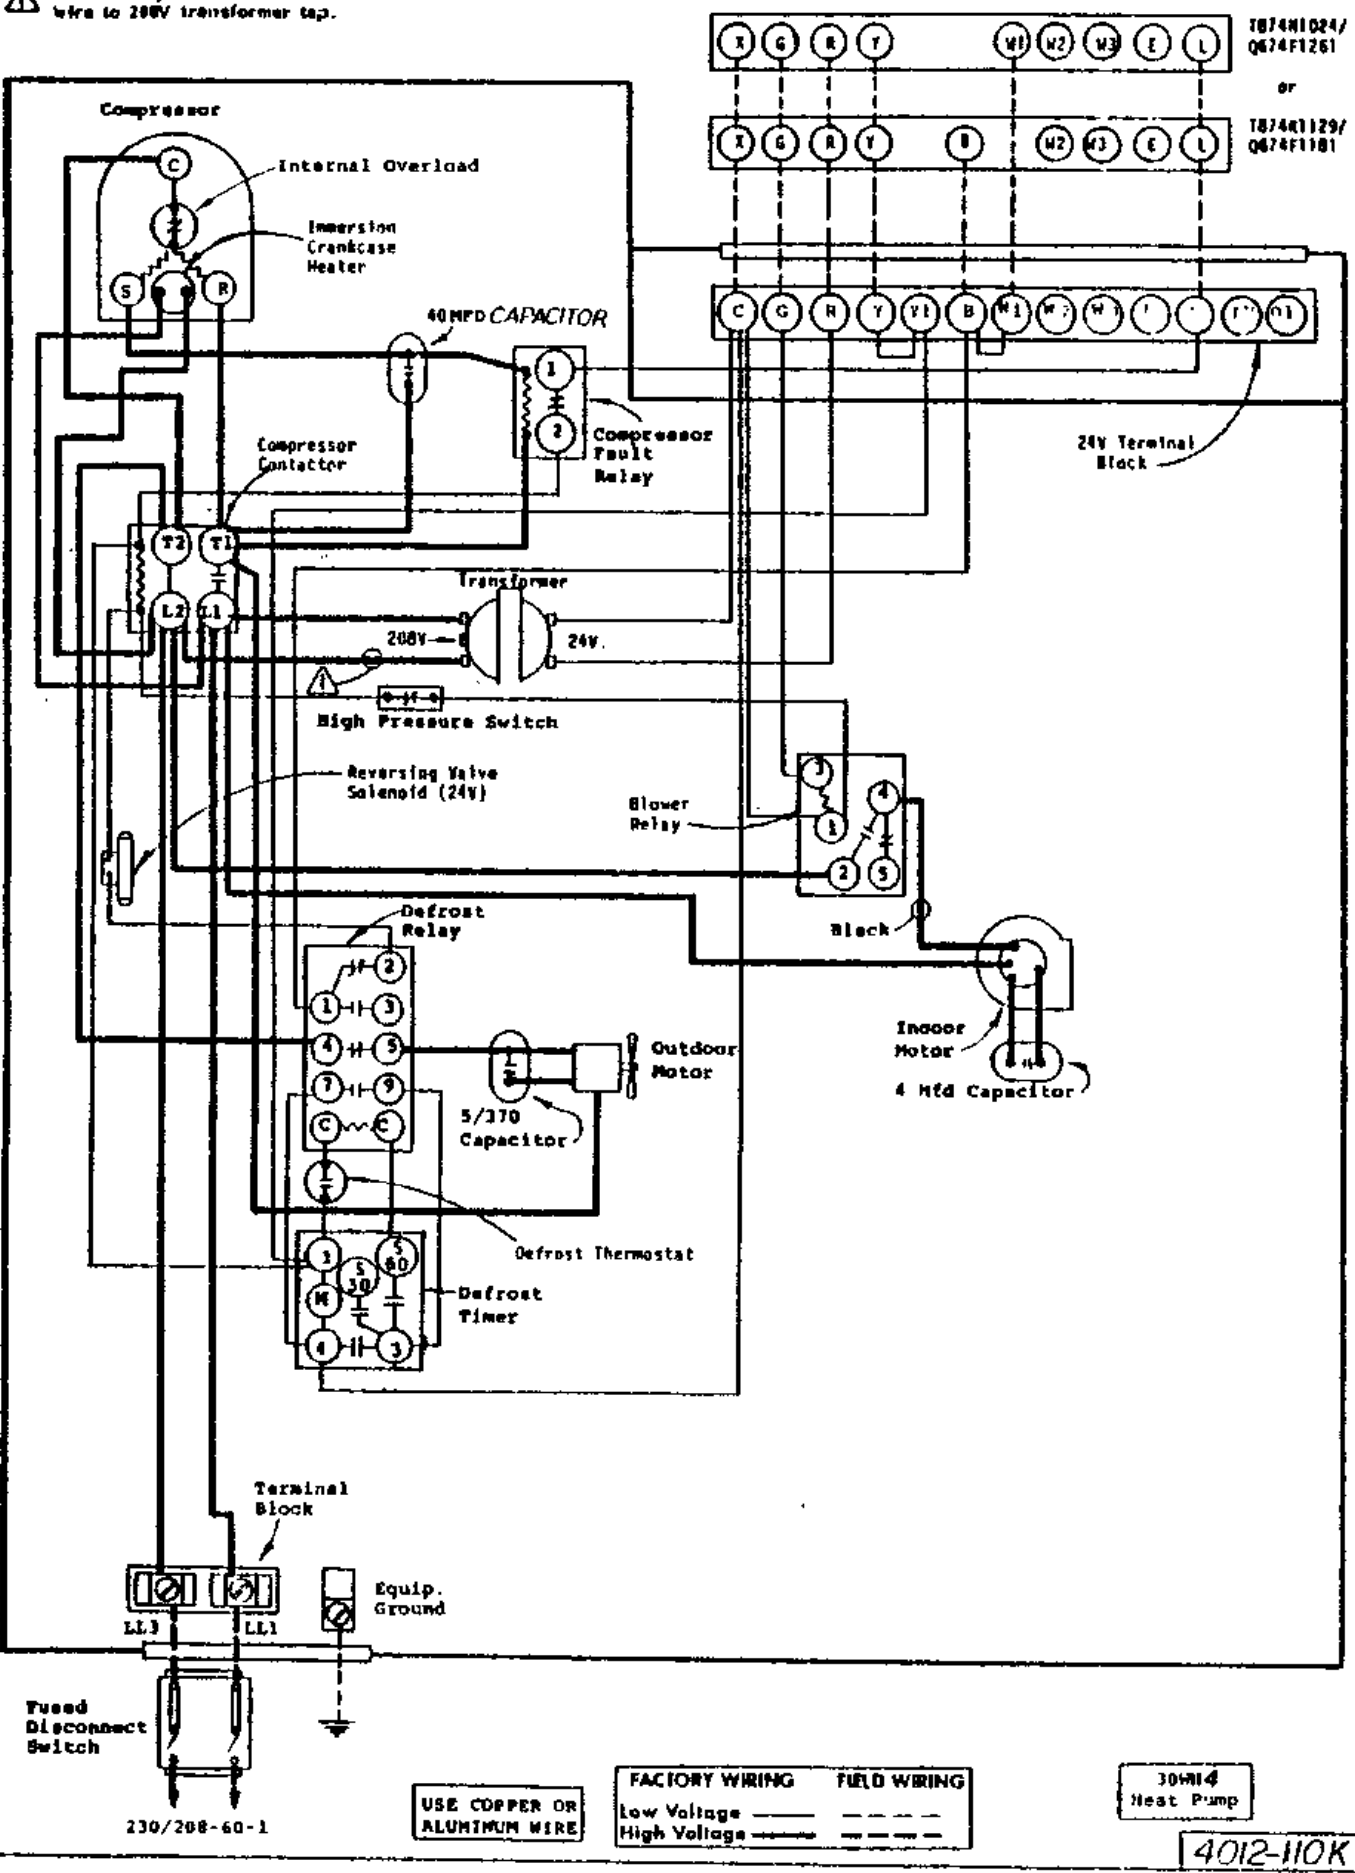


⚠ For 208V operation move this wire to 208V transformer tap.

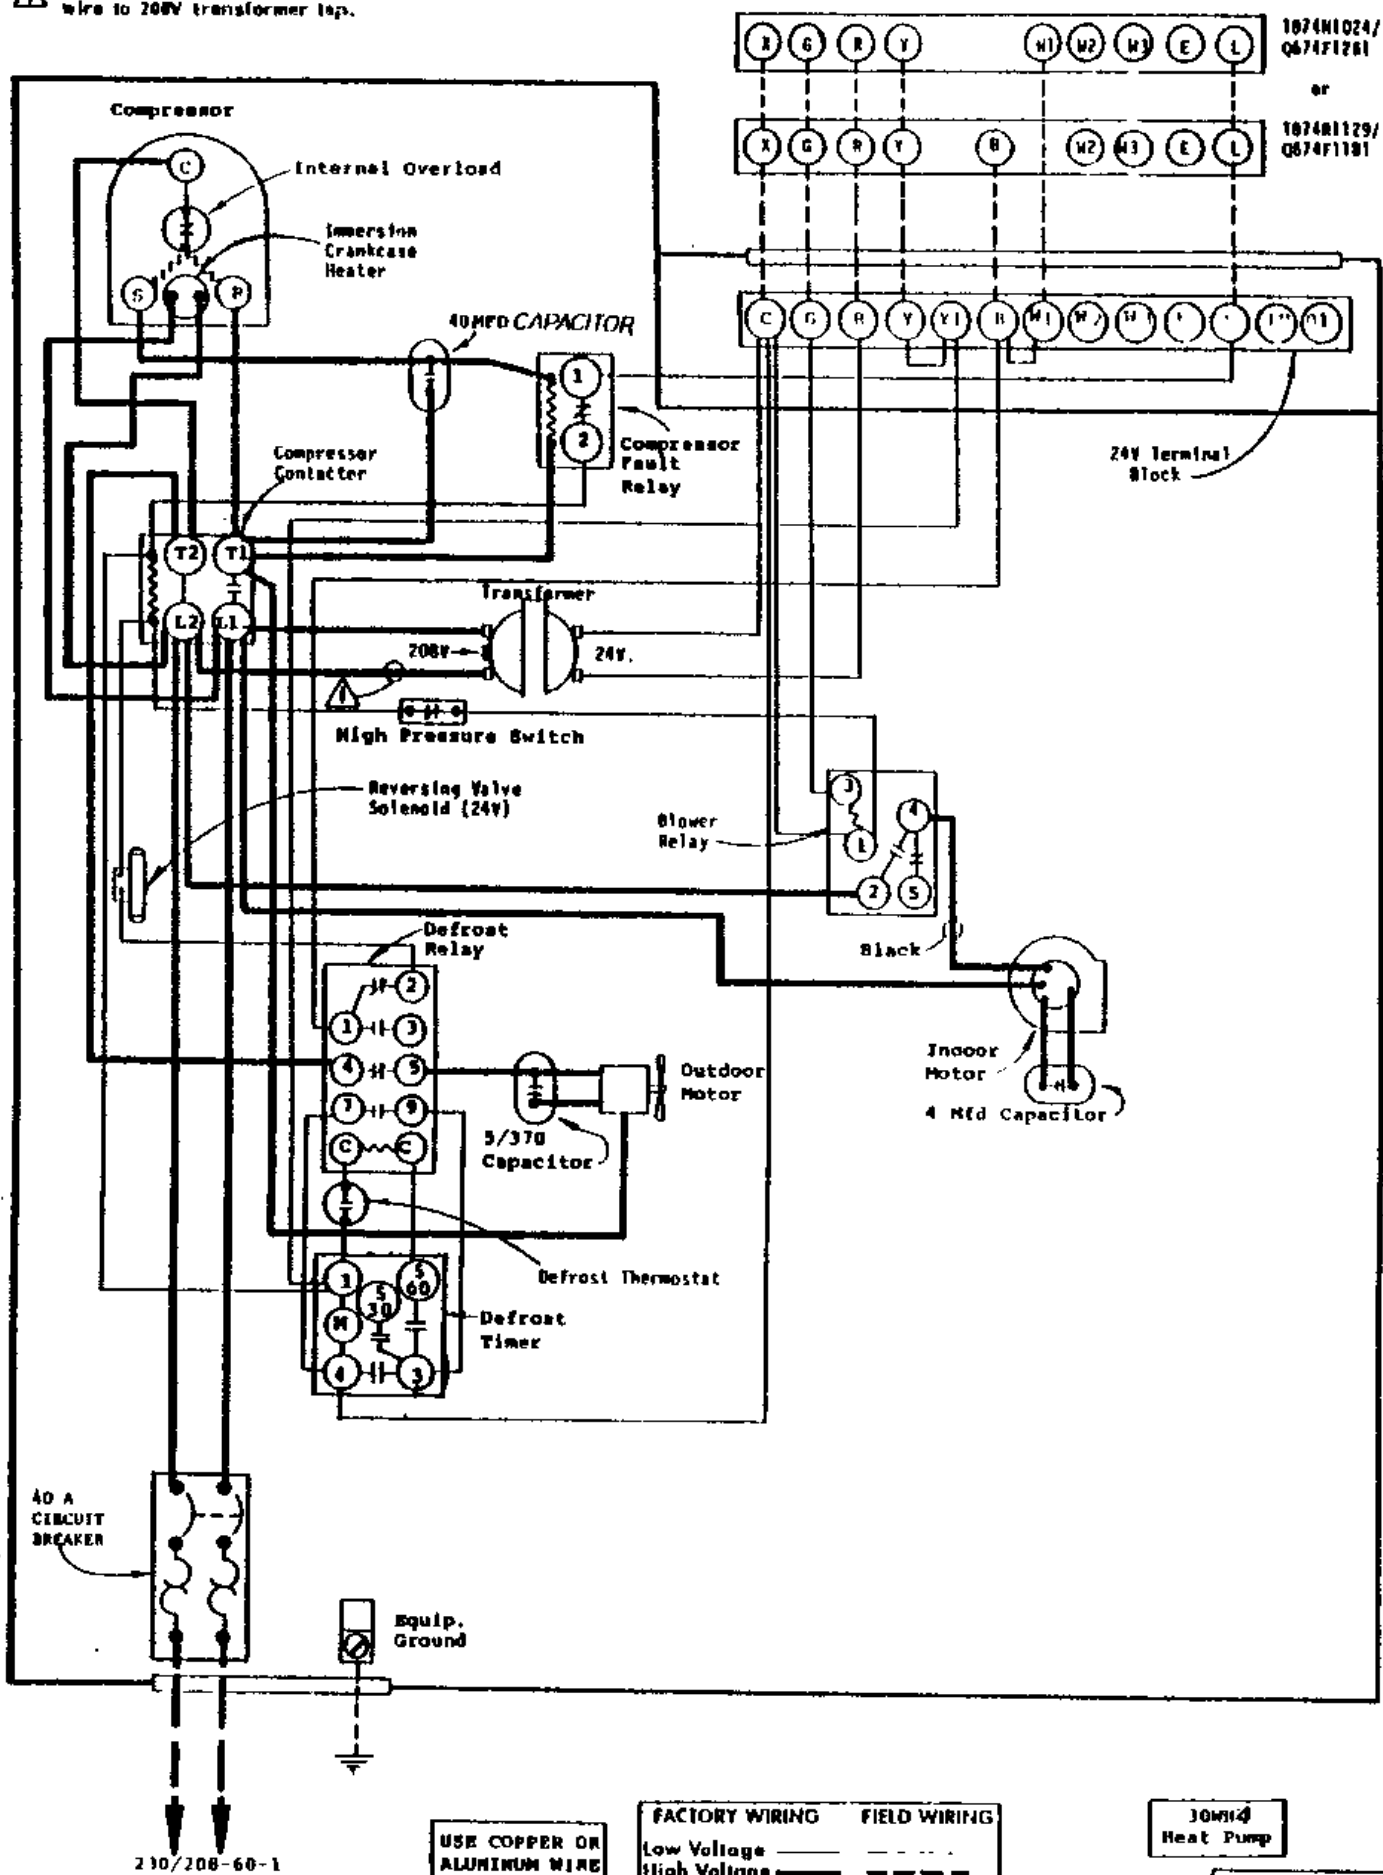

⚠ For 208V operation move this wire to 208V transformer tap.

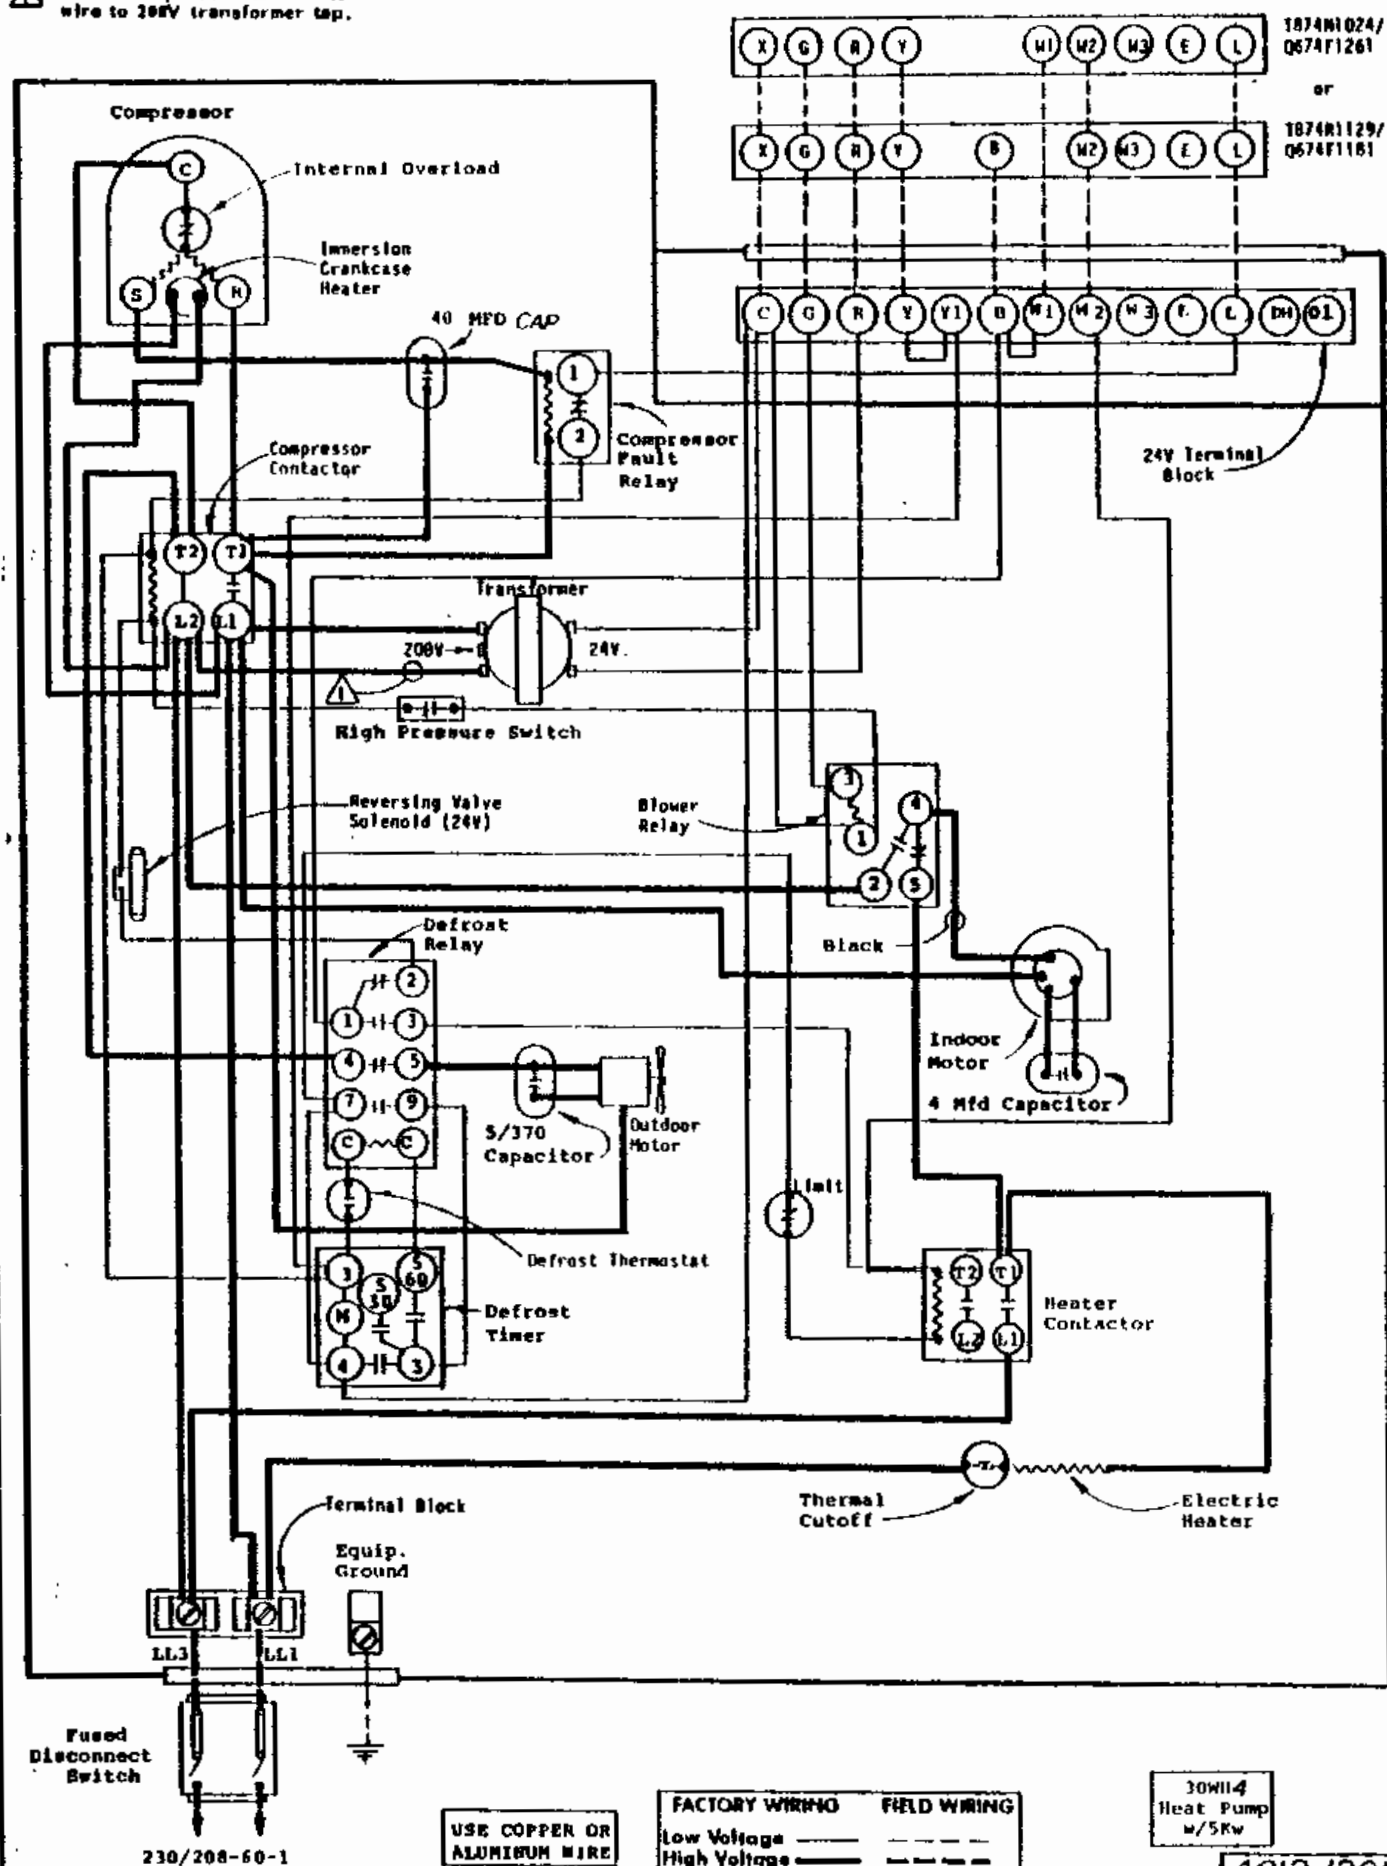

⚠ For 208V operation move this wire to 208V transformer tap.

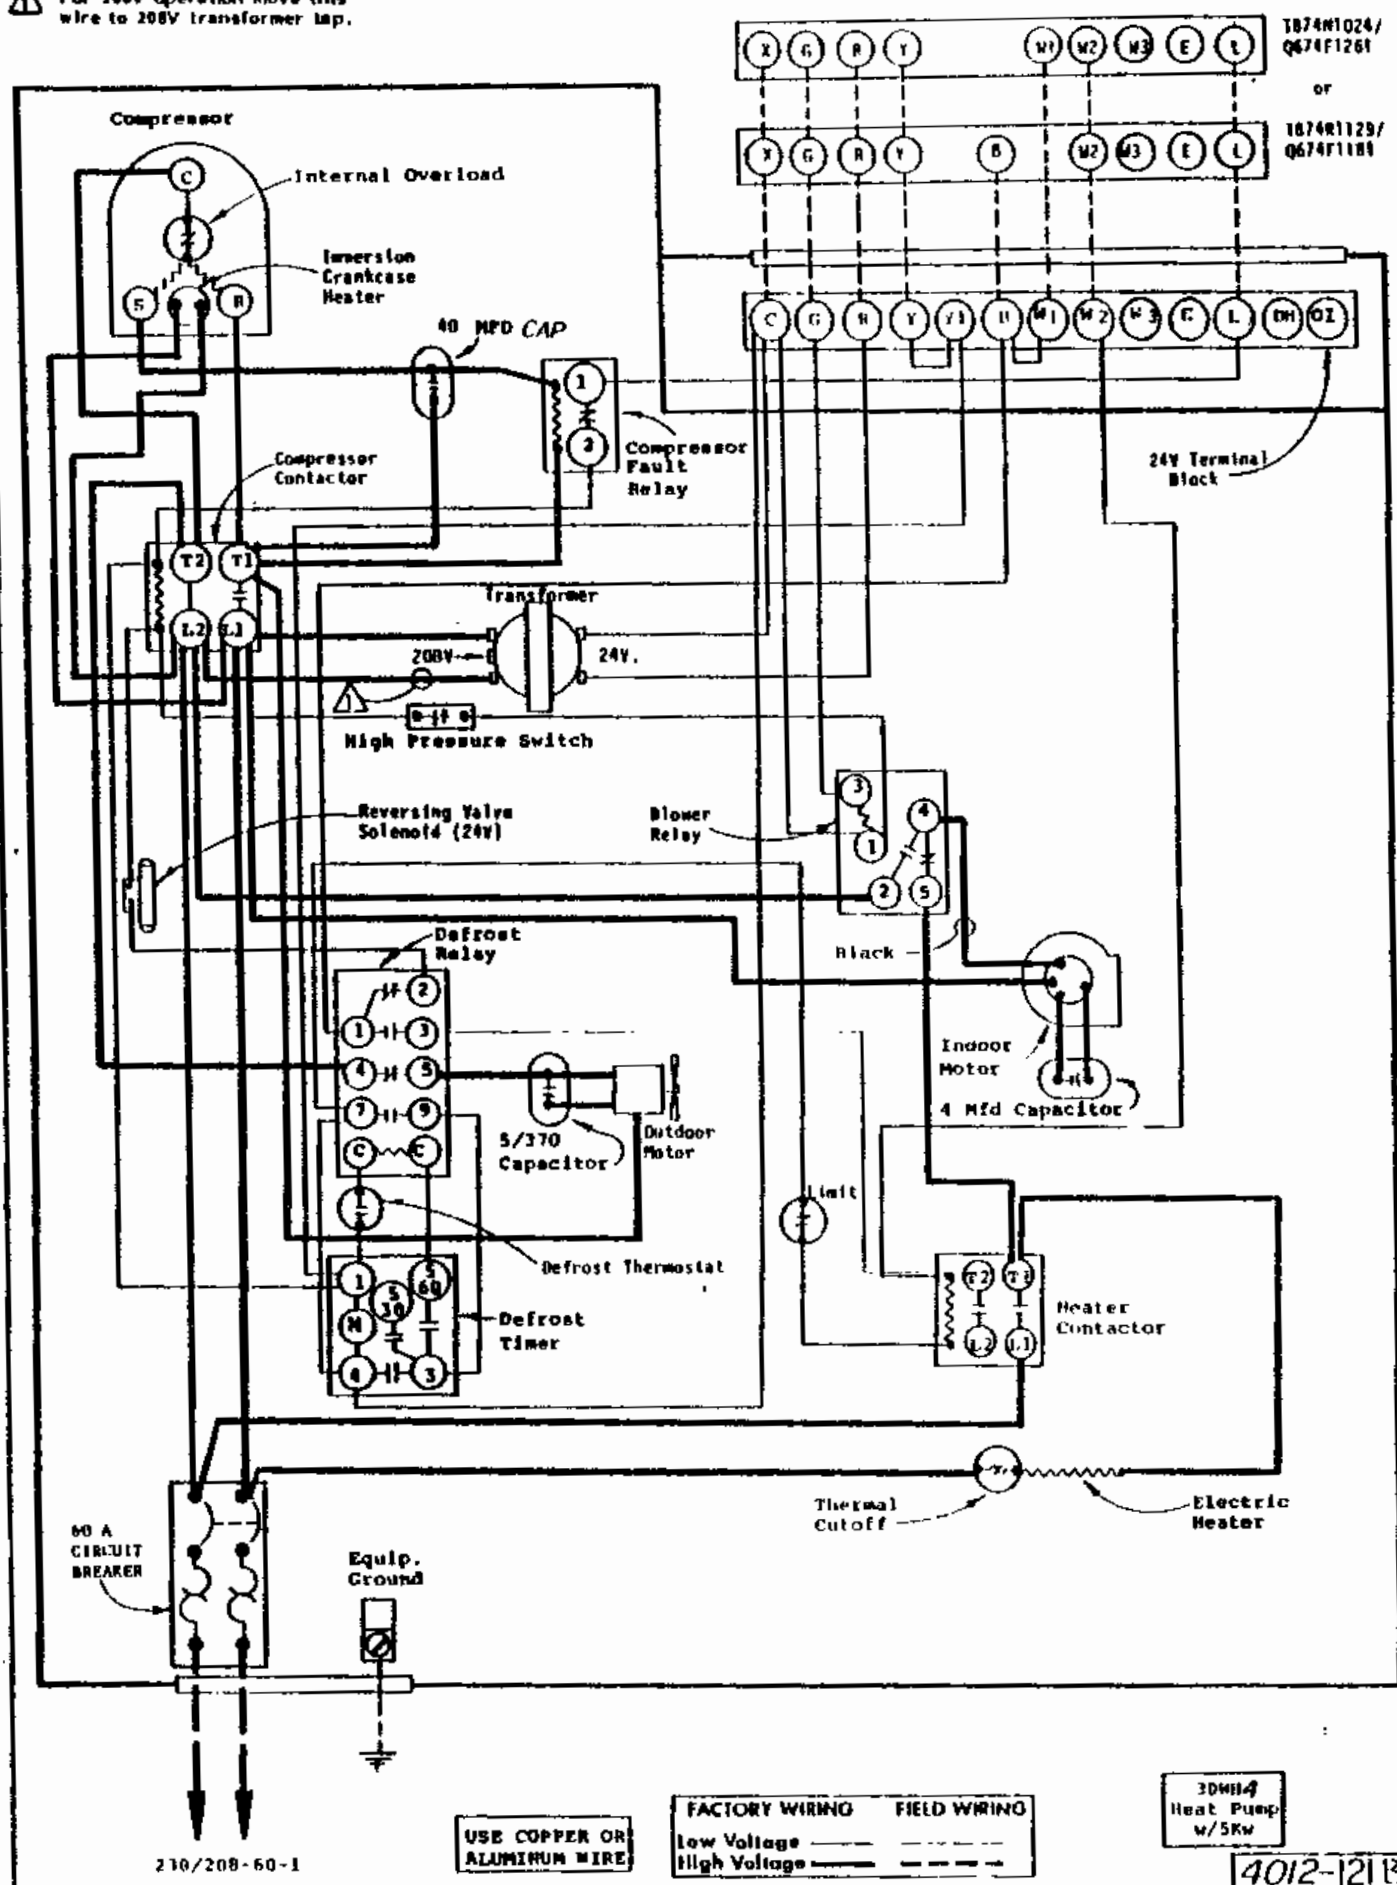

210/208-60-1


USE COPPER OR ALUMINUM WIRE

	FACTORY WIRING	FIELD WIRING
Low Voltage	_____	_____
High Voltage	_____	_____


3DWH4
Heat Pump
w/5Kw

4012-1213

⚠ For 208V operation move this wire to 208V transformer tap.

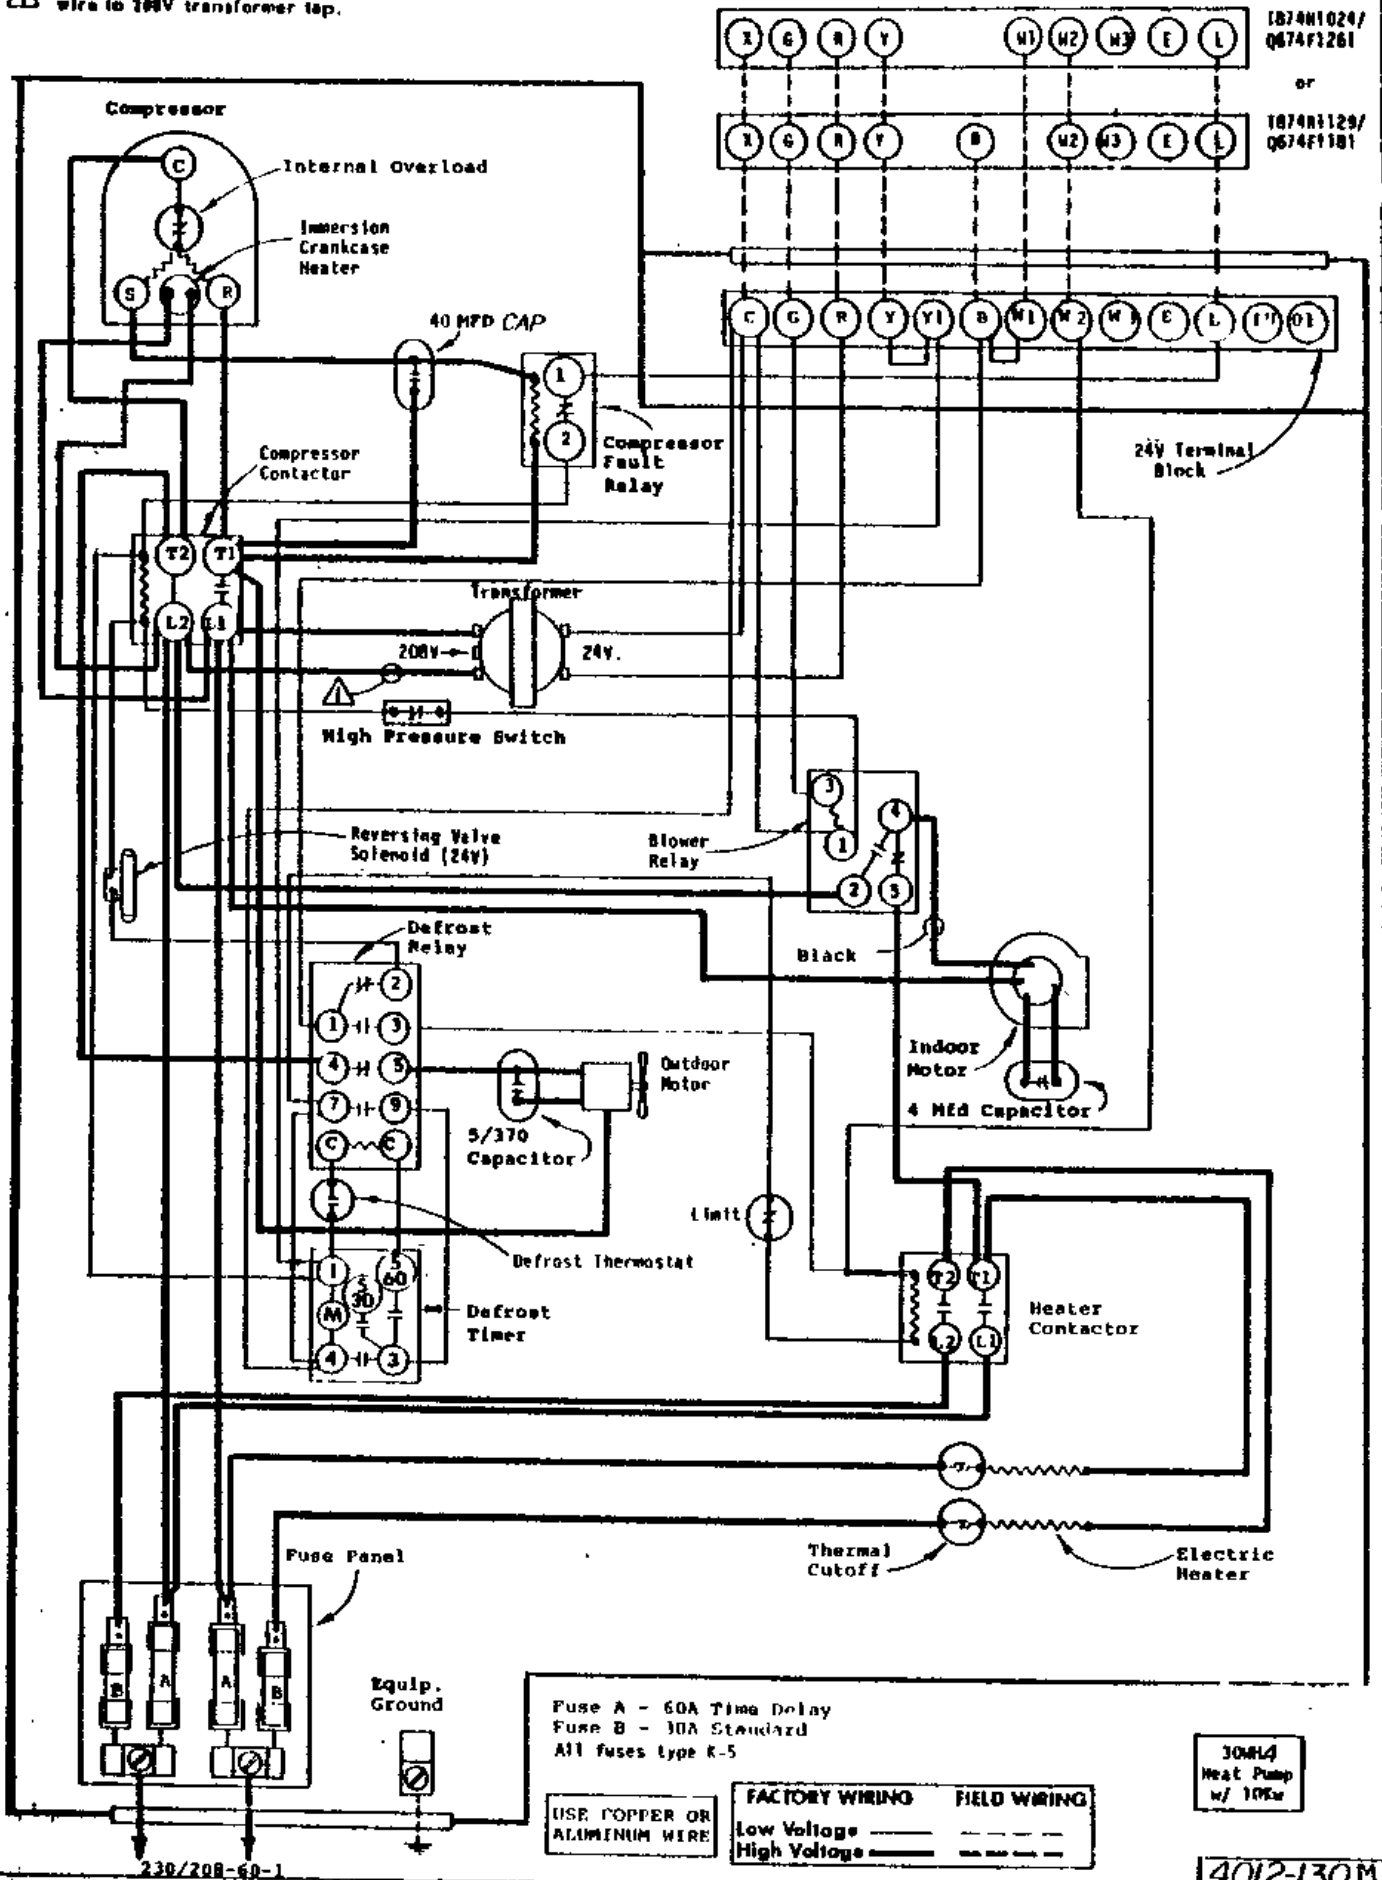


⚠ For 208V operation move this wire to 208V transformer tap.

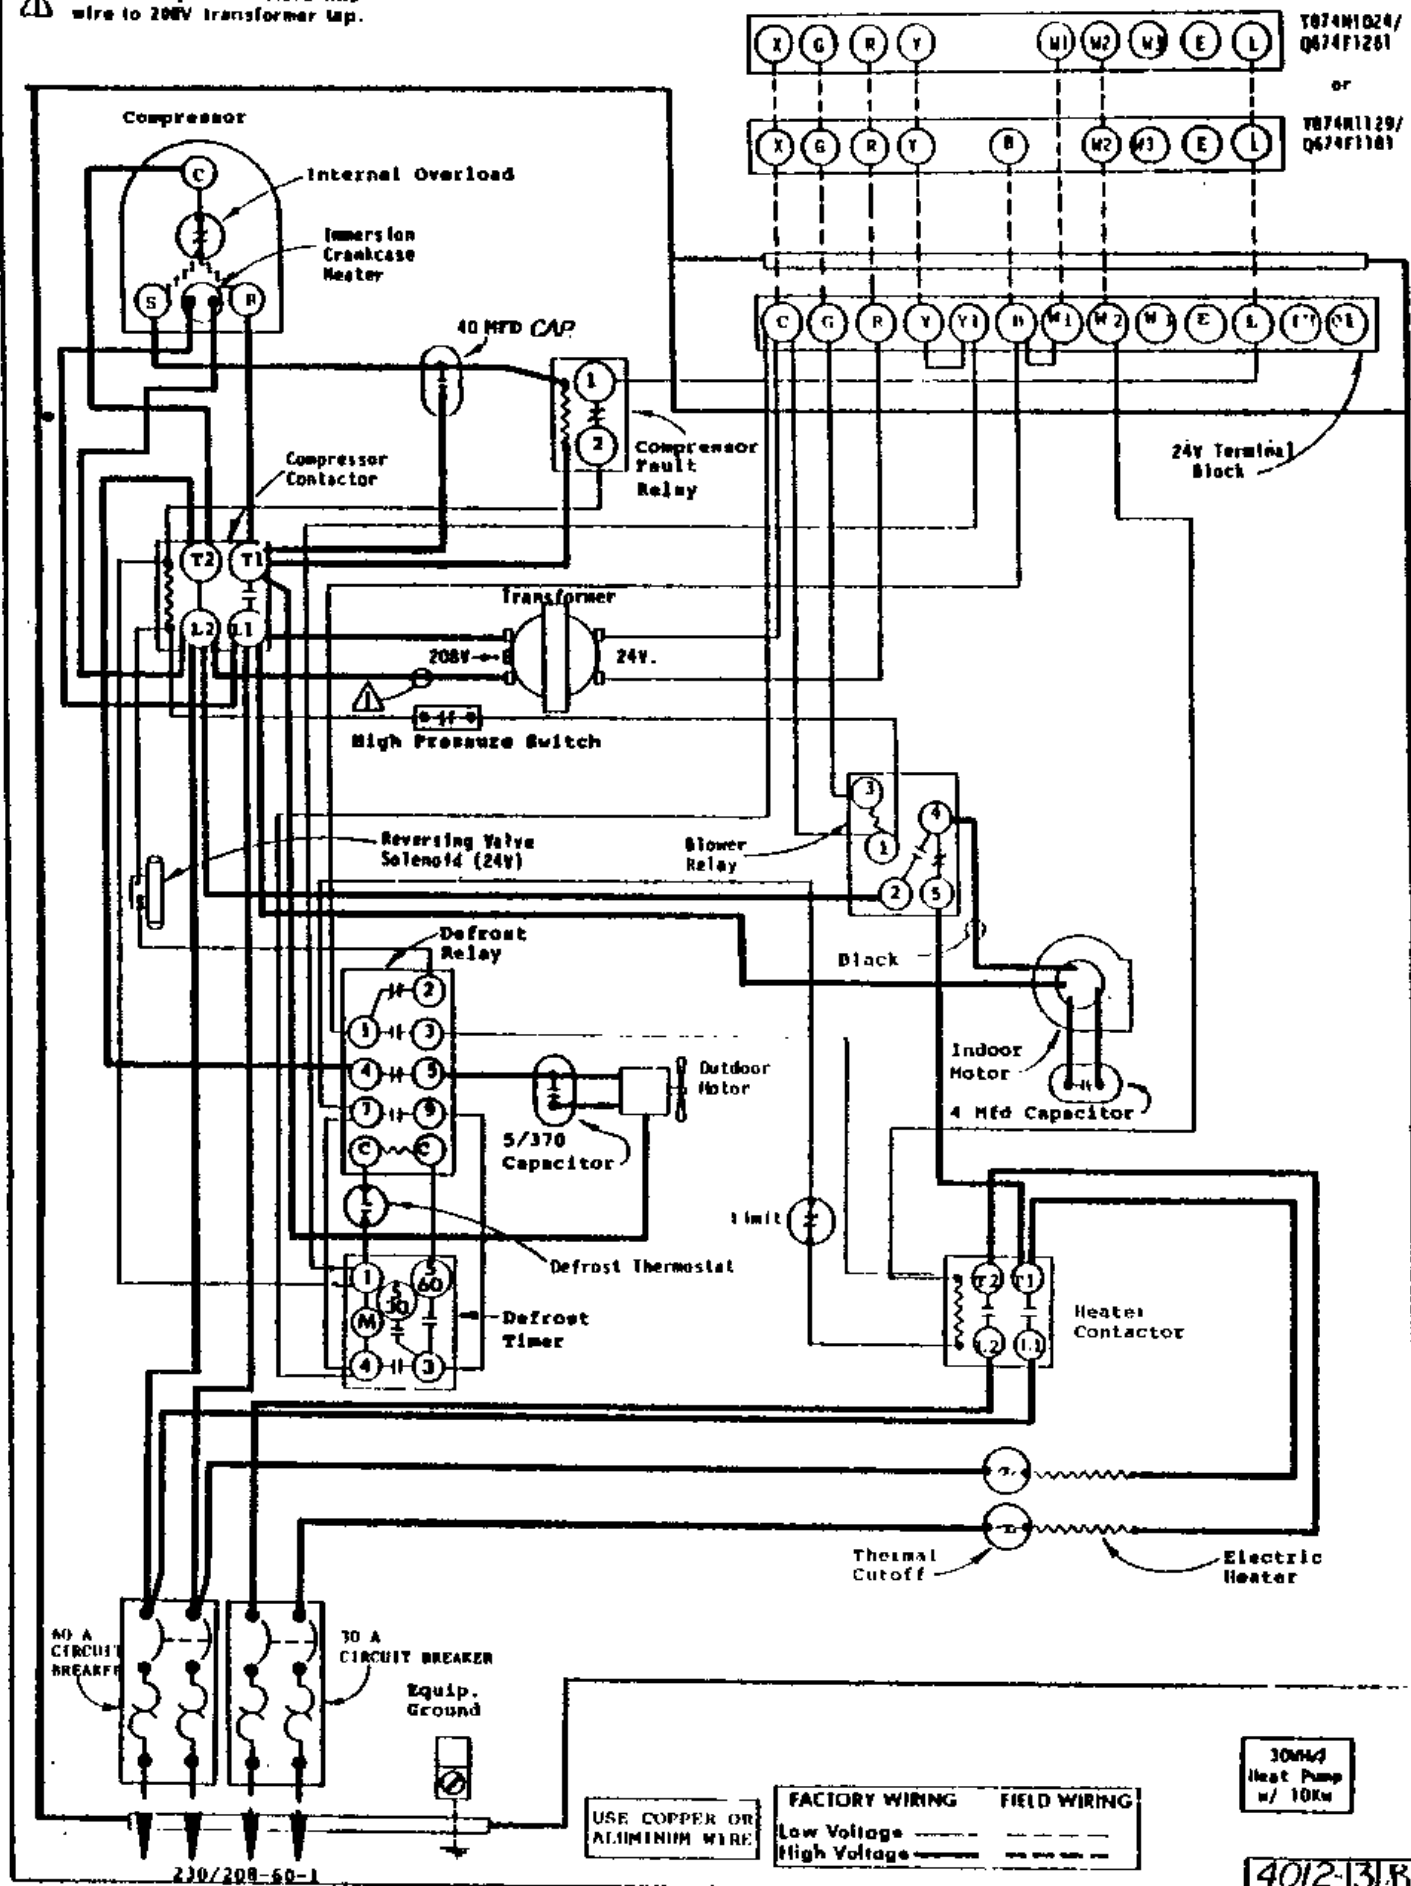

⚠ 2nd heat contactor operated only during emergency heat or compressor cutoff.

⚠ For 208V operation move this wire to 208V transformer tap.

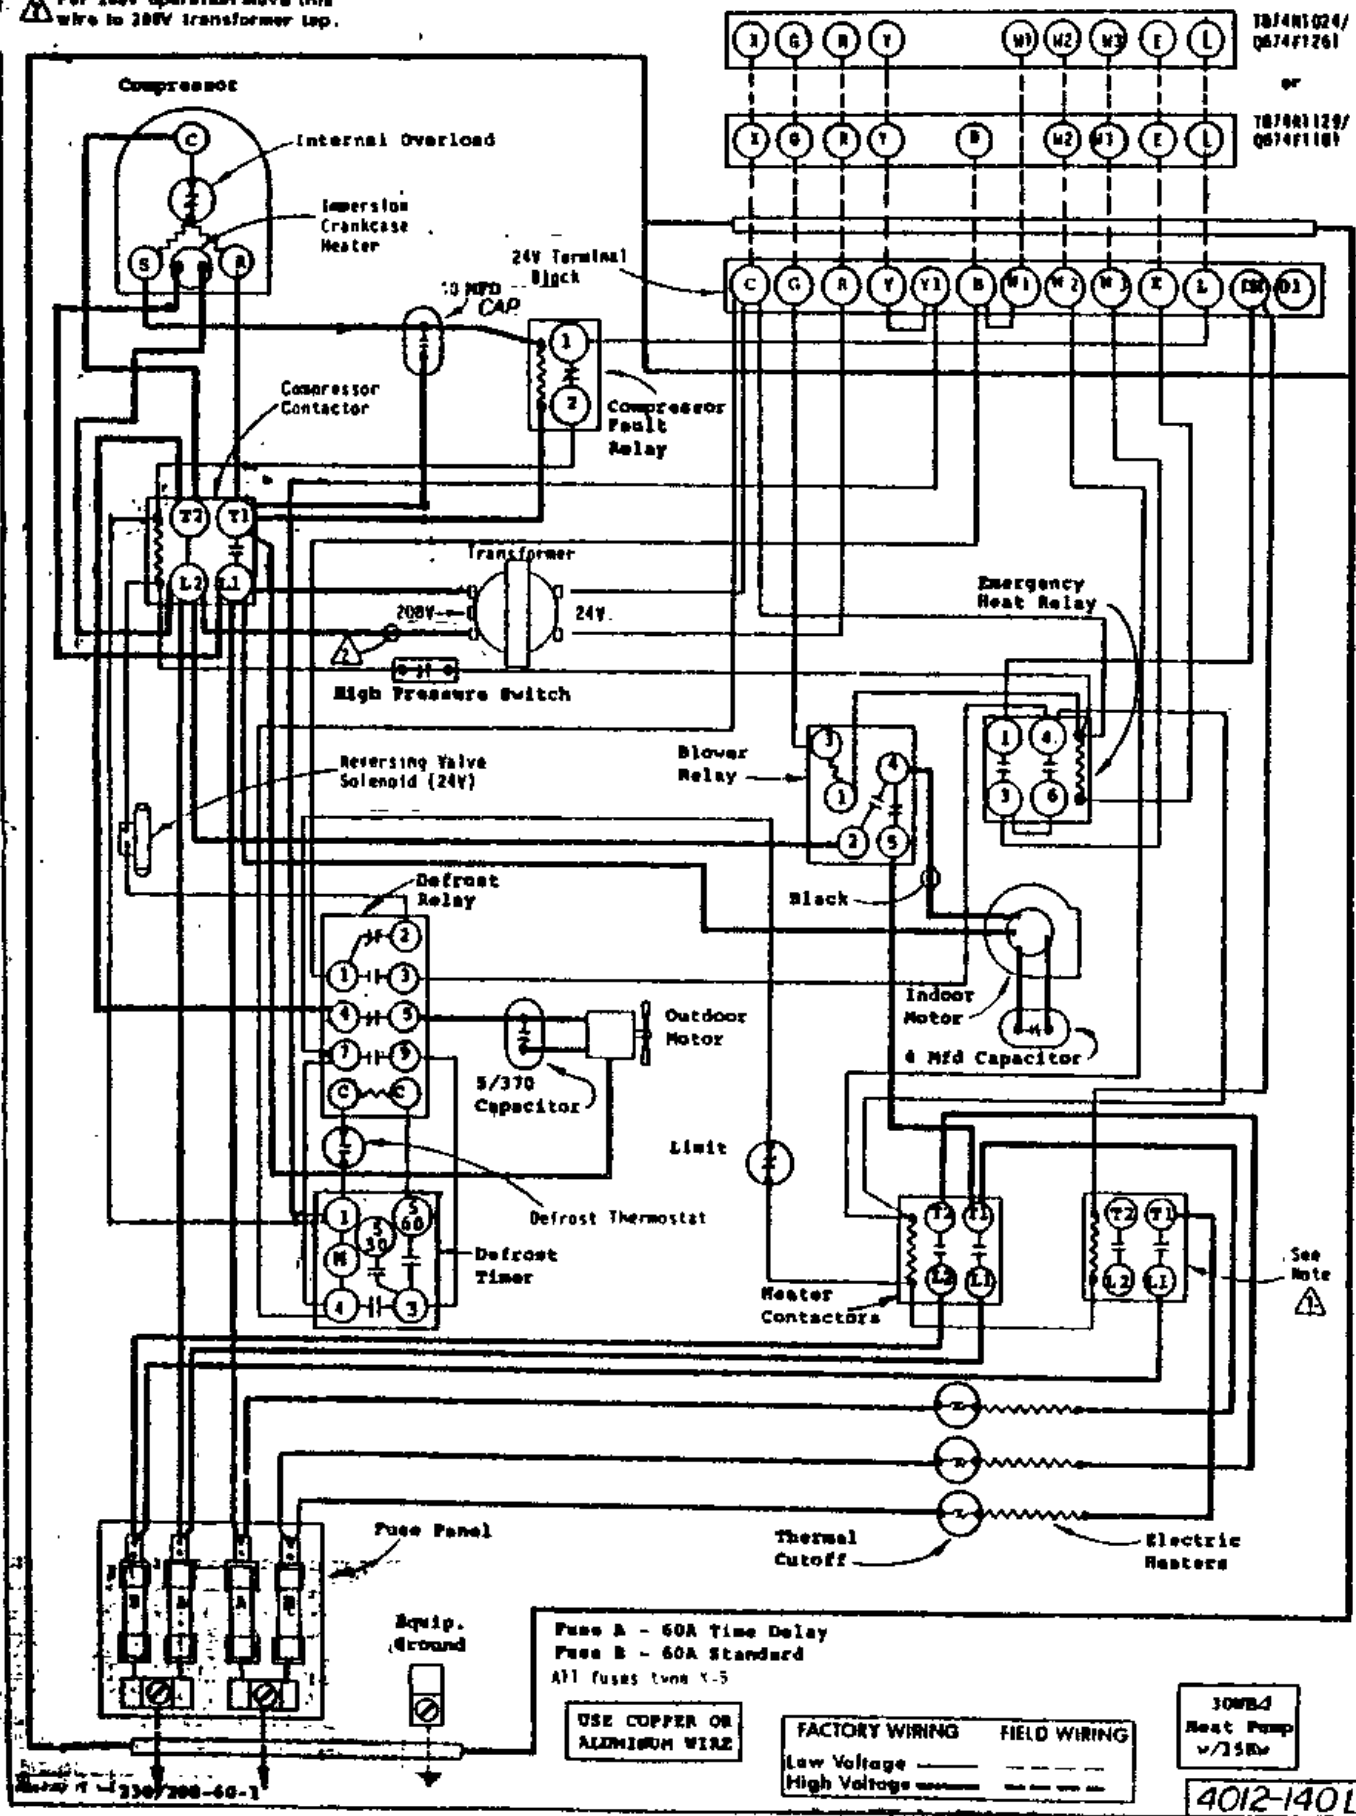

⚠ 2nd heat contactor operated only during emergency heat or compressor cutoff.

⚠ For 208V operation move this wire to 208V transformer tap.

