


Model  
mWA 2

Factory Wiring ———  
Field Wiring - - - - -

4n09-210

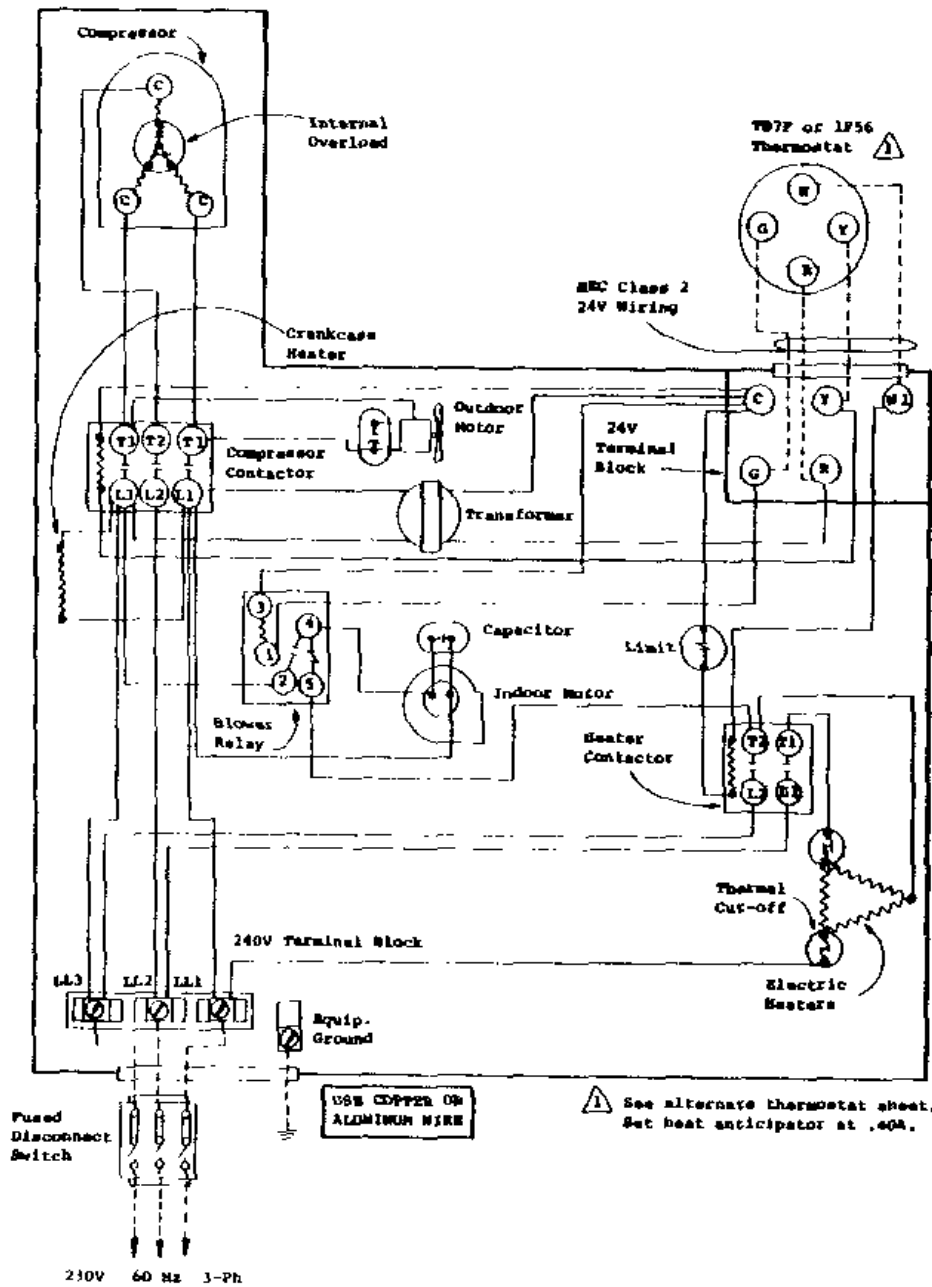


⚠ See alternate thermostat sheet.  
Set heat anticipator at .40A.

Model  
36WA2  
w/6 or 9kw

Factory Wiring ———  
Field Wiring - - - - -

4009-220

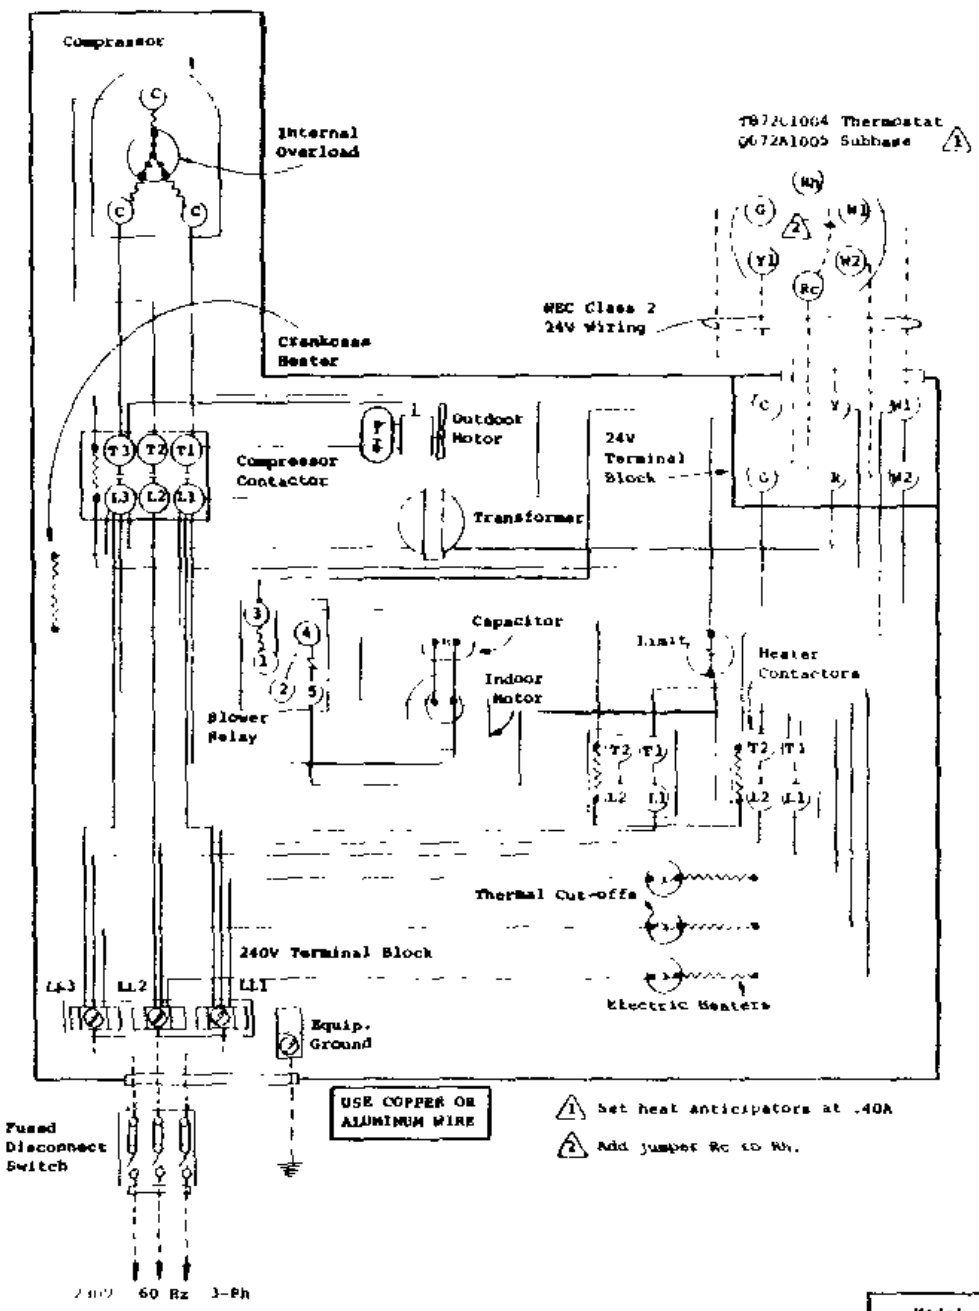

Model  
16WA7  
w/12 or 15kw

Factory Wiring ———  
Field Wiring - - - - -

4009-230