




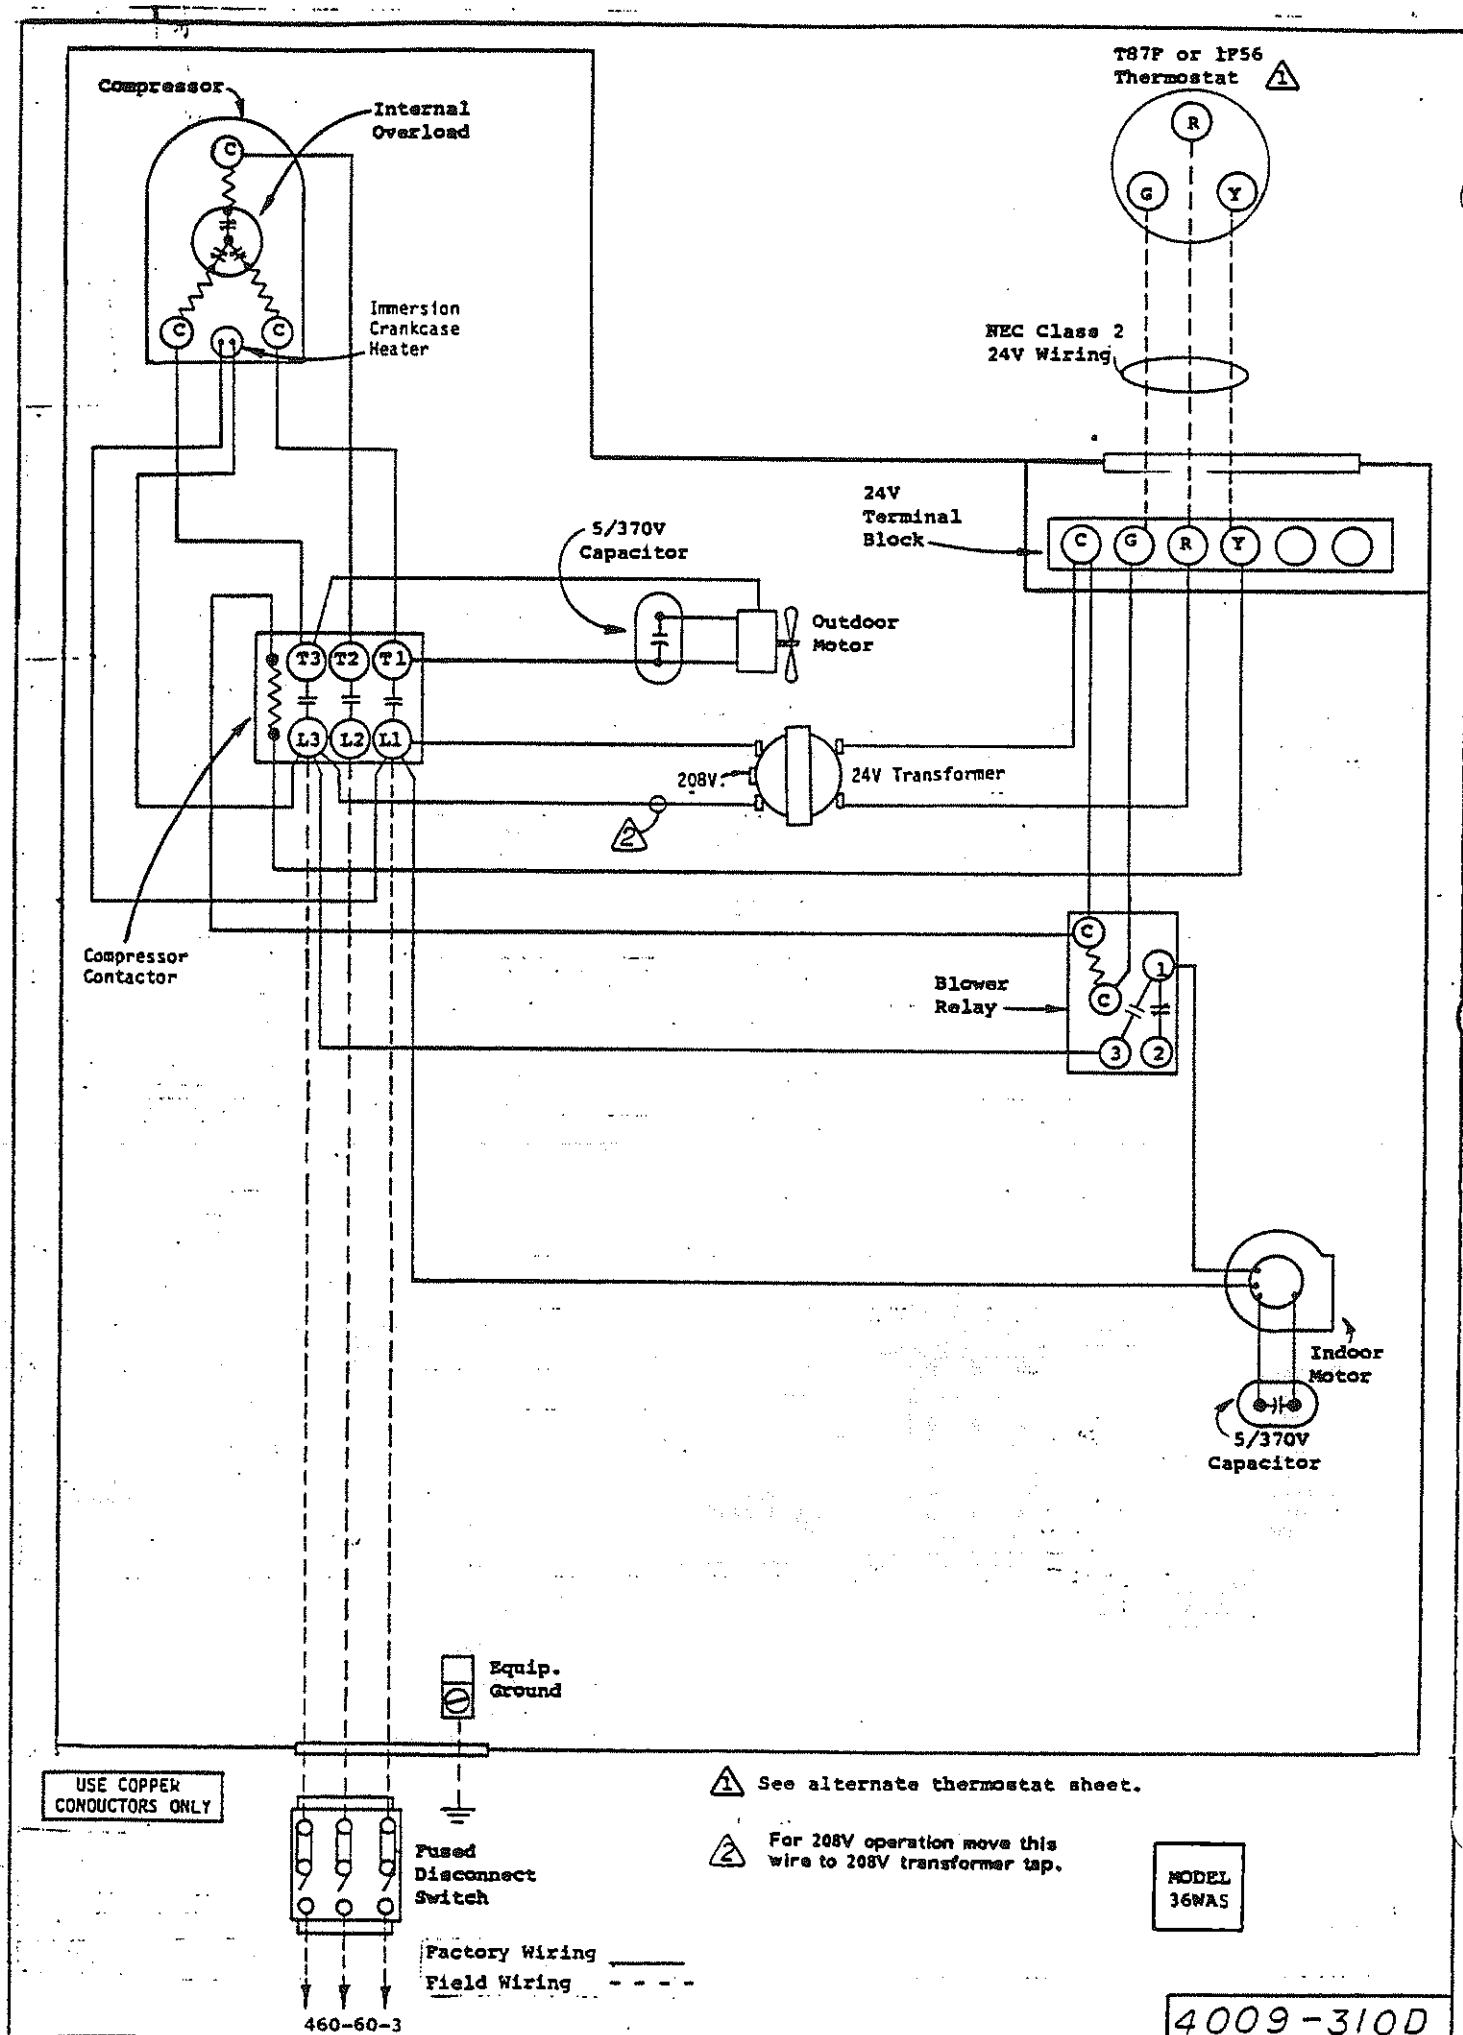

⚠ See alternate thermostat sheet.

⚠ For 208V operation move this wire to 208V transformer tap.

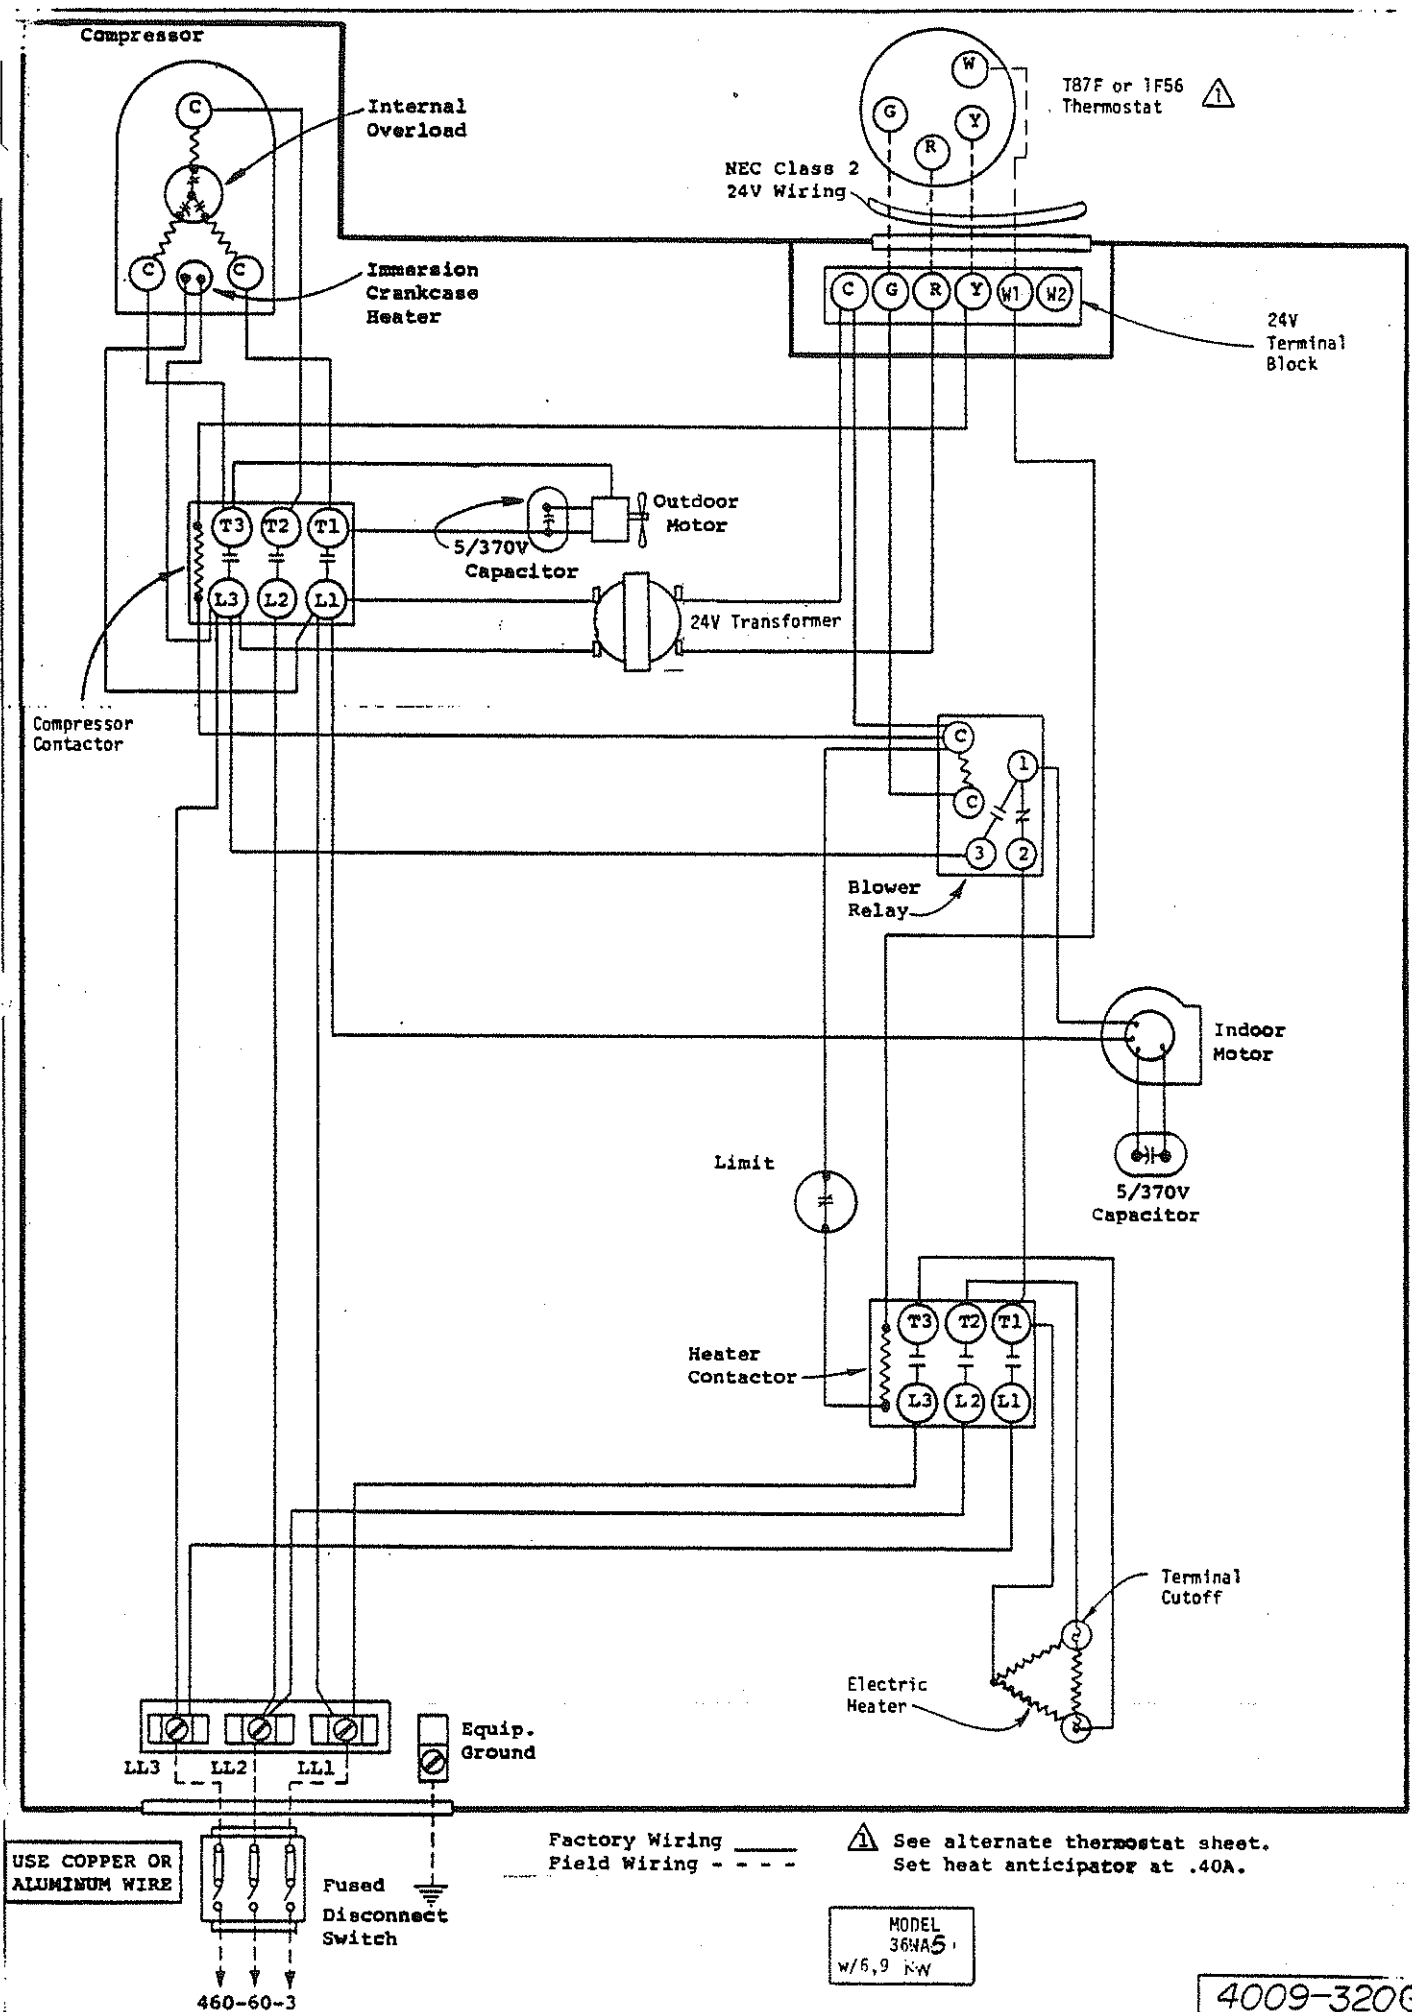

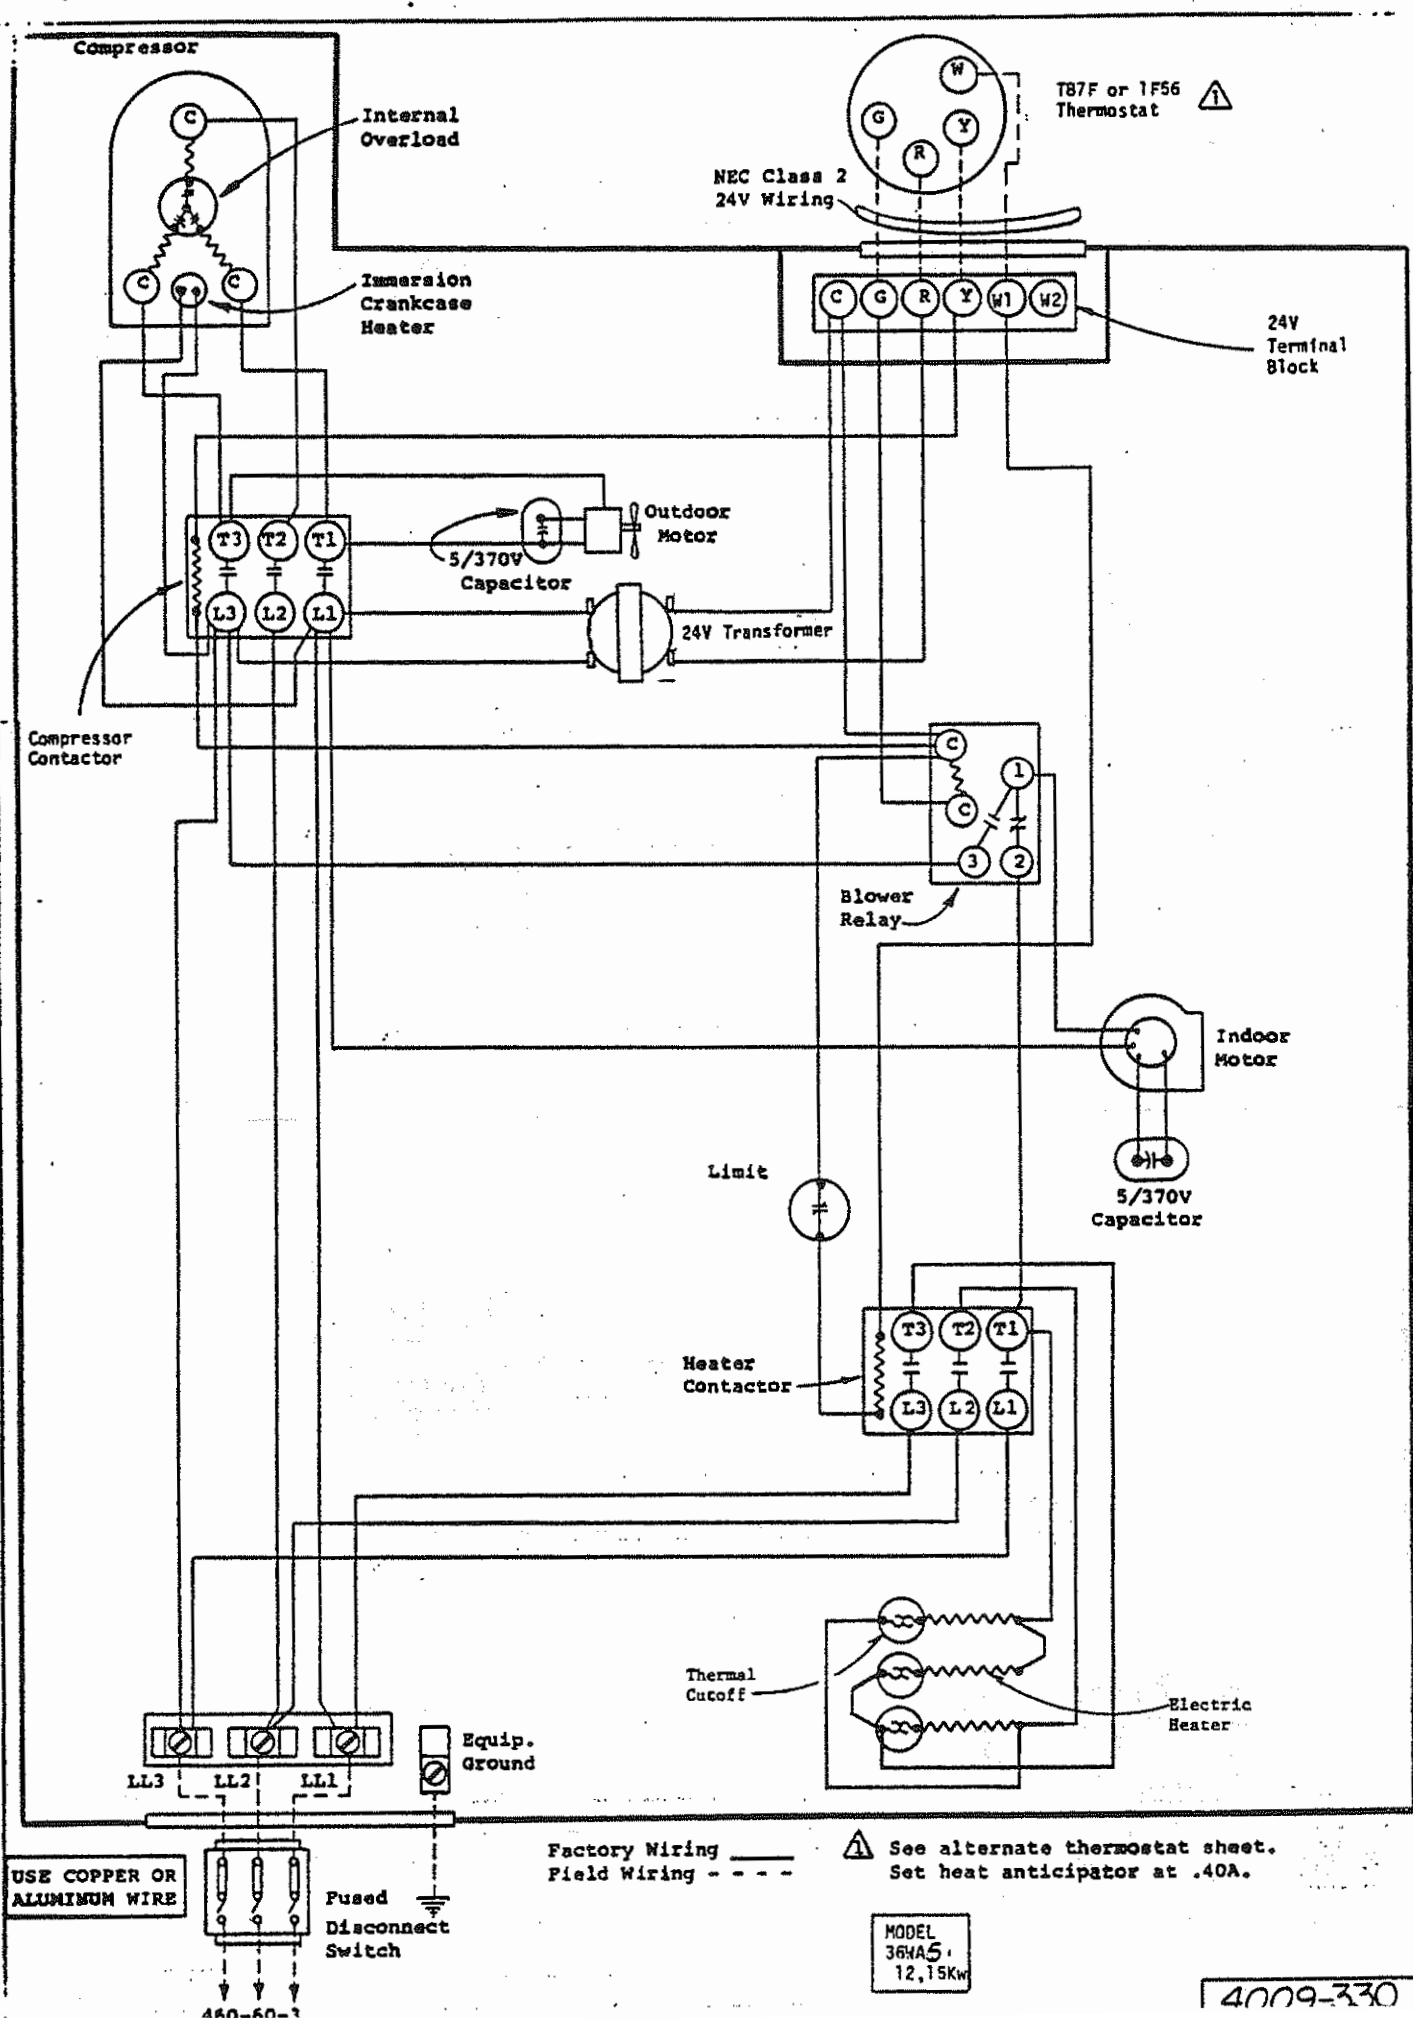

Factory Wiring ——— See alternate thermostat sheet.
Field Wiring - - - Set heat anticipator at .40A.

MODEL
36HA5
12,15KW

4009-330