





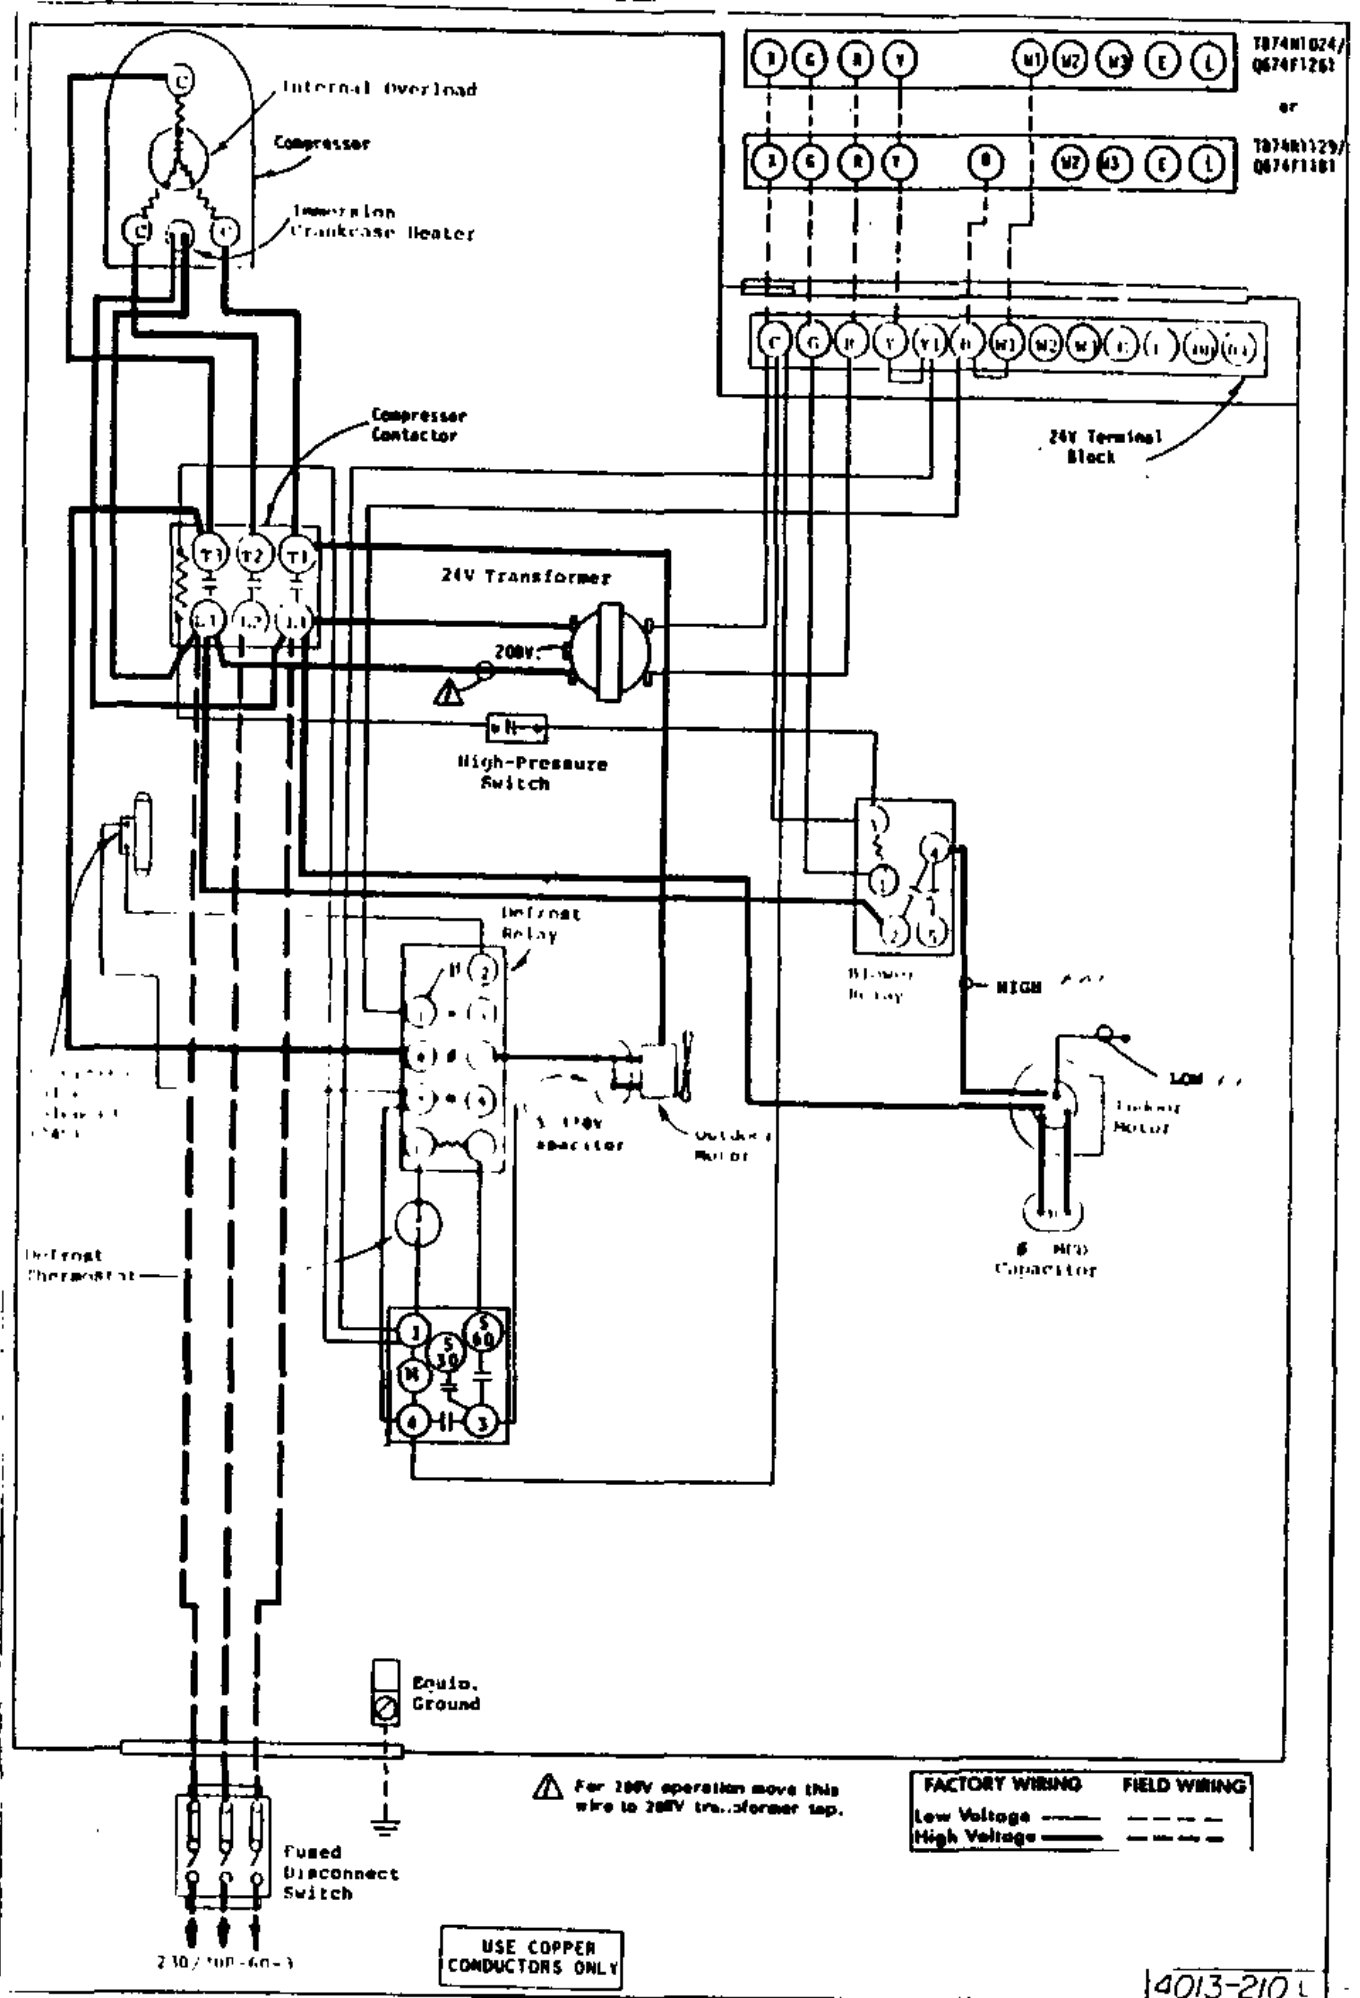

4013-210

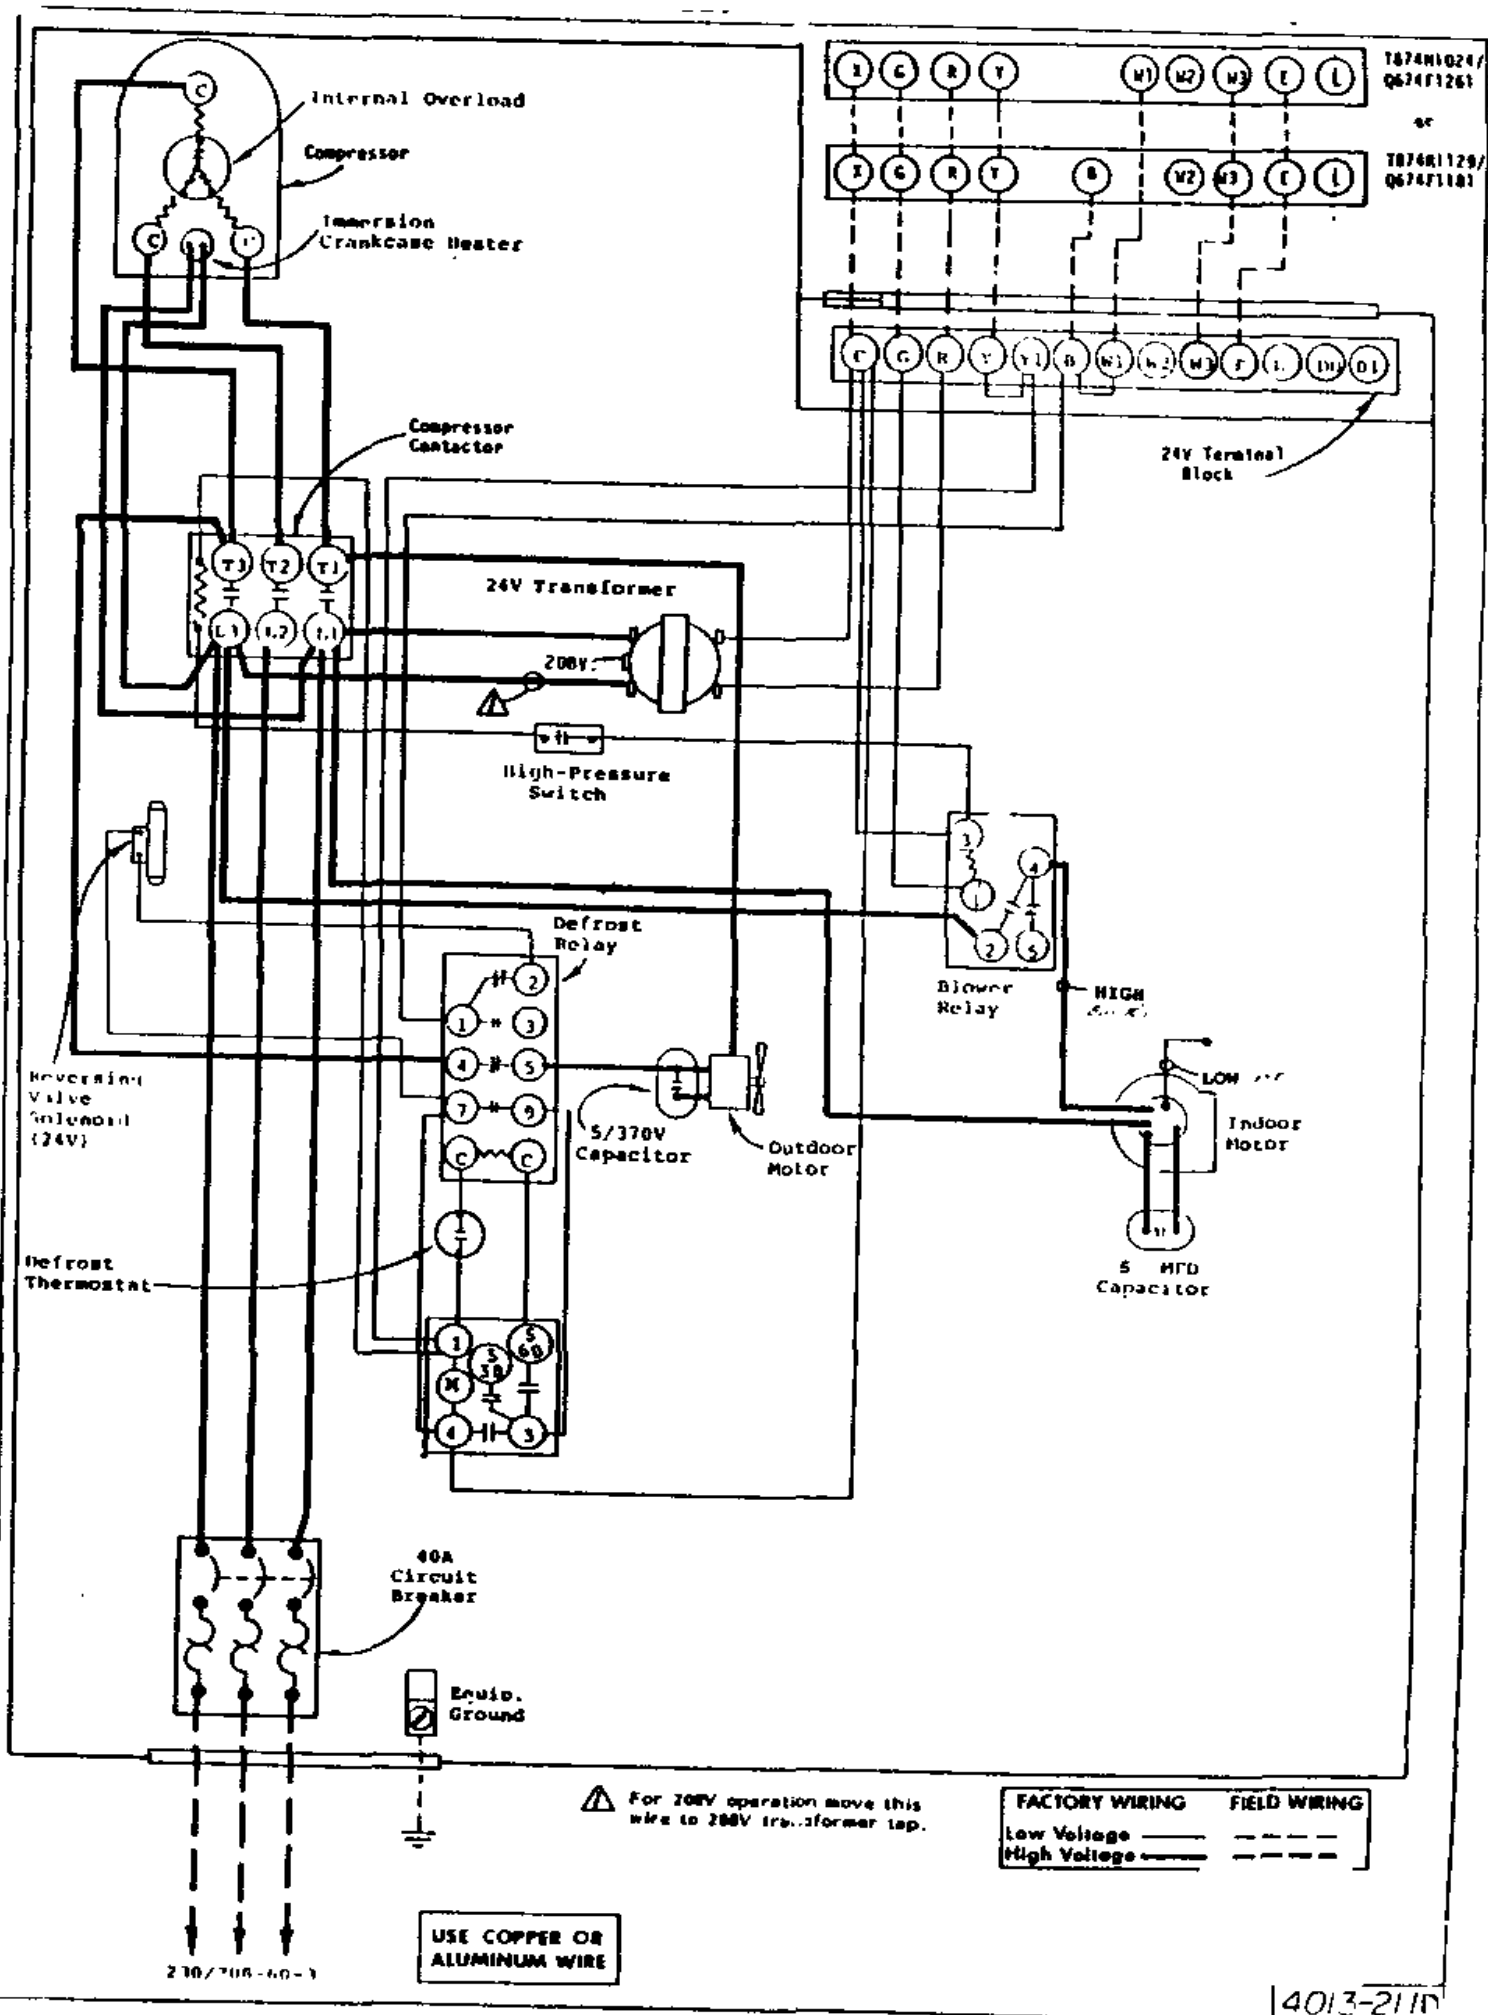

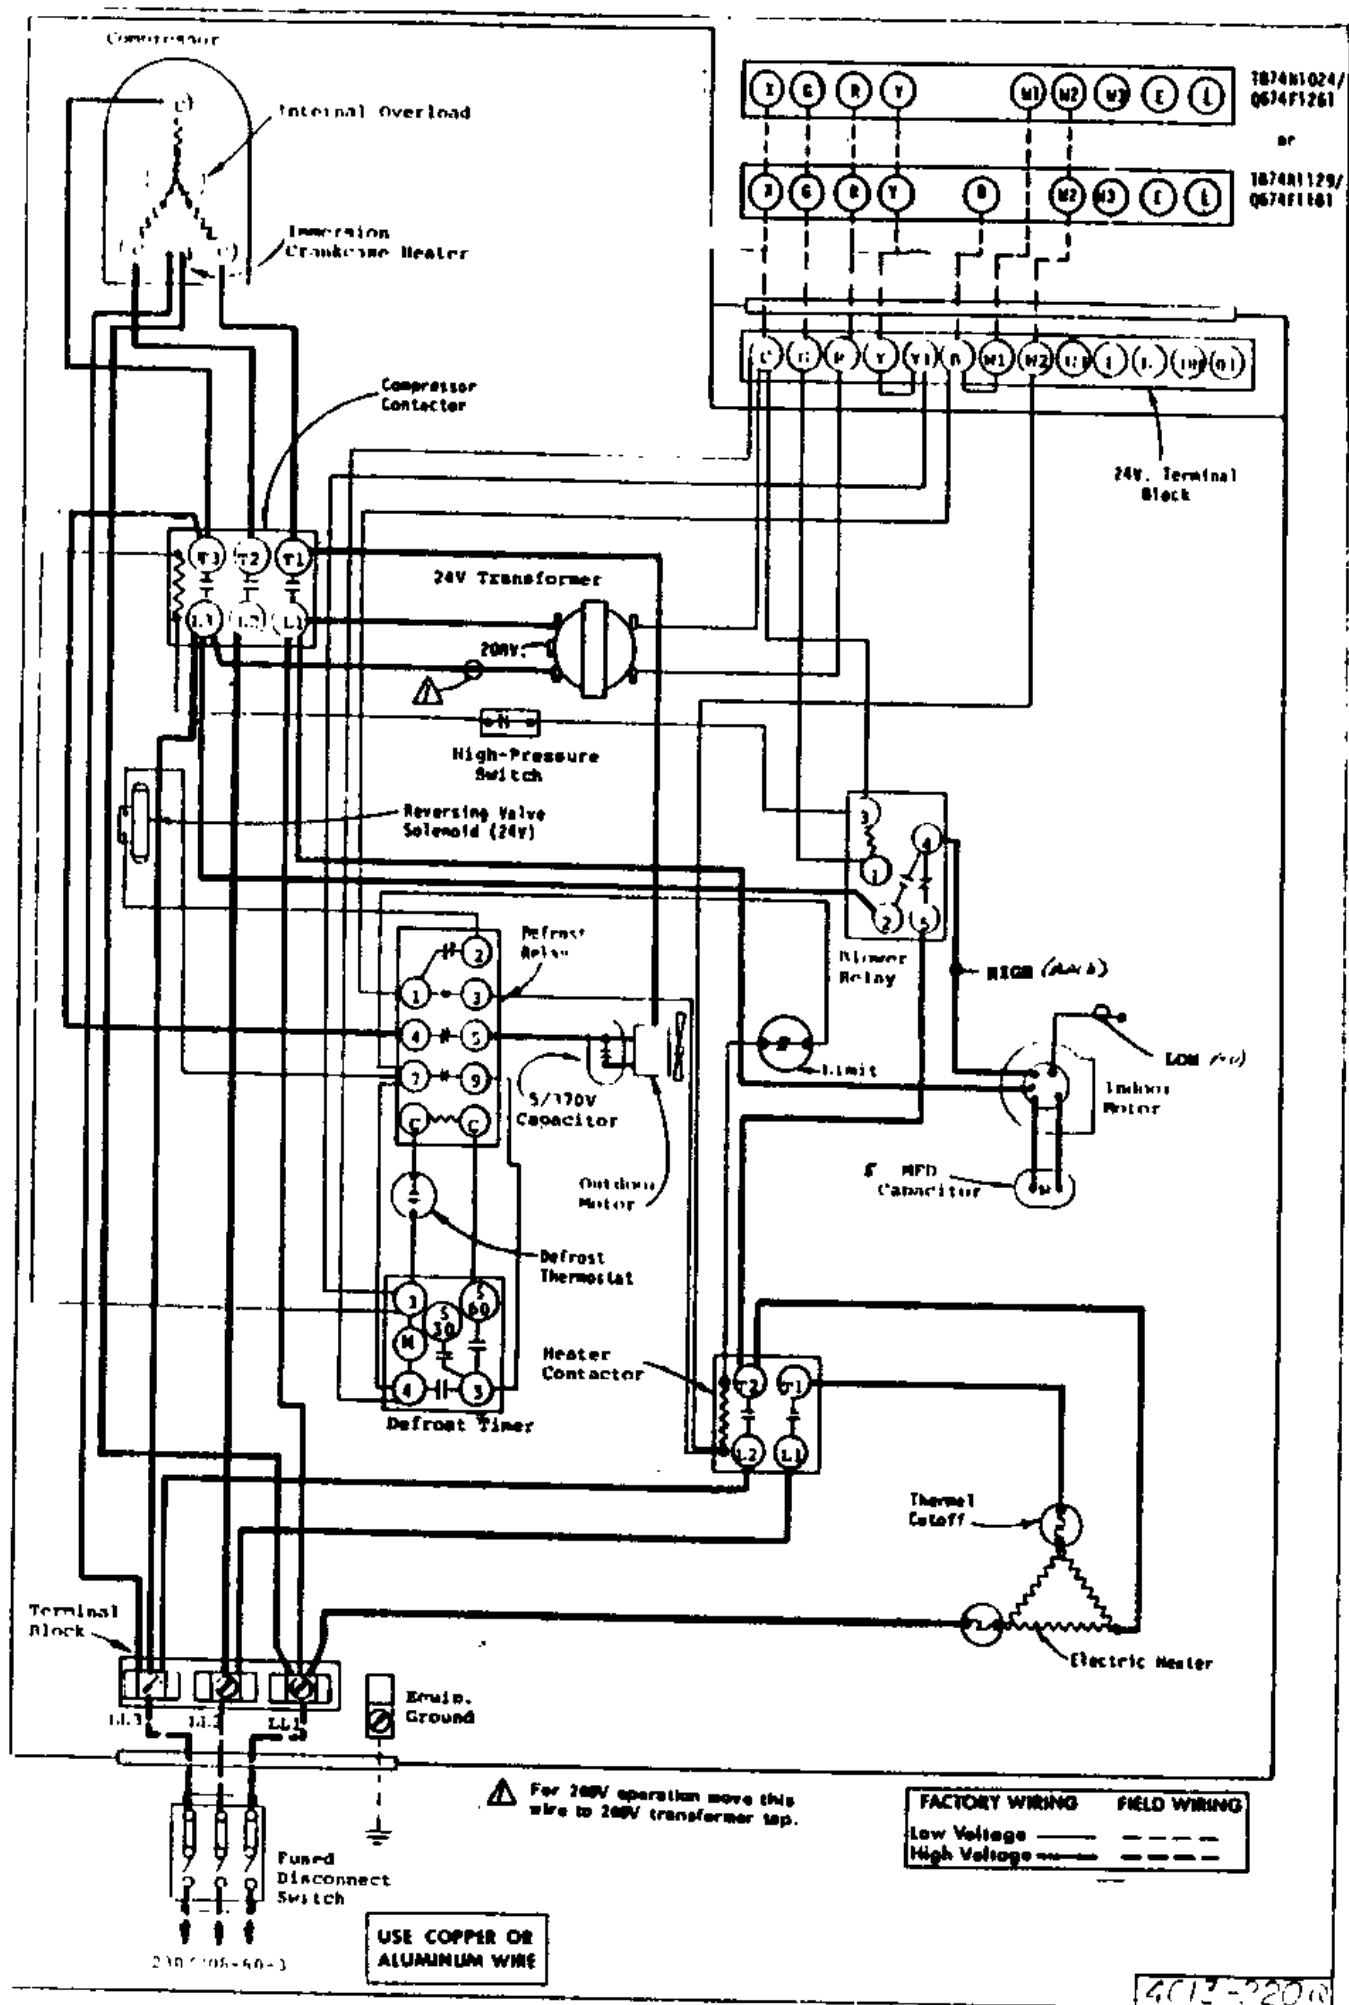

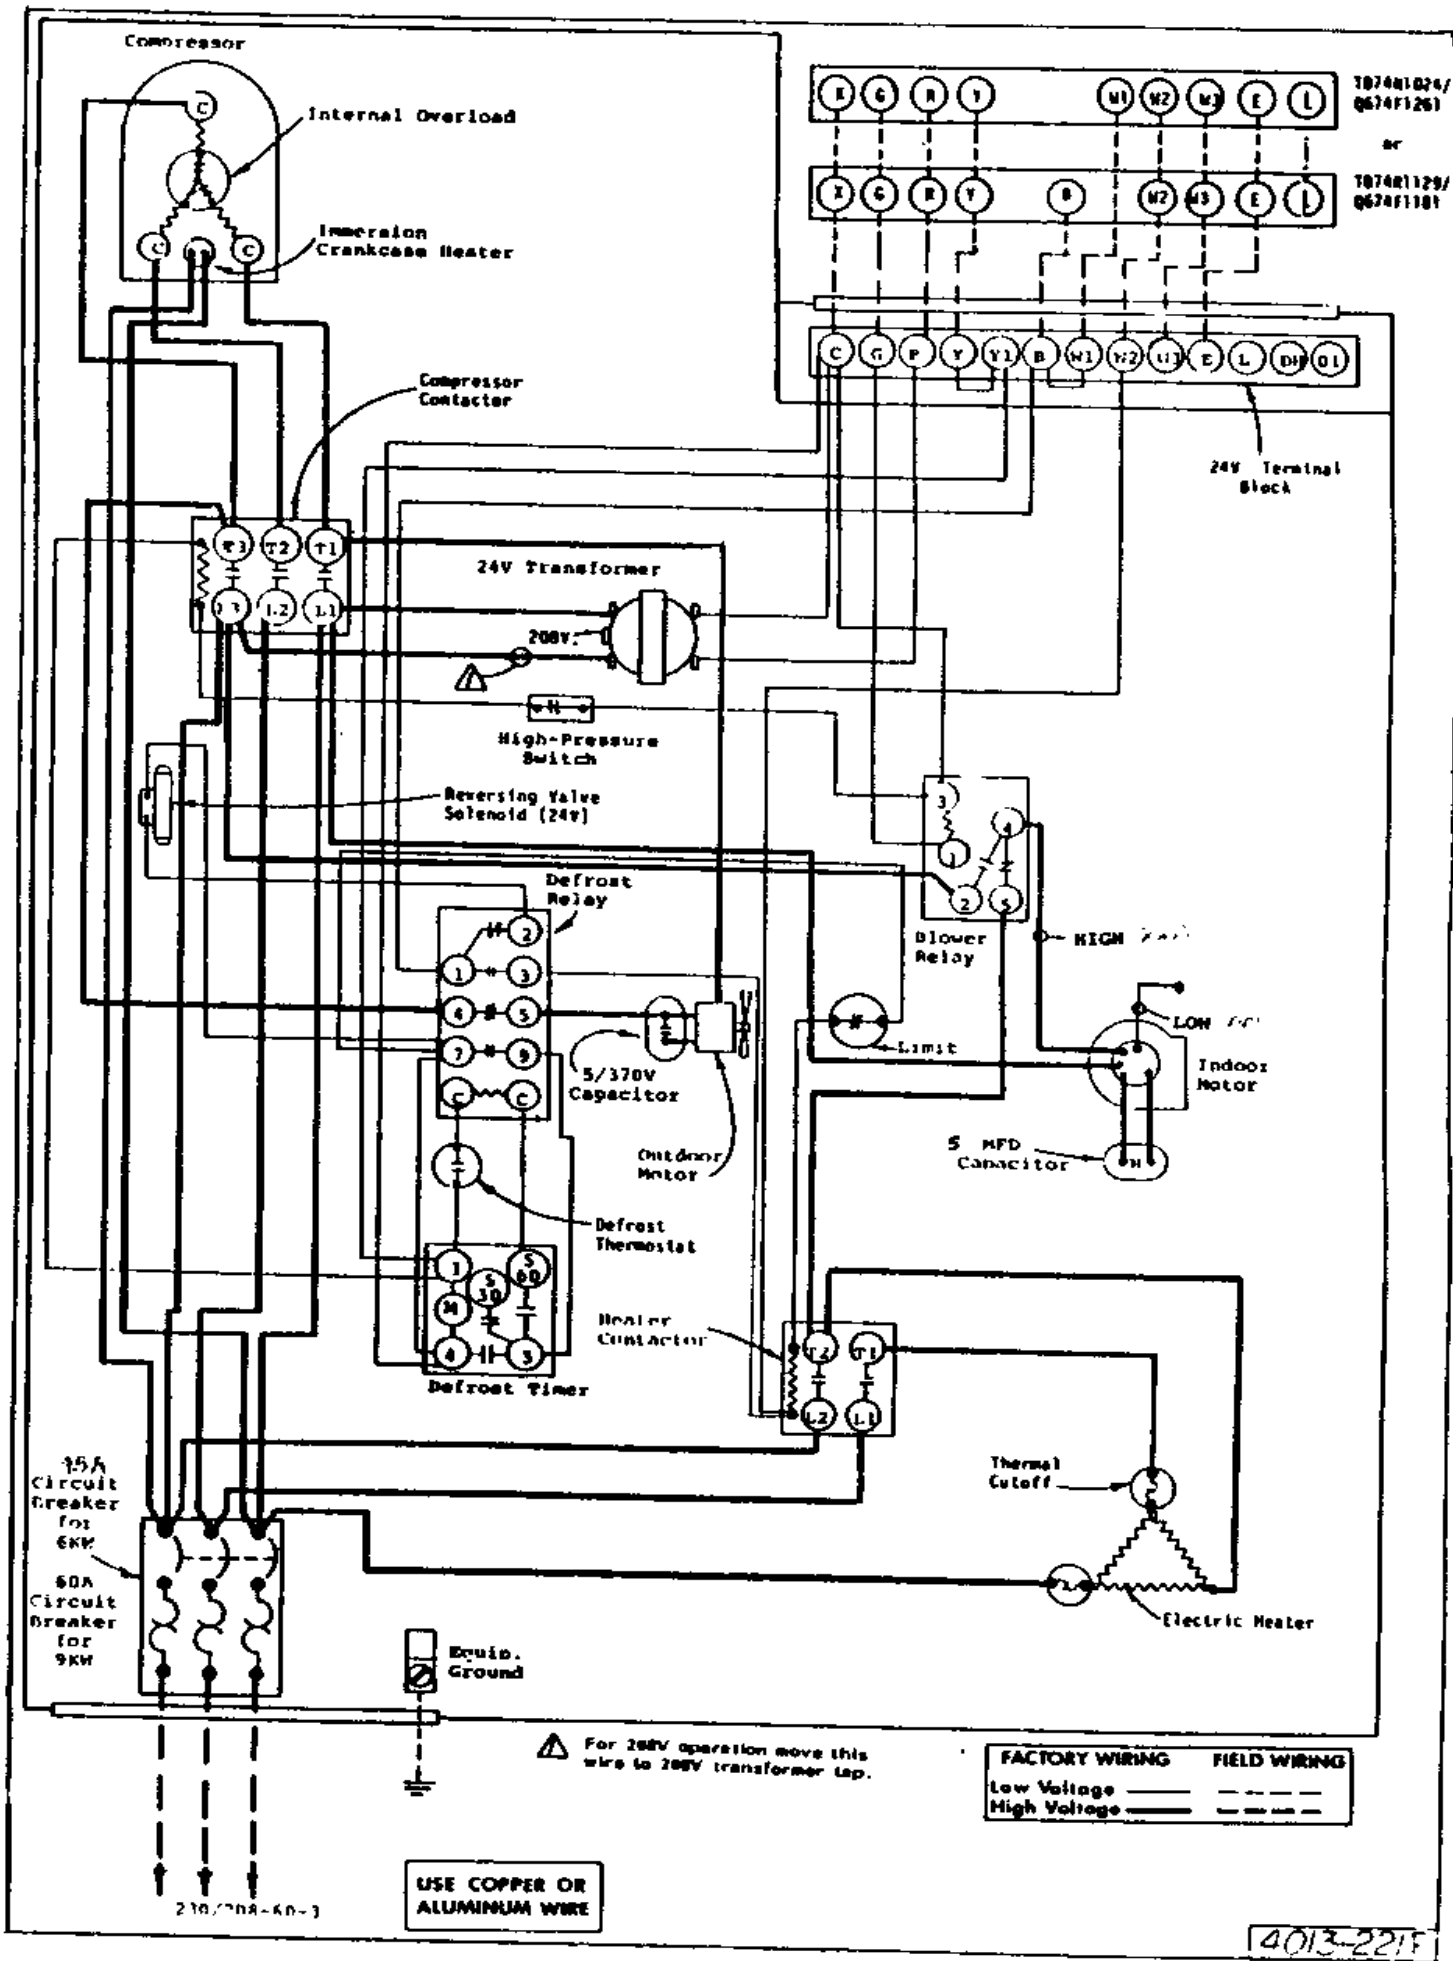



107401024/  
0674F1261  
or  
107401129/  
0674F1181


24V Terminal Block

| FACTORY WIRING |    | FIELD WIRING |      |
|----------------|----|--------------|------|
| Low Voltage    | —— | ----         | ---- |
| High Voltage   | —— | ----         | ---- |

4013-221F

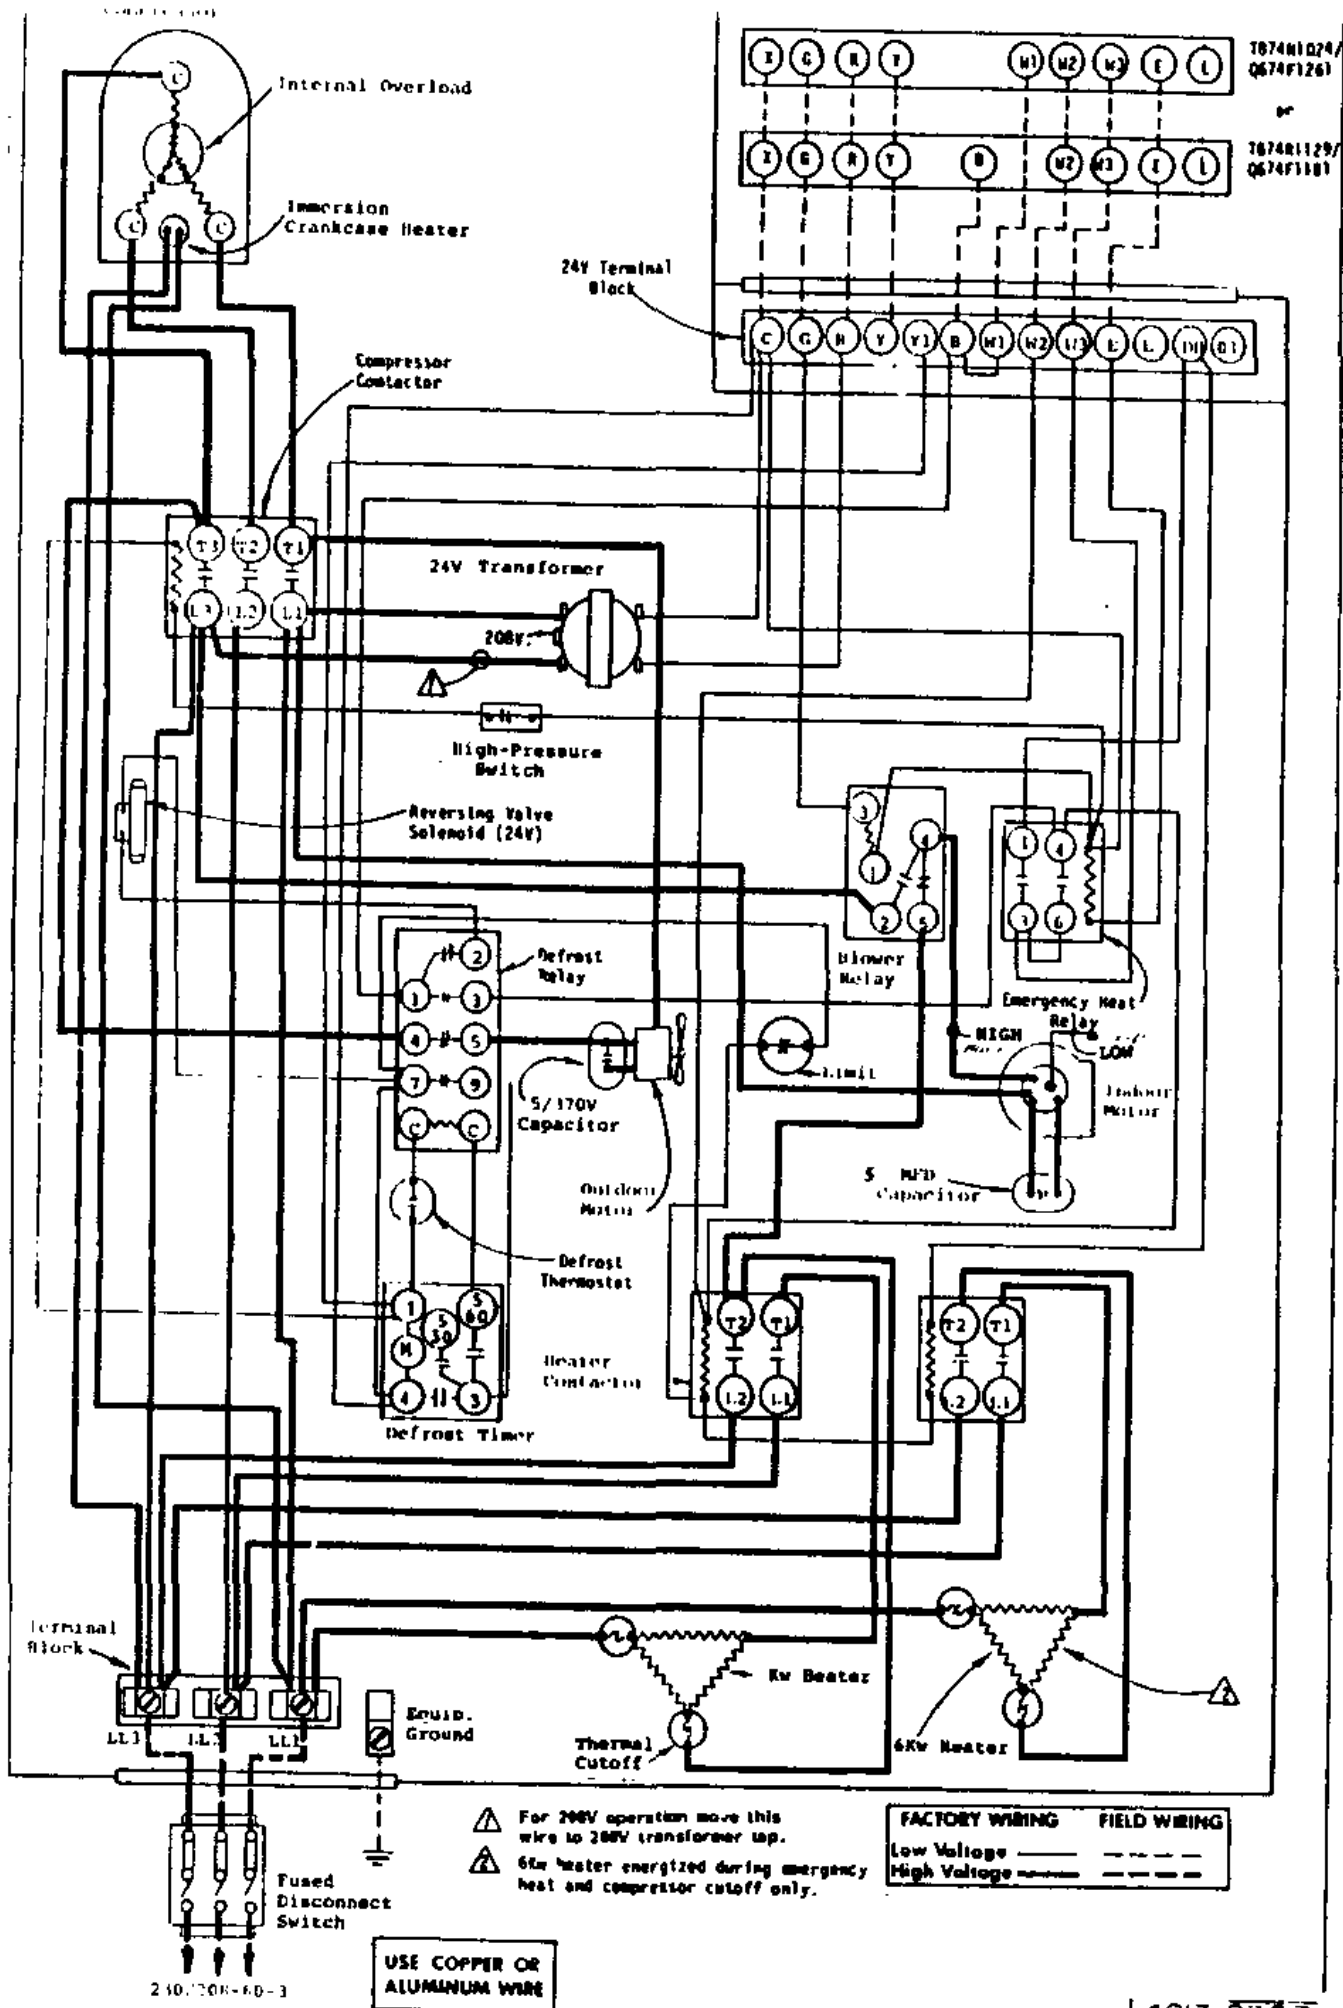

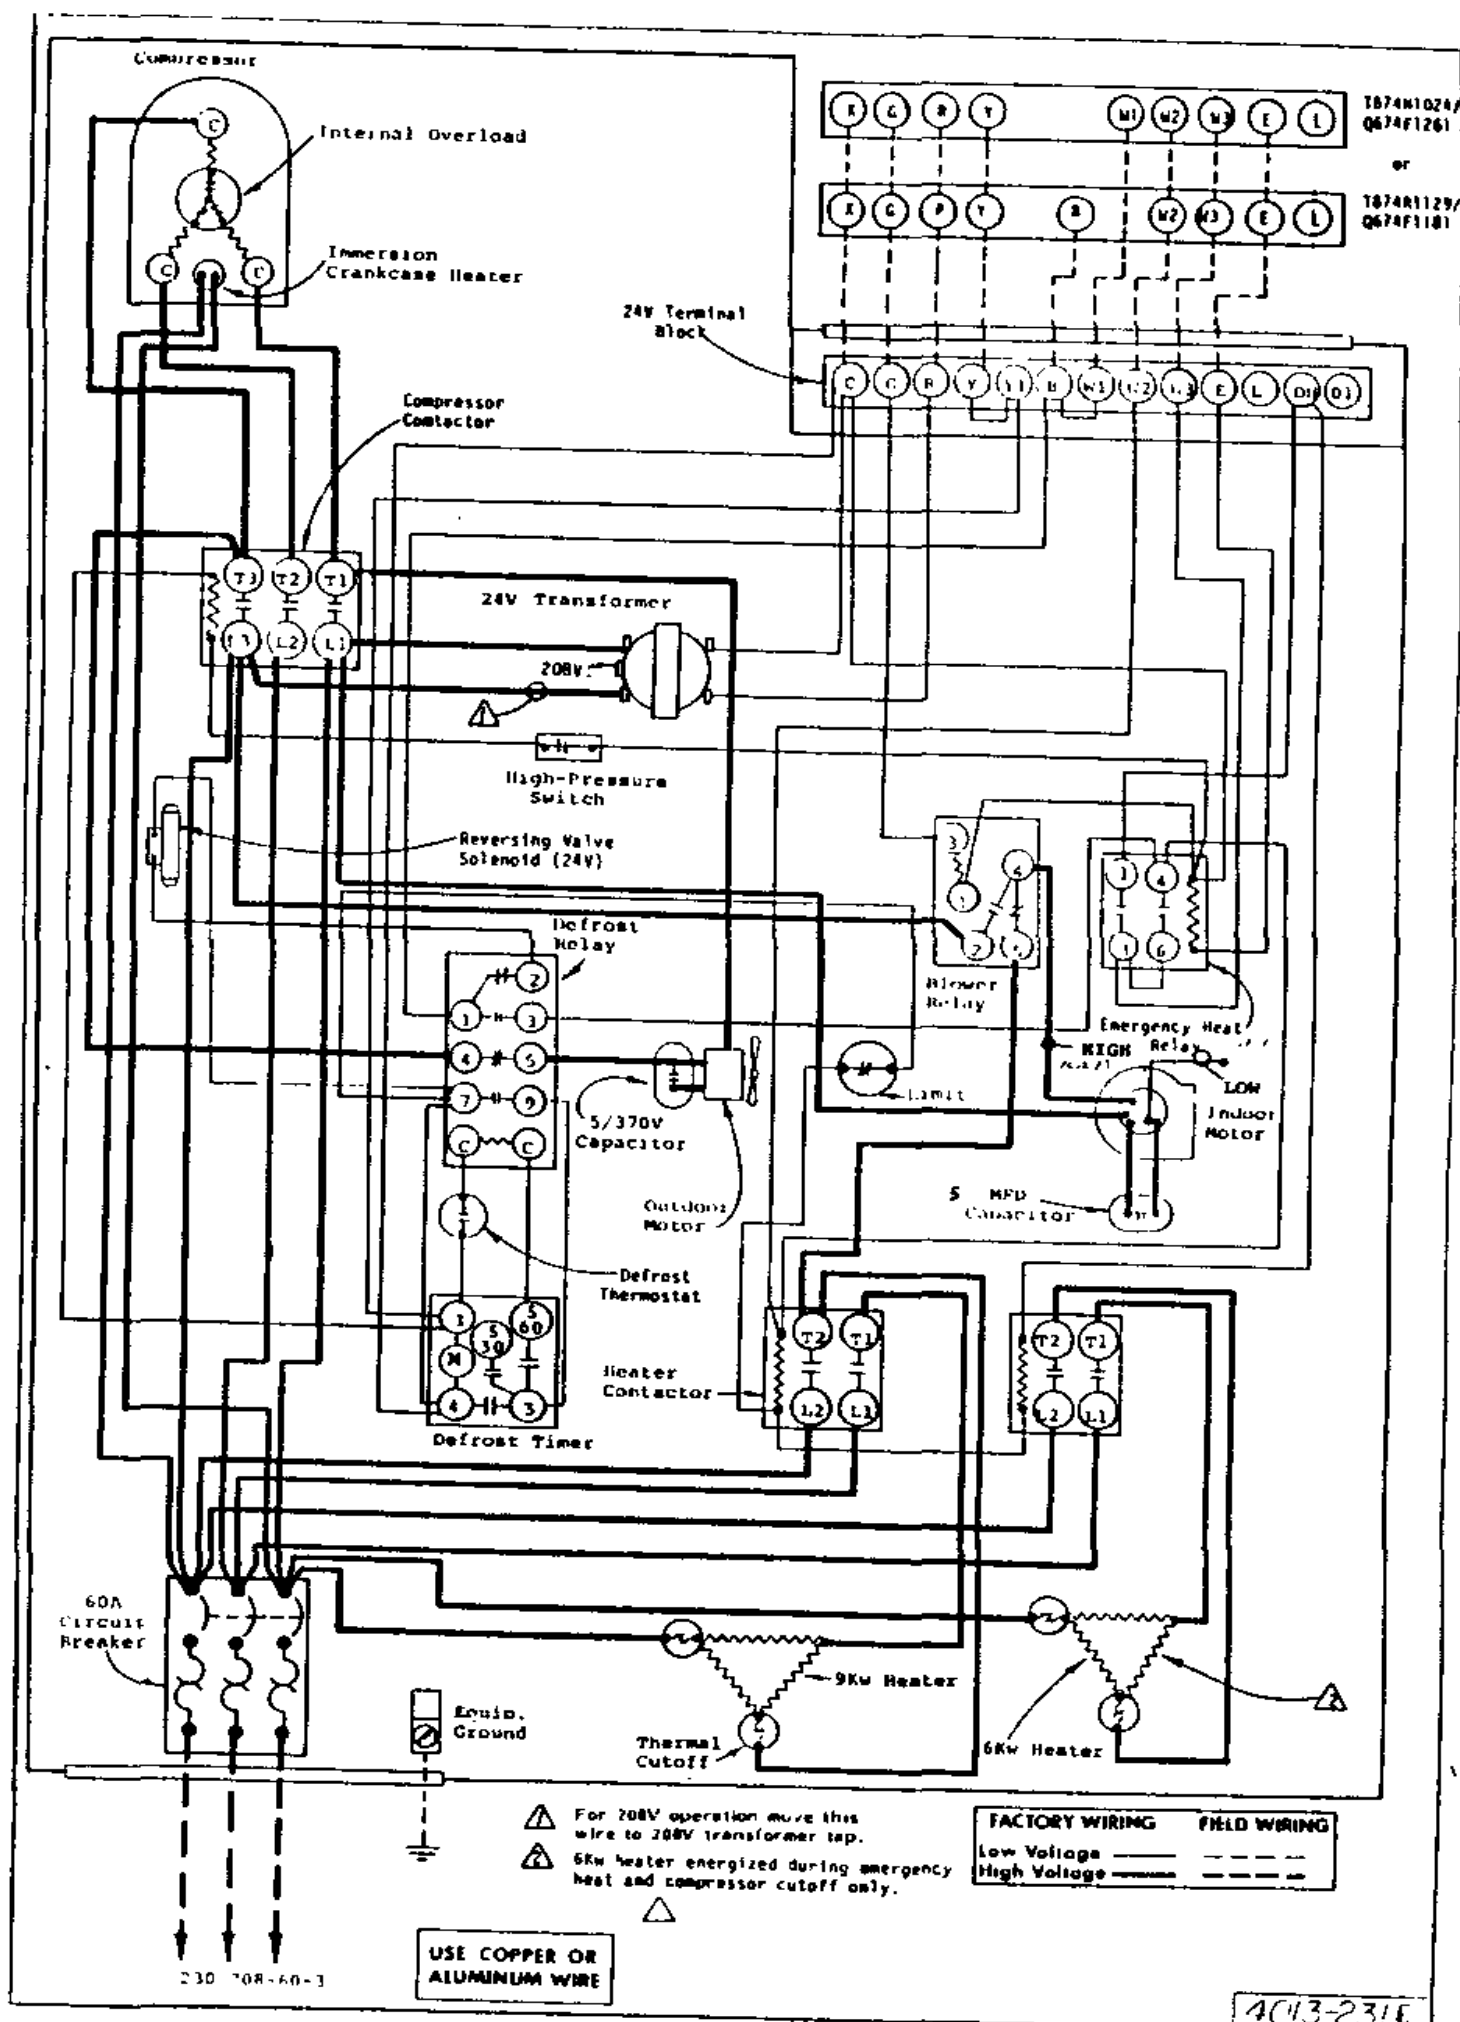

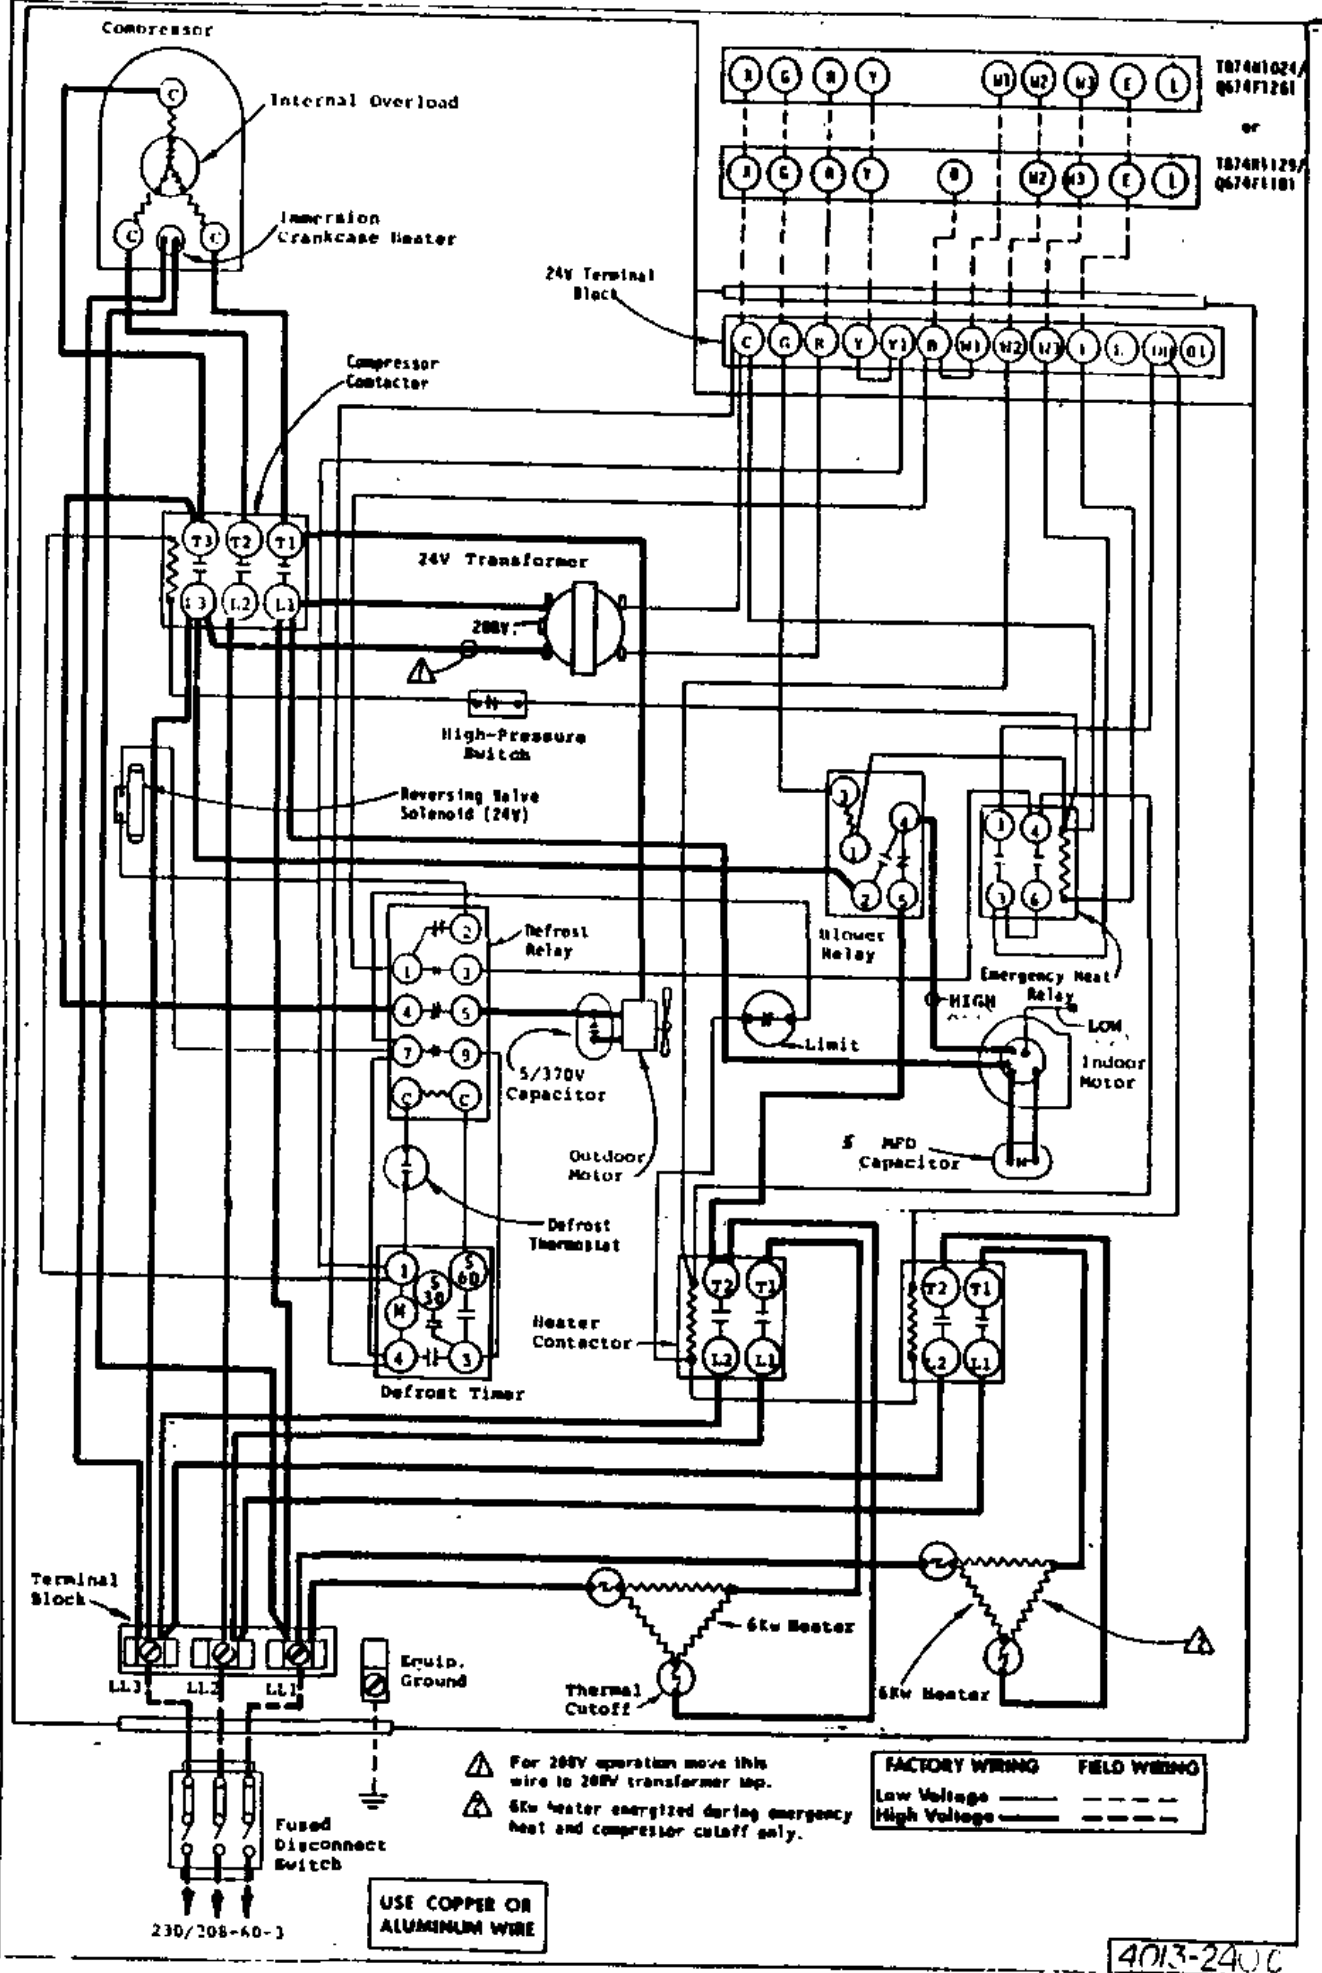

⚠ For 208V operation move this wire to 208V transformer tap.

⚠ 6kw heater energized during emergency heat and compressor cutoff only.