


17241076-1672F-2-9
7421129-1671F1267

17241076-1672F-1-8
7421129-1671F1267

240 Terminal Block

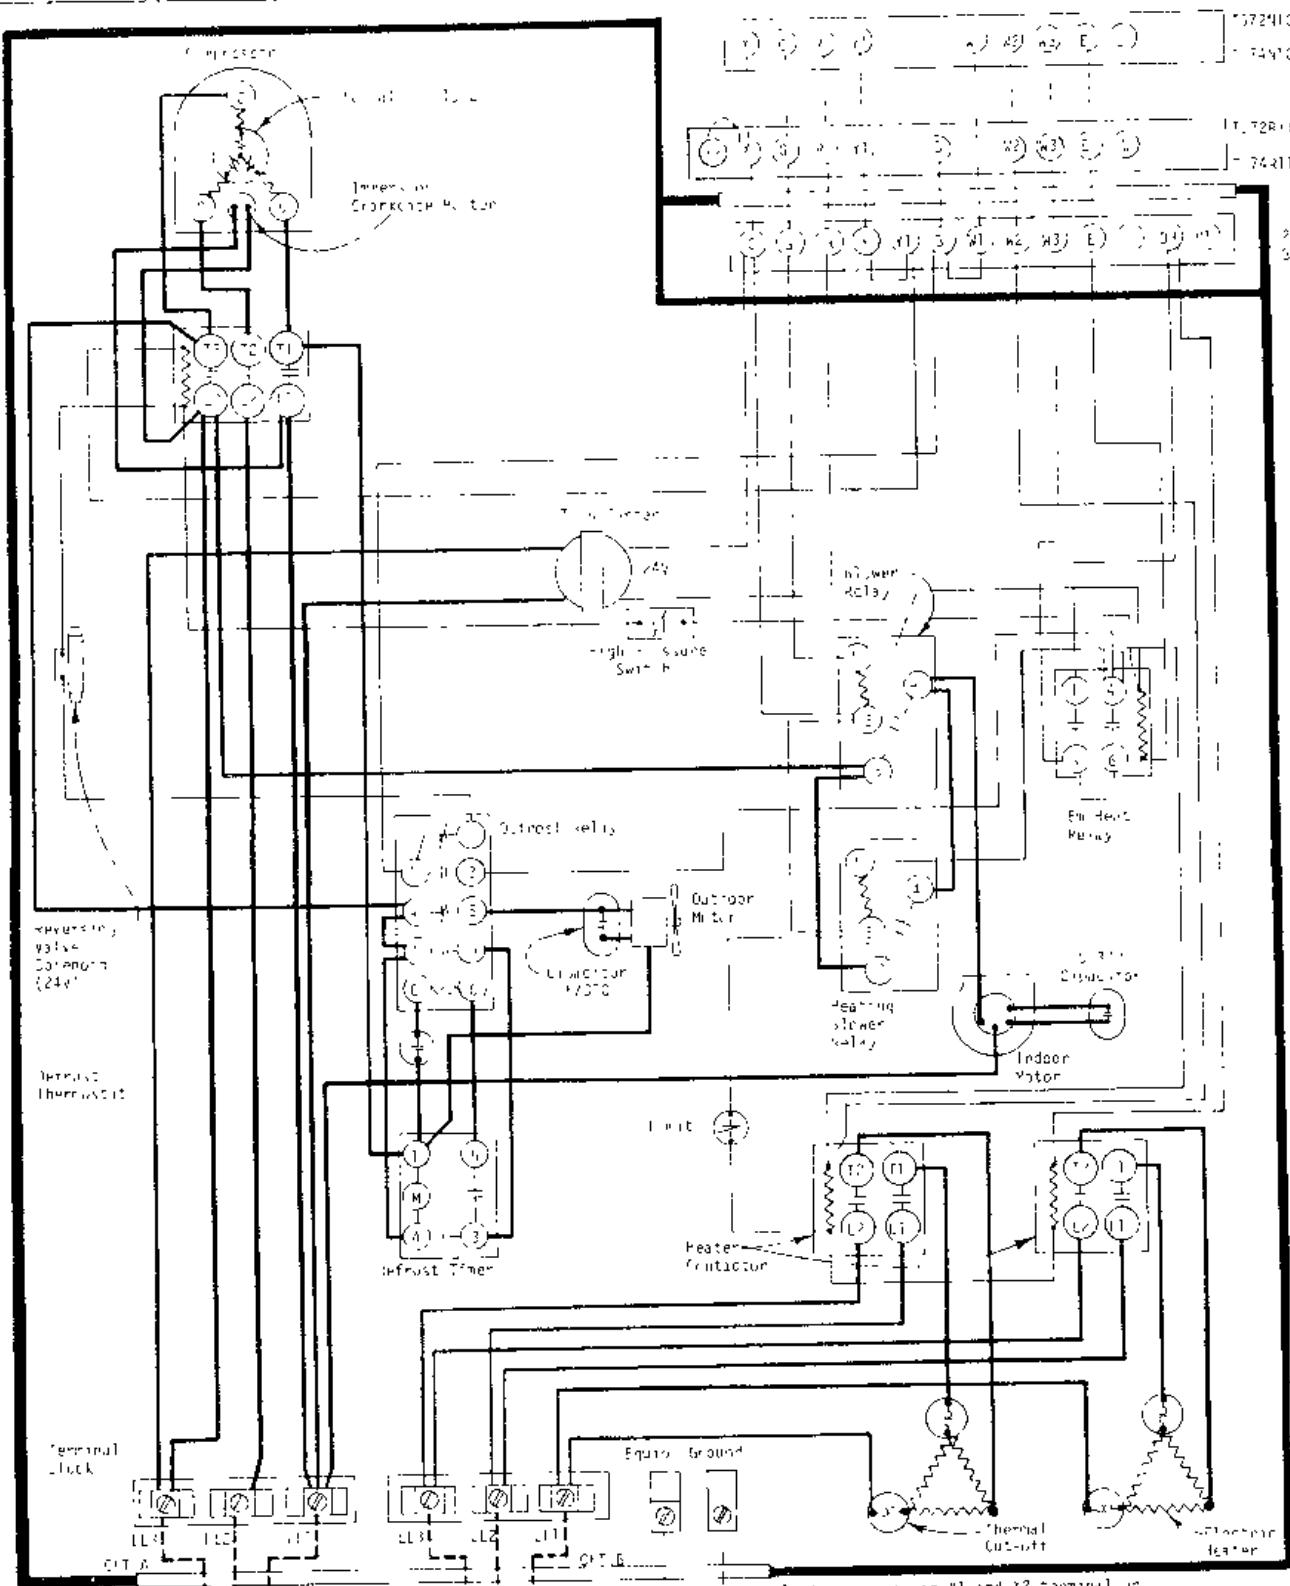

USE WIRE OF
APPROPRIATE SIZE

Fixed
Disconnect
Switch

230/240-3

FACTORY WIRING FIELD WIRING
Low Voltage High Voltage

MODEL
17241076
HEAT PUMP
W/16-1

If there is an X1 and X2 terminal on
terminal block, jumper them together and
connect from X1 to either
one.

17241076