



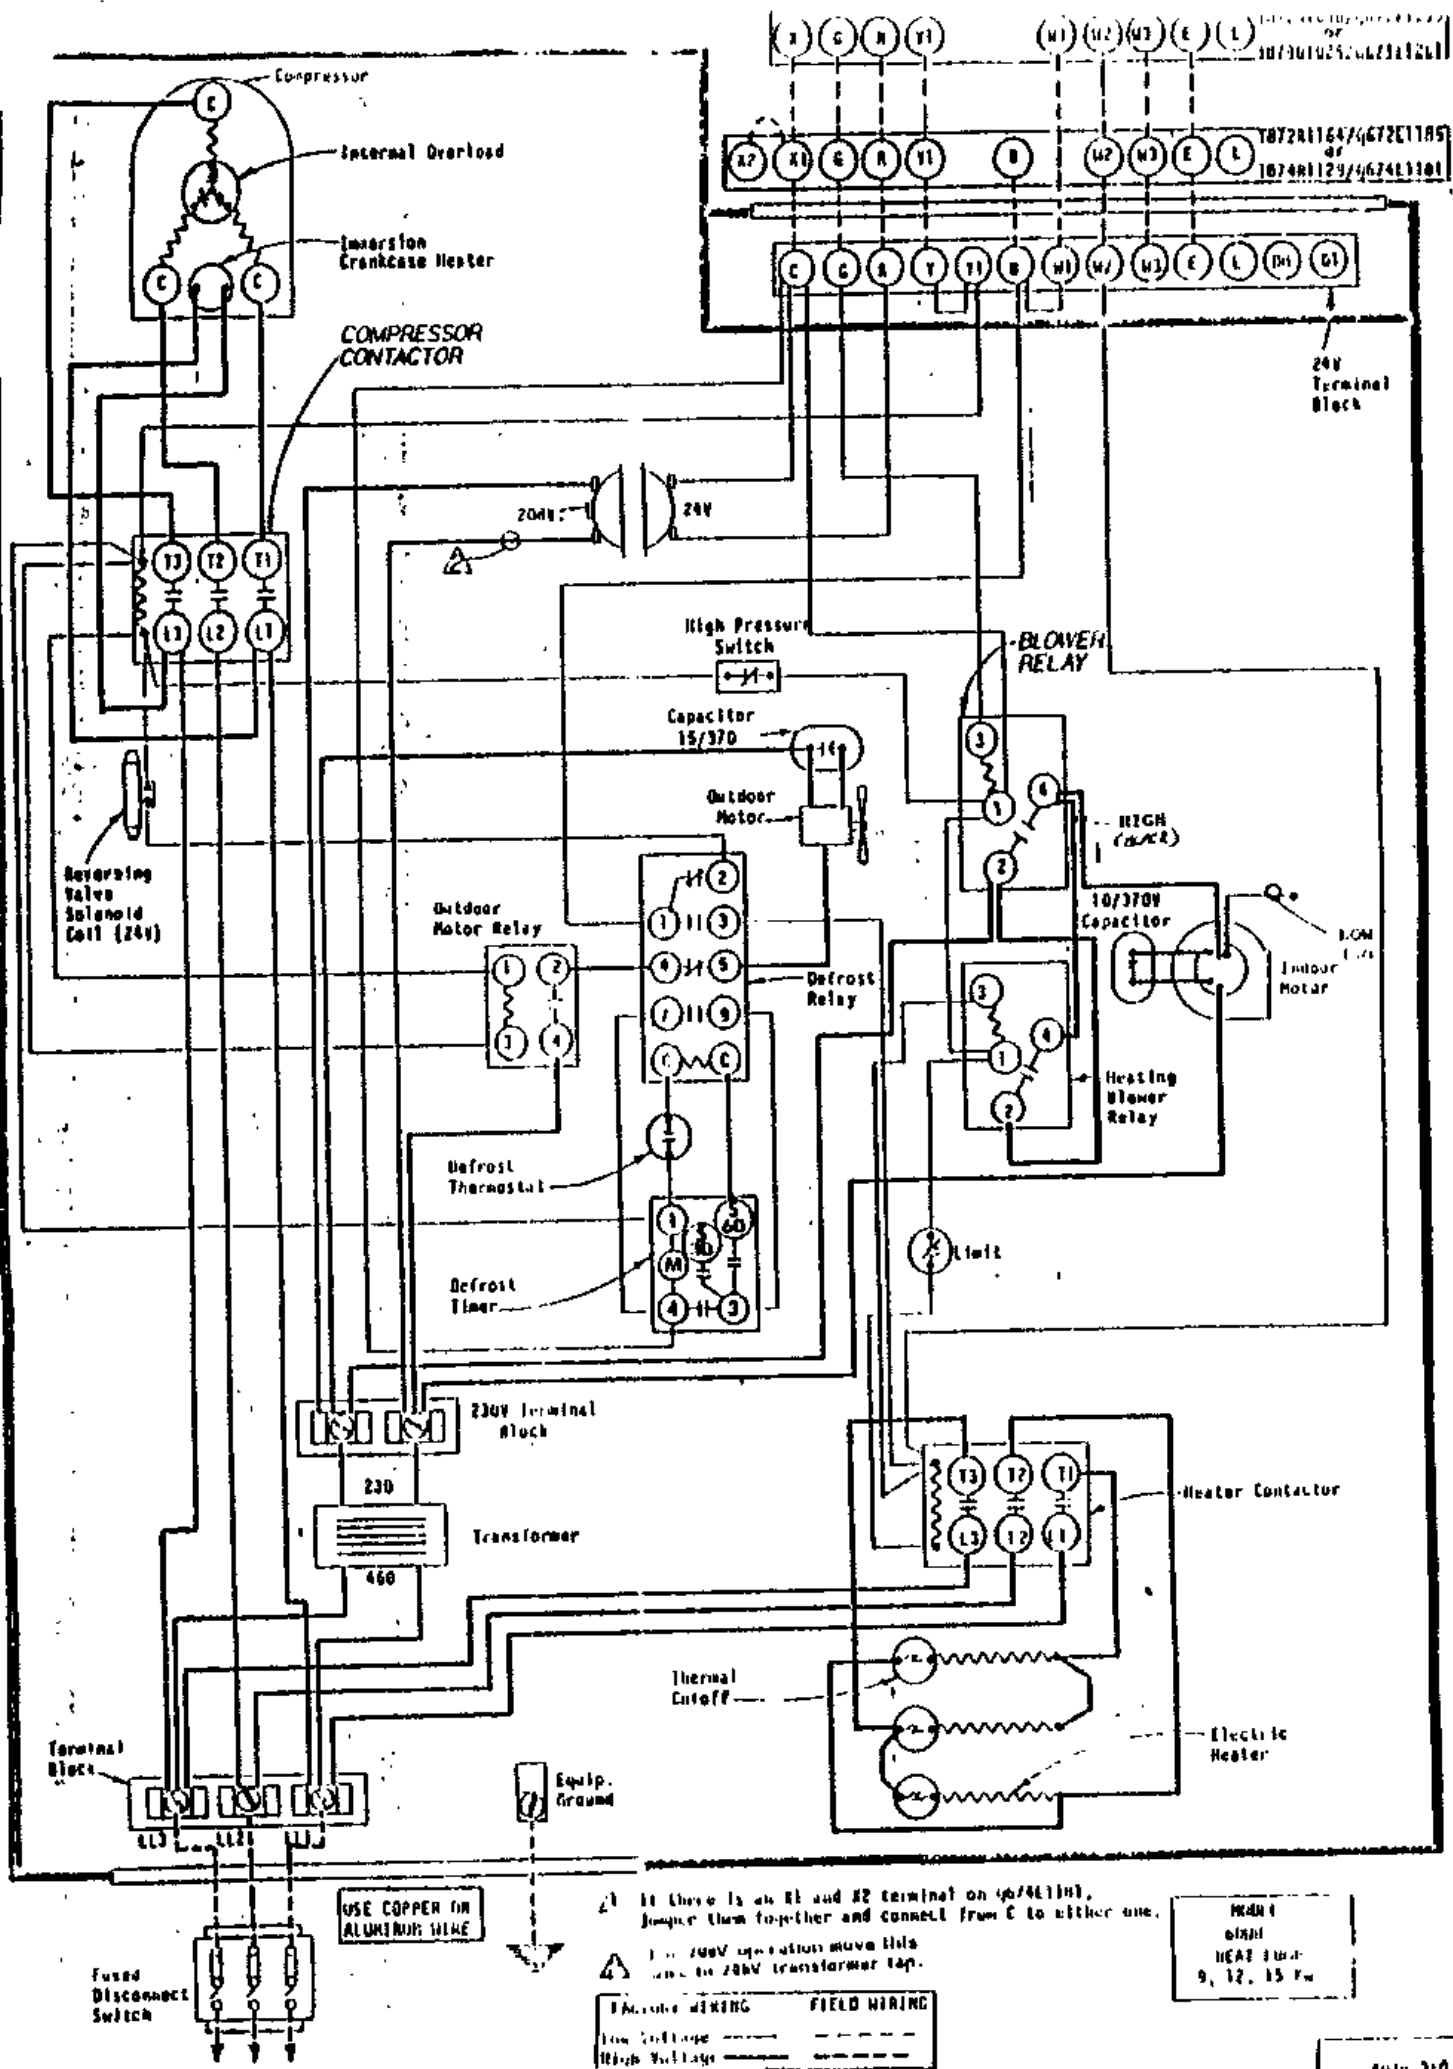

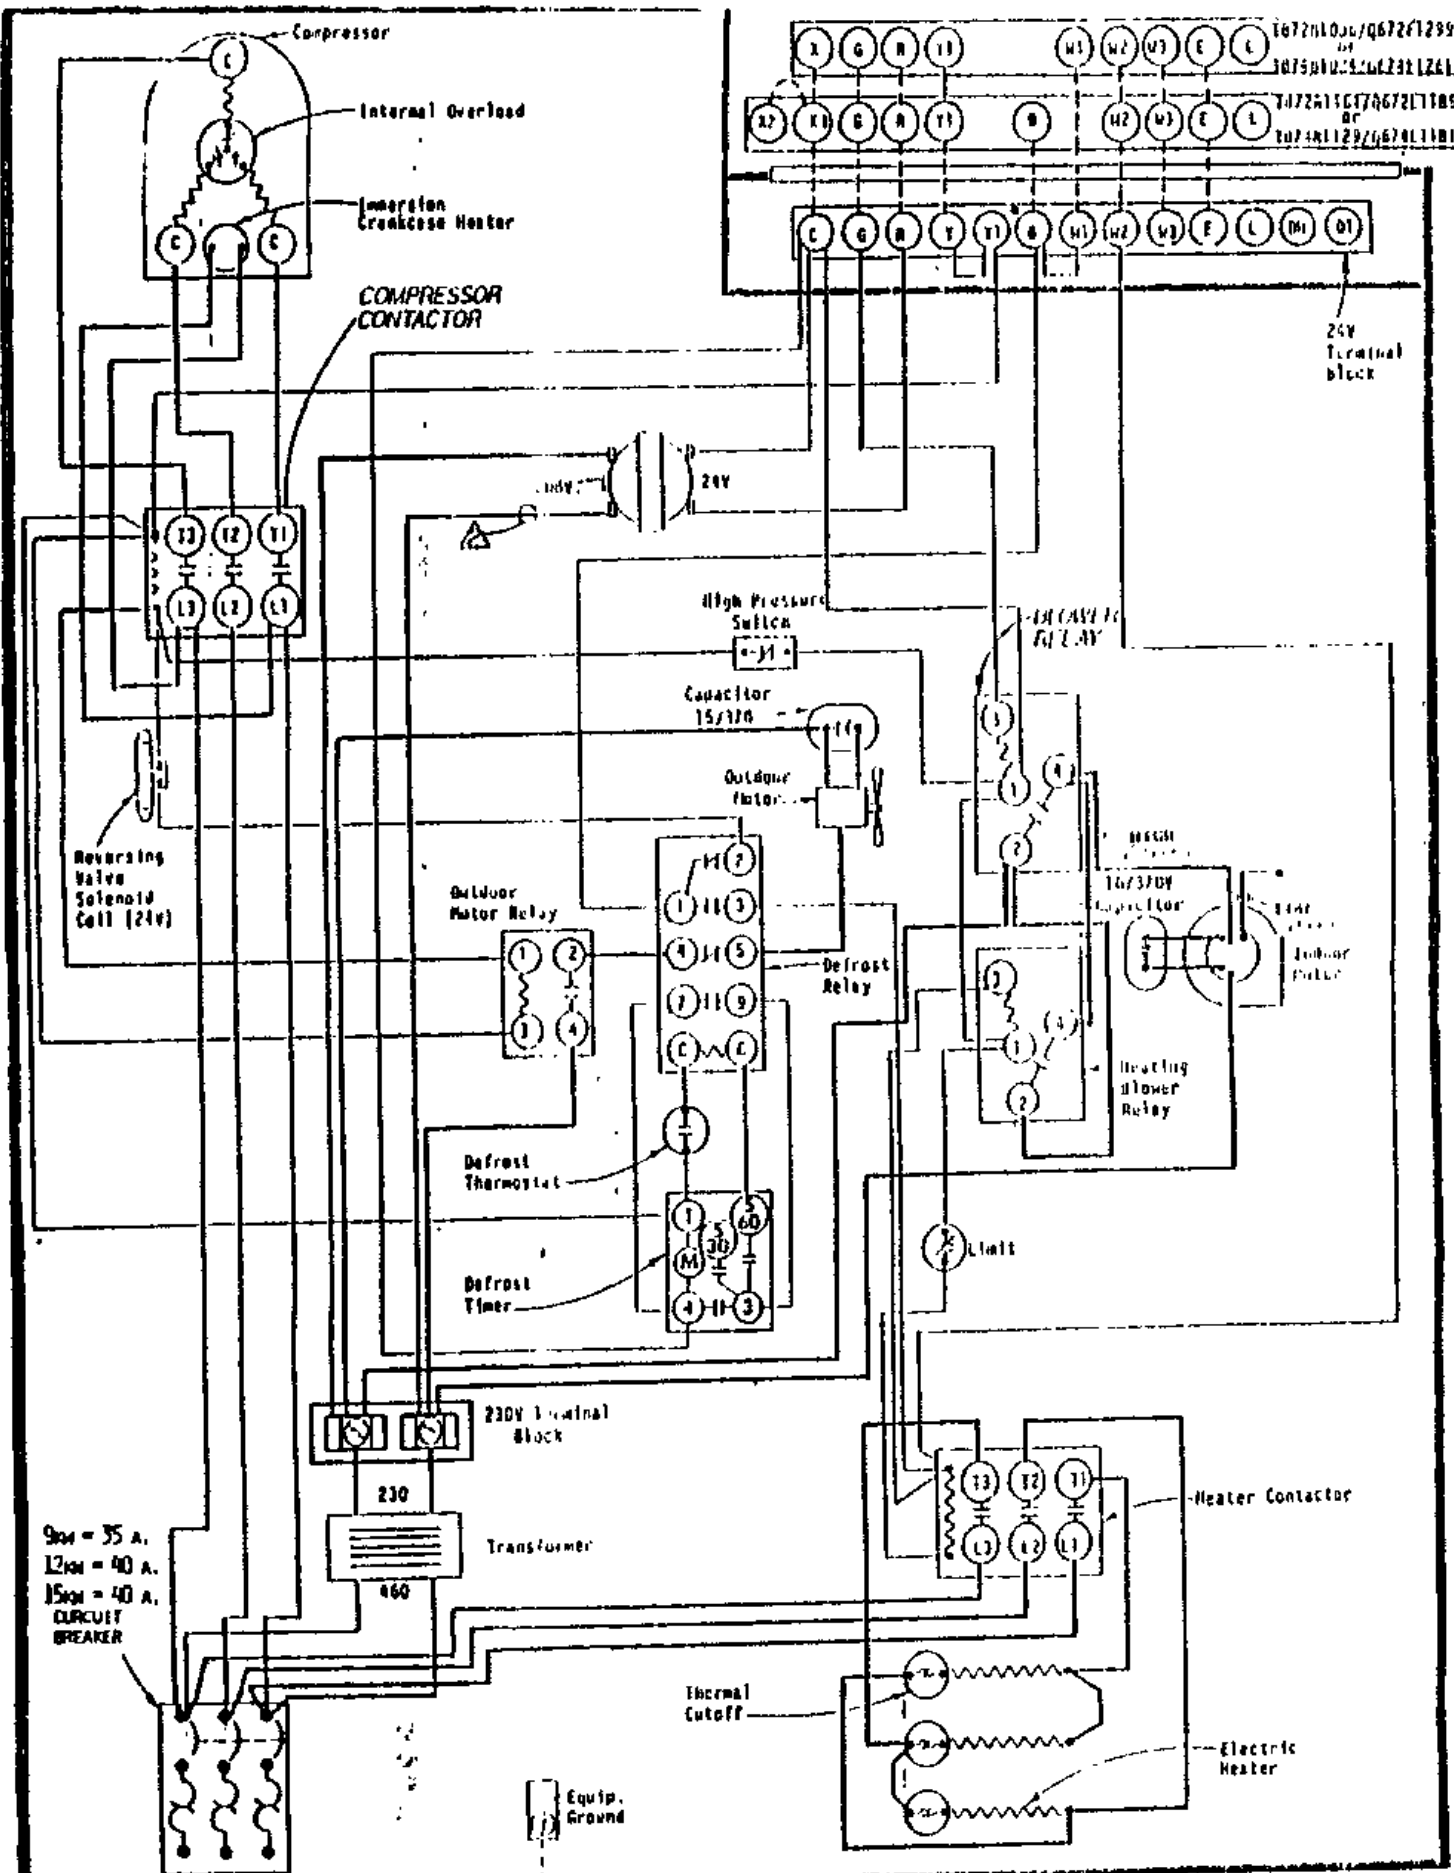

90A = 35 A.
 120A = 40 A.
 150A = 40 A.
 CIRCUIT BREAKER

USE COPPER OR ALUMINUM WIRE

⚠ If there is an X1 and X2 terminal on (46741101), jumper them together and connect from C to either one.
 ⚠ For 208V operation move this wire to 208V transformer tap.

MODEL 60H
 HEAT PUMP
 9, 12, 15 V.

FACTORY WIRING	FIELD WIRING
New Voltage	-----
Old Voltage	-----