



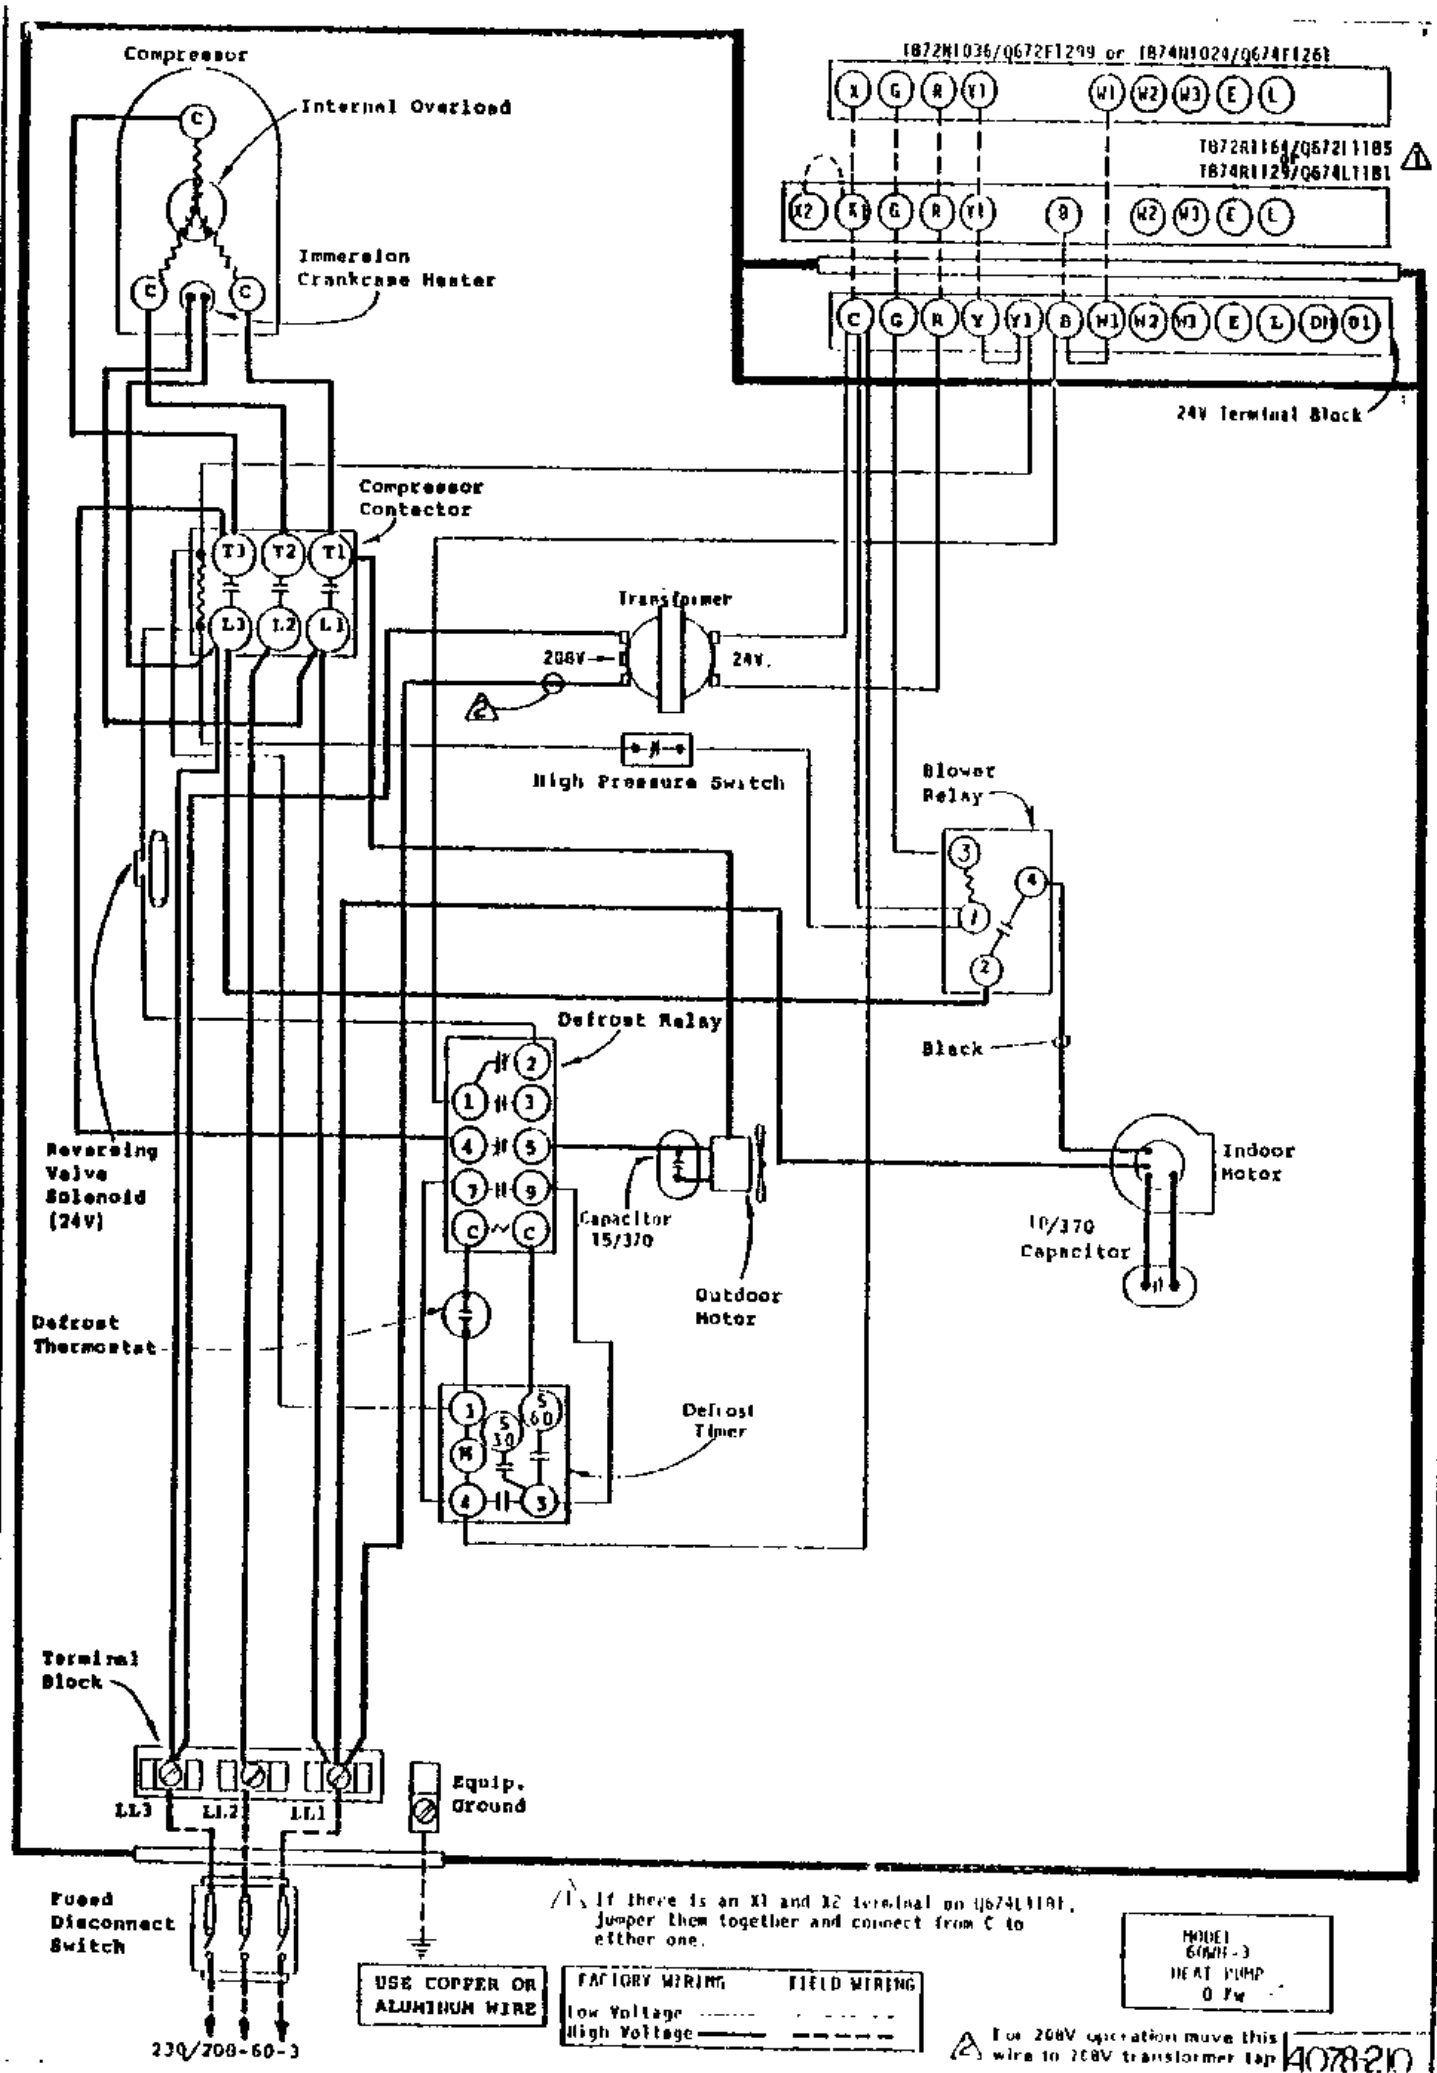


407820

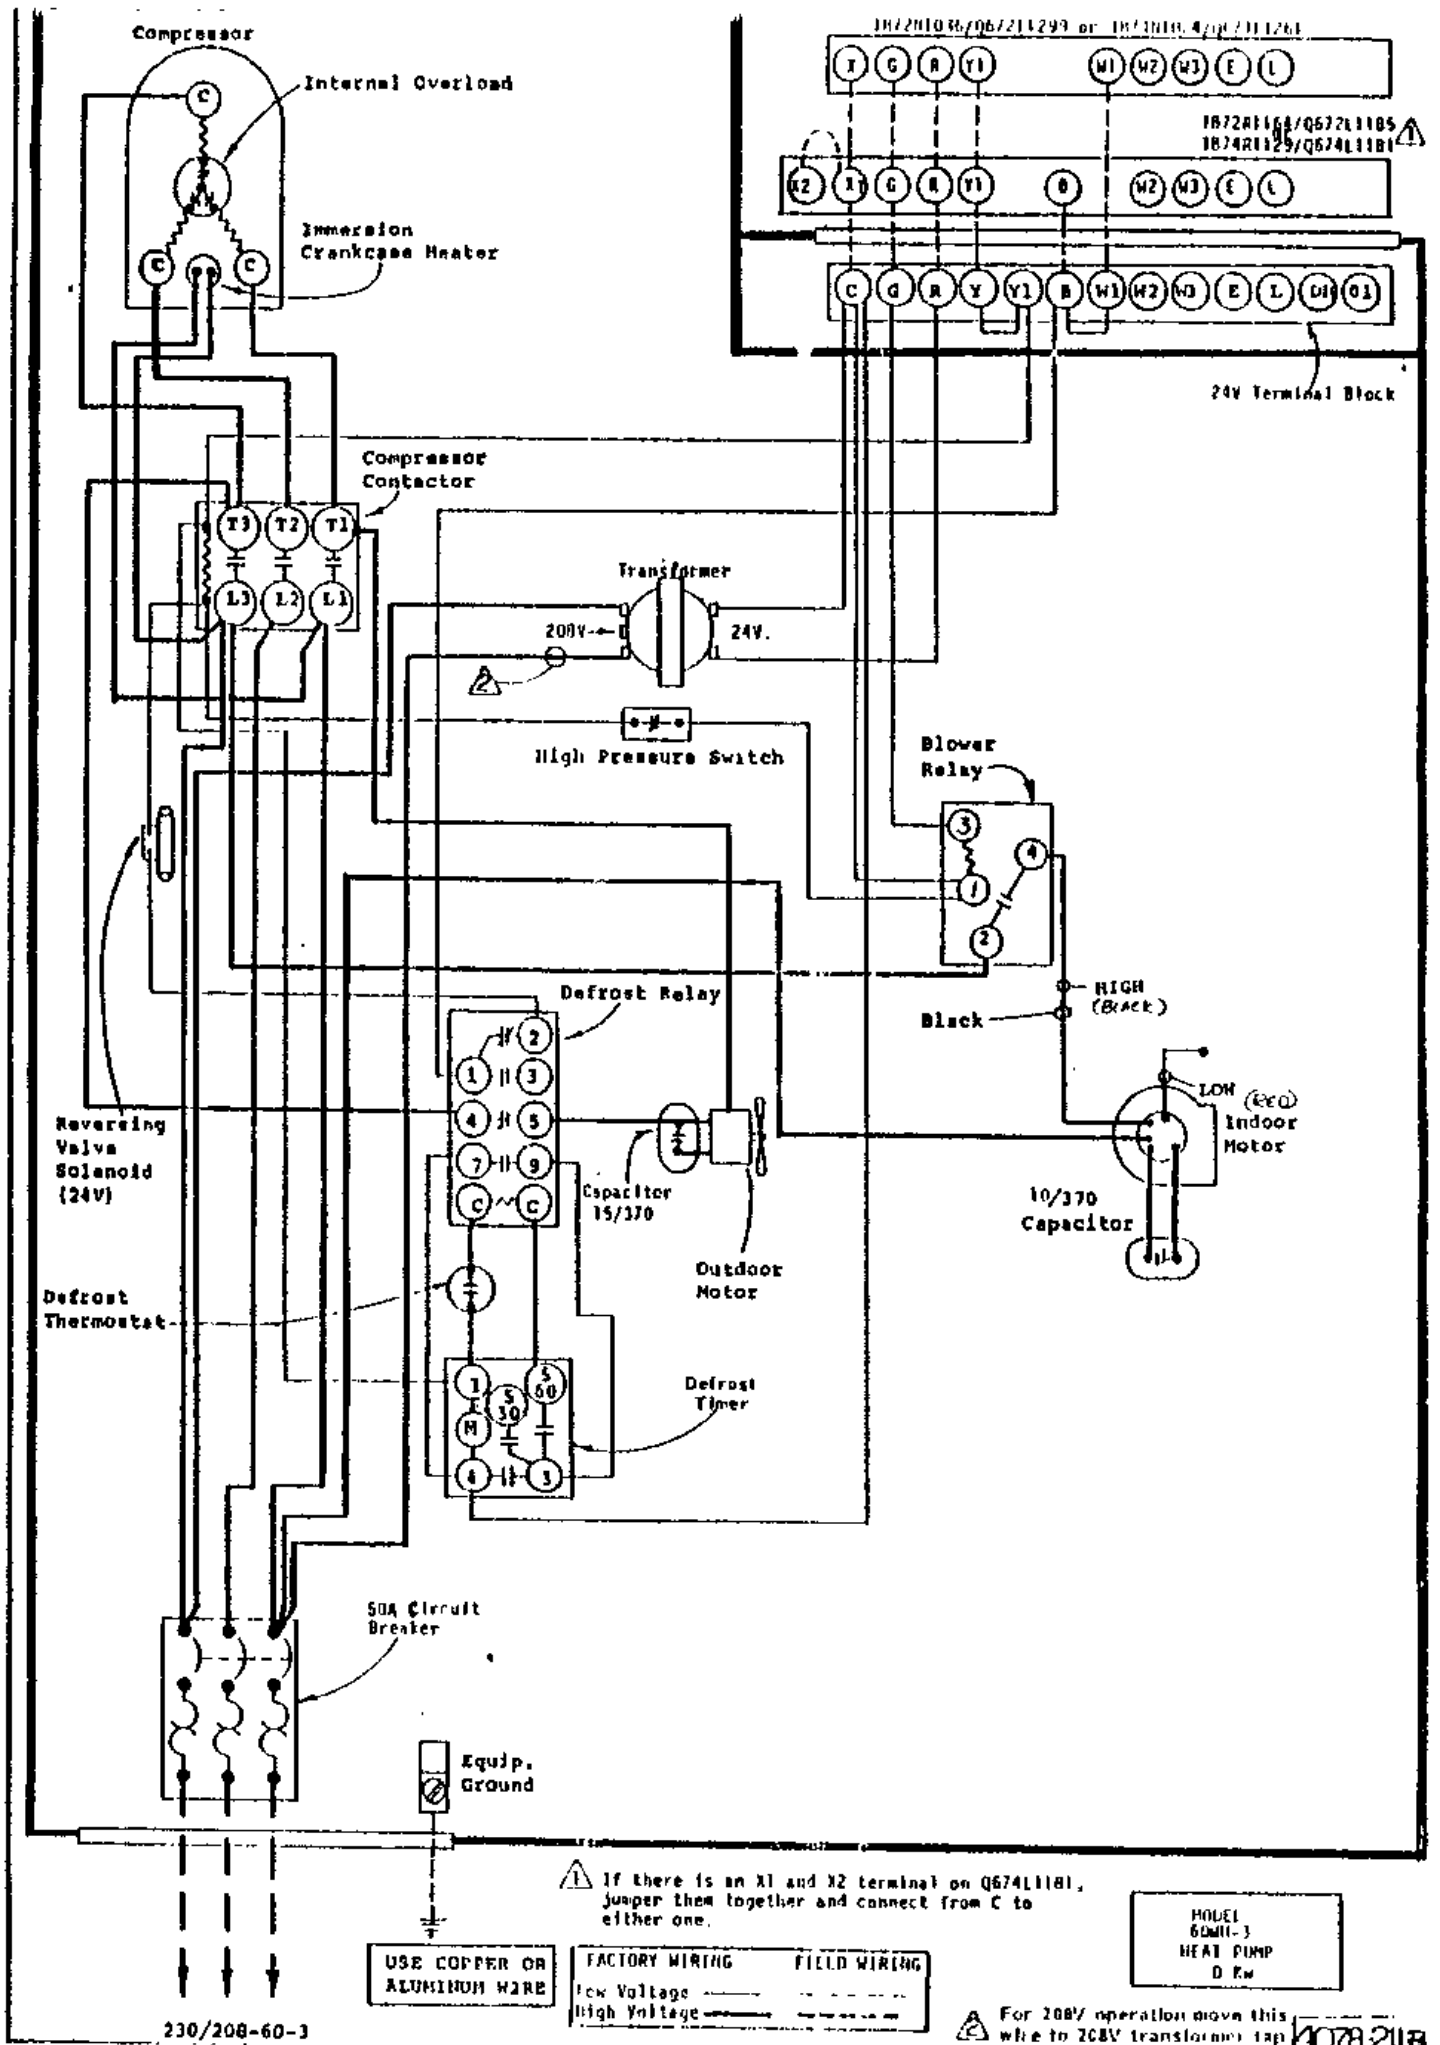


⚠ If there is an X1 and X2 terminal on Q674L1181, jumper them together and connect from C to either one.

⚠ For 208V operation move this wire to 208V transformer tap

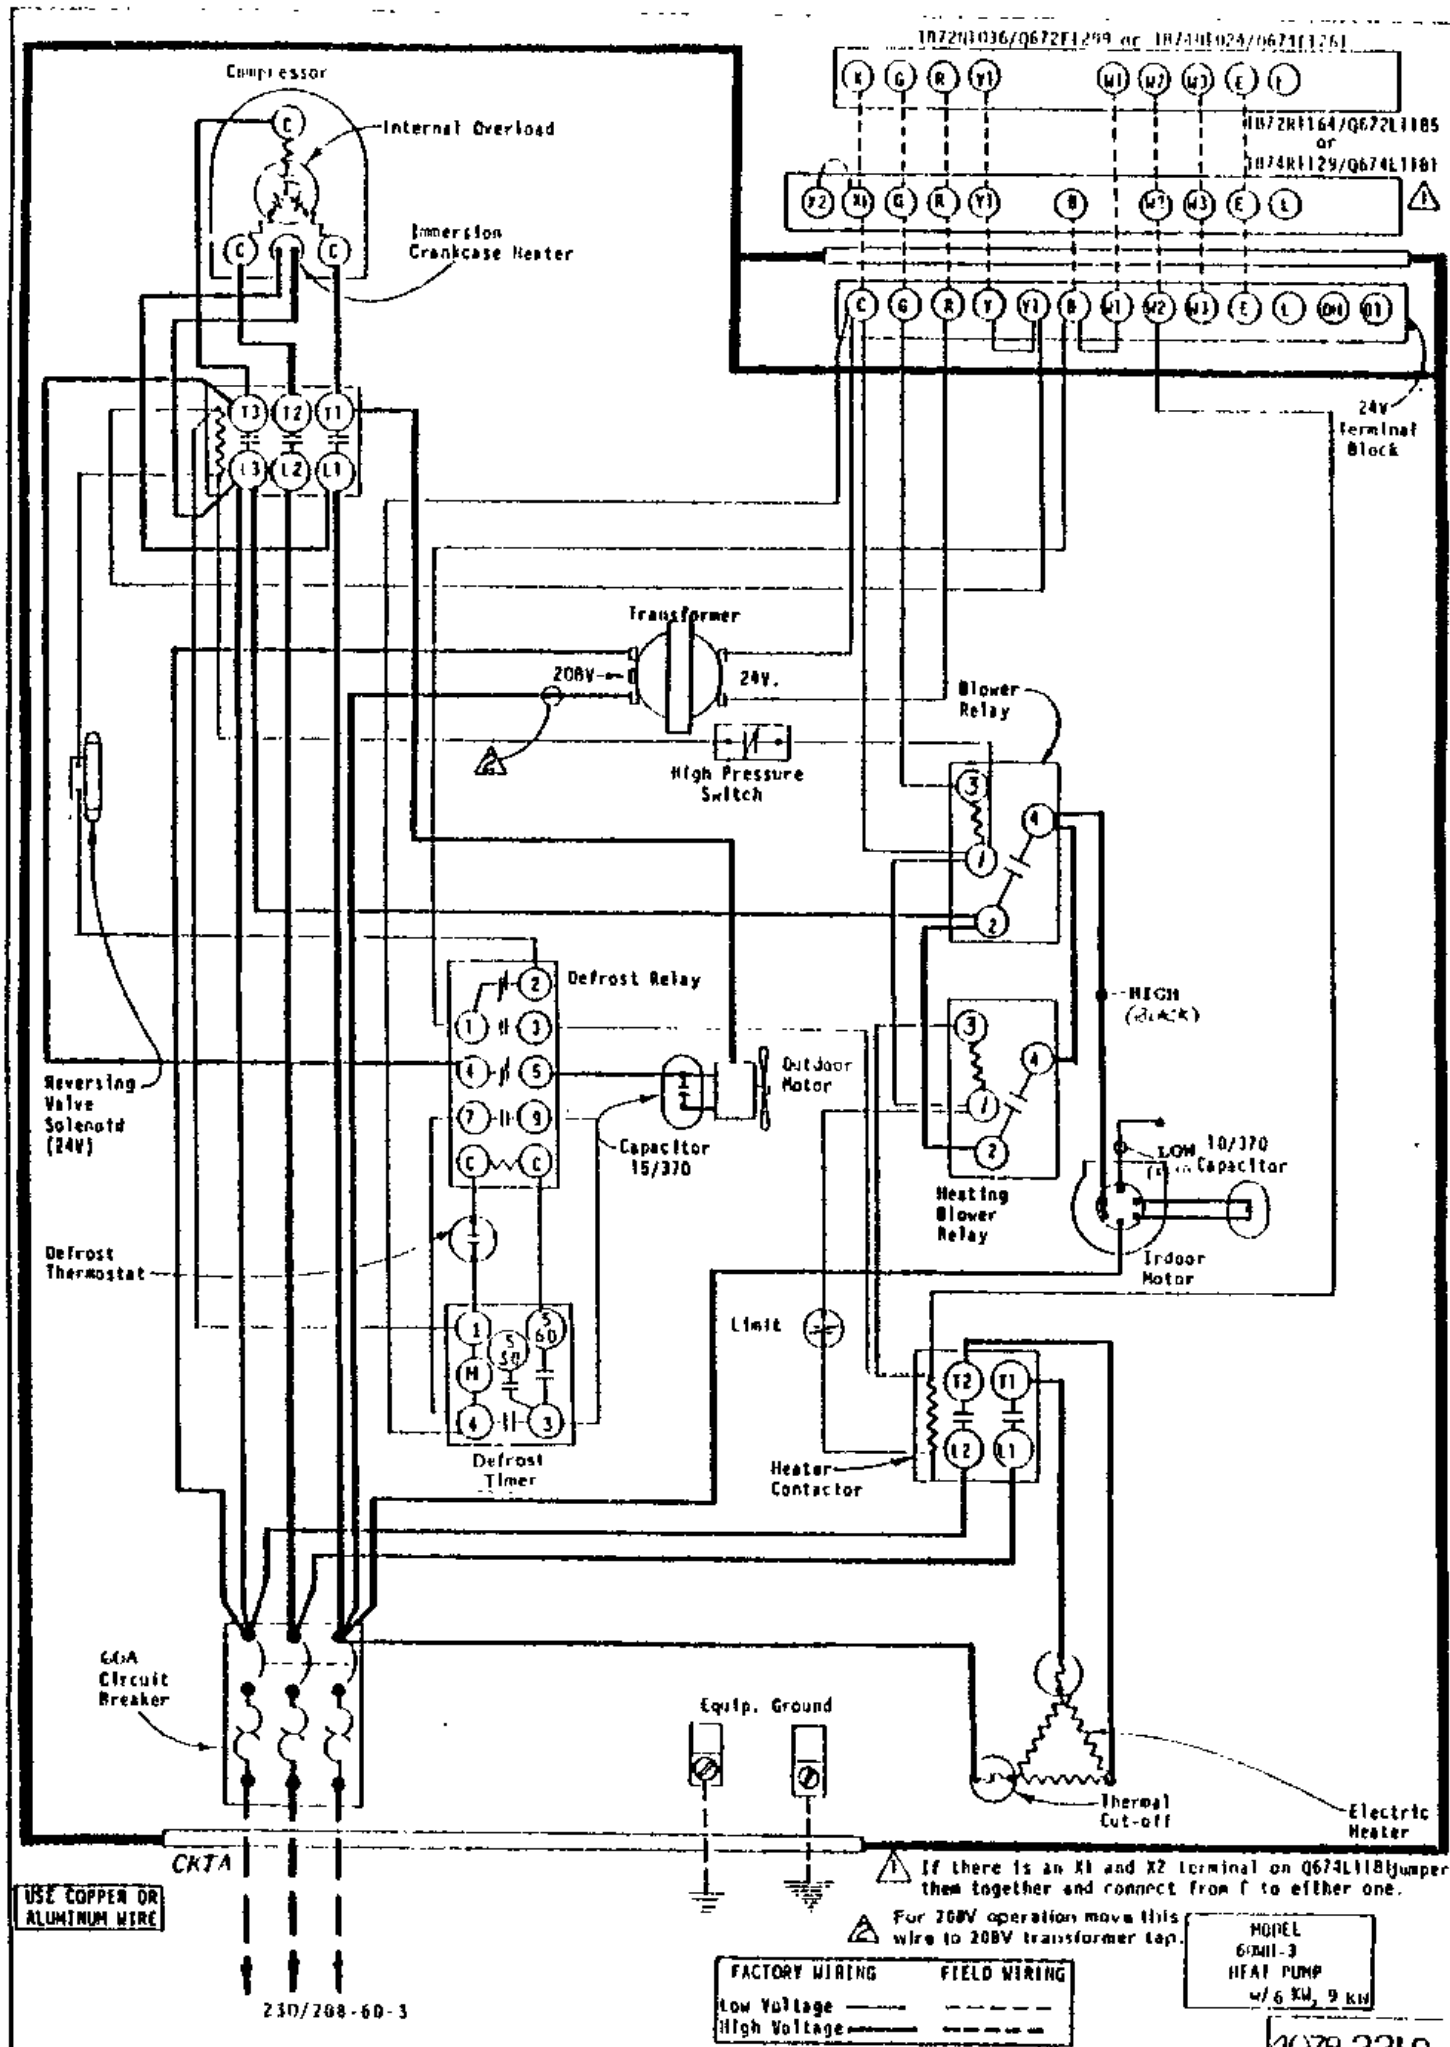


4078-221C

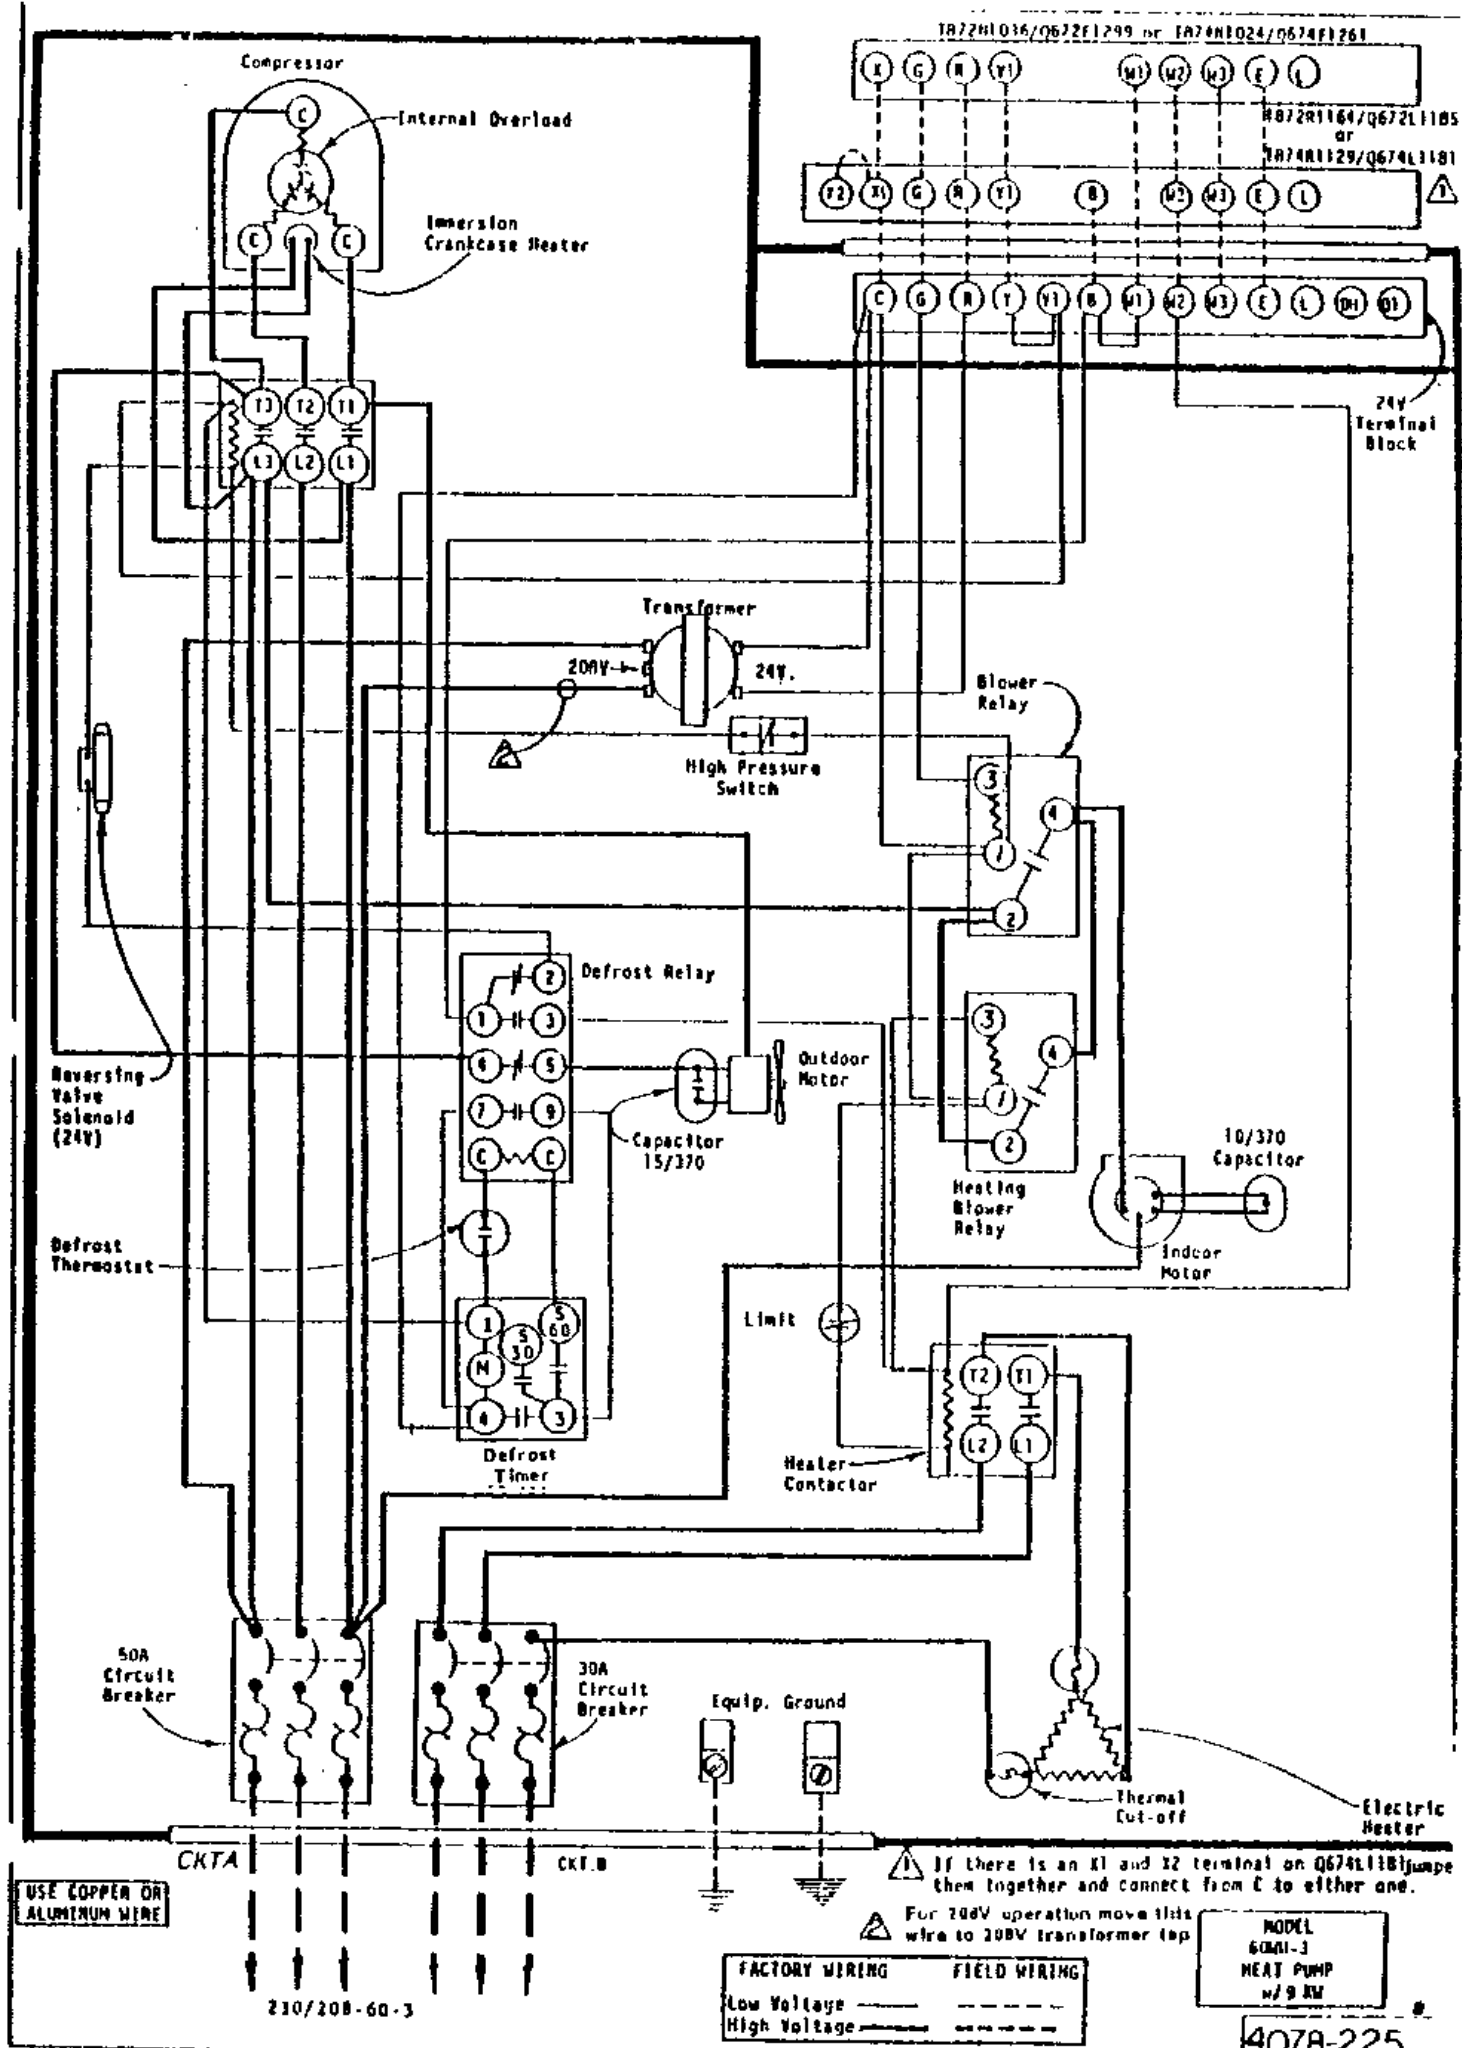



4078-230

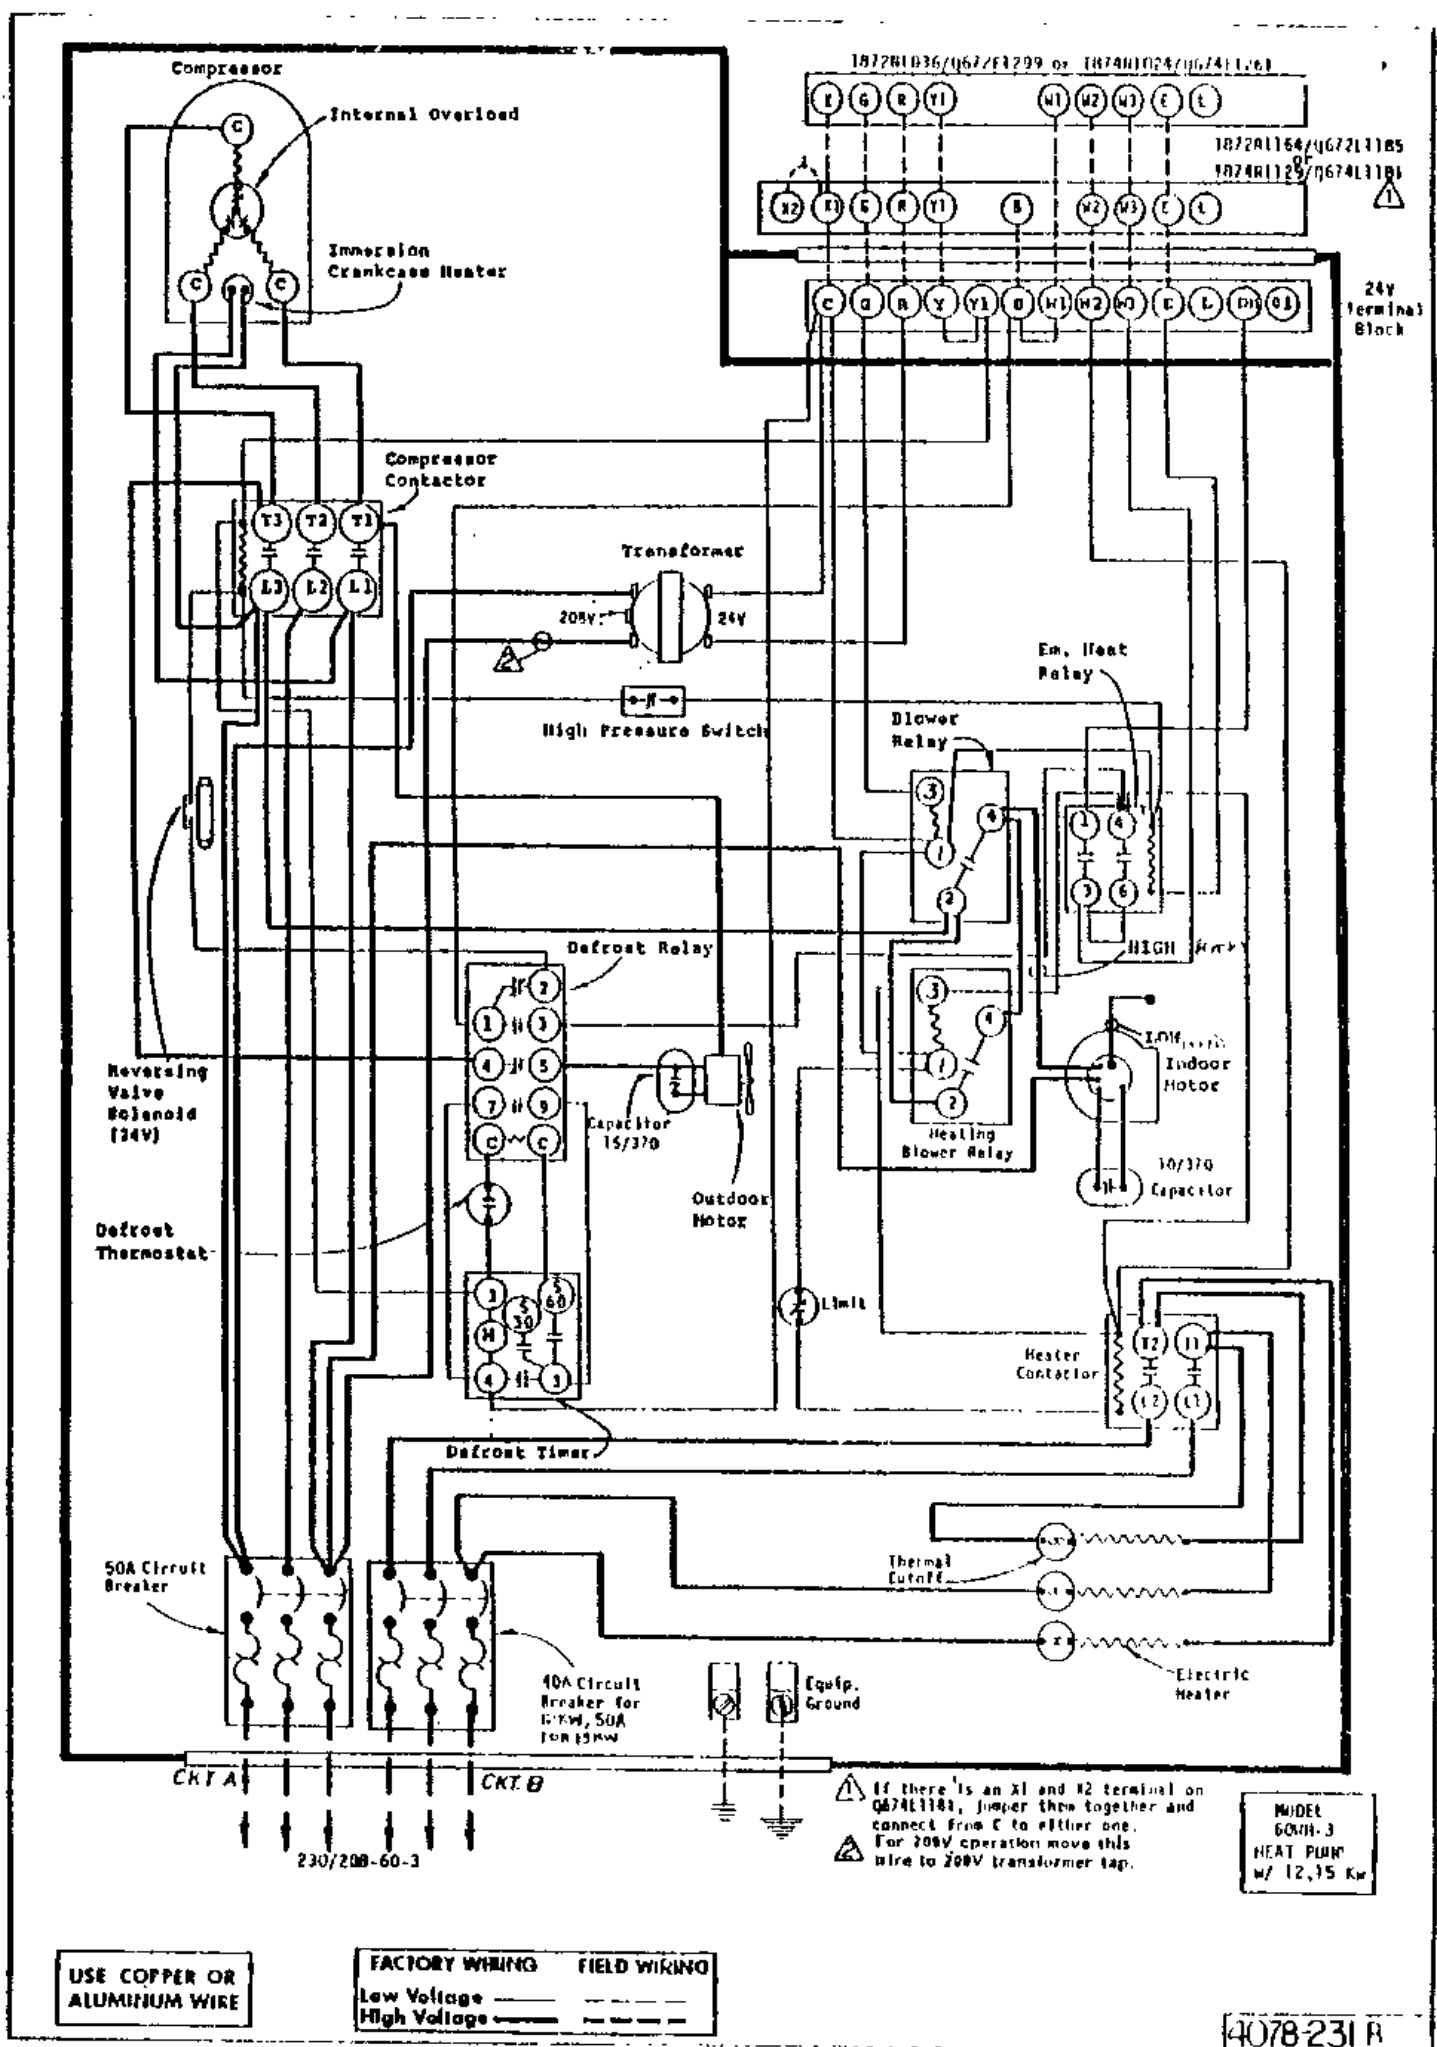

⚠ If there is an X1 and X2 terminal on Q674L1181, jumper them together and connect from C to either one.
⚠ For 208V operation move this wire to 208V transformer tap.

MODEL 60NH-3
HEAT PUMP
w/ 12, 15 Kw

USE COPPER OR
ALUMINUM WIRE

	FACTORY WIRING	FIELD WIRING
Low Voltage	_____	_____
High Voltage	_____	_____

4078-231 R

